


160 Veranda Street
 Portland, Maine 04103
 T: 207.221.2340
 F: 207.221.2346
 Web: www.allied-eng.com

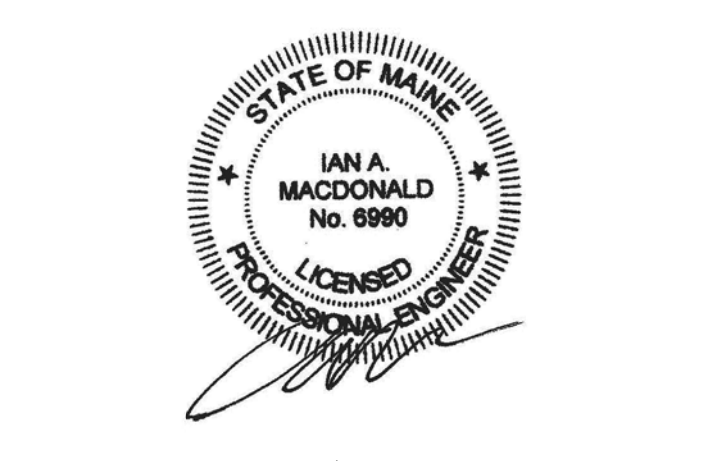


Graphic Scale: 1" = 10' 0" 1"

The Park Danforth

777 Stevens Ave, Portland, ME, 04103

NO.	DESCRIPTION	DATE
1	Addendum No. 2	2015-06-25

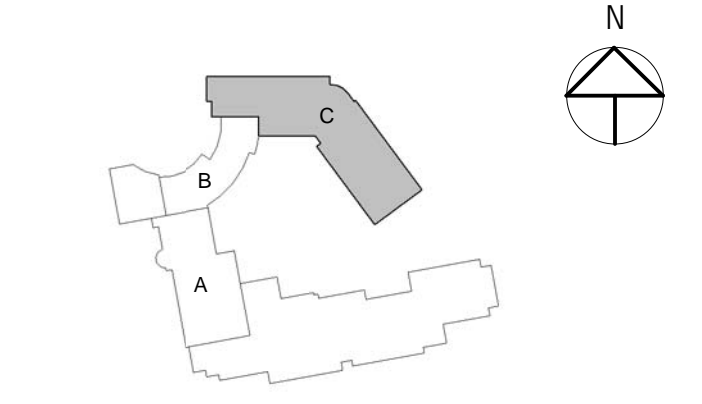


CONTENT:	
MECHANICAL PART PLAN - LEVEL 1 - NEW BUILDING	
DRAWN BY:	REW
PROJECT NO.:	
DATE:	06/05/2015
REVISED:	
SCALE:	AS NOTED

MH1.1C

Project Phase
 100% CONSTRUCTION DOCUMENTS

COPYRIGHT © 2014 BY LAVALLEE BRENSINGER PROFESSIONAL ASSOCIATION. ALL RIGHTS RESERVED. NO REPRODUCTION WITHOUT PERMISSION.

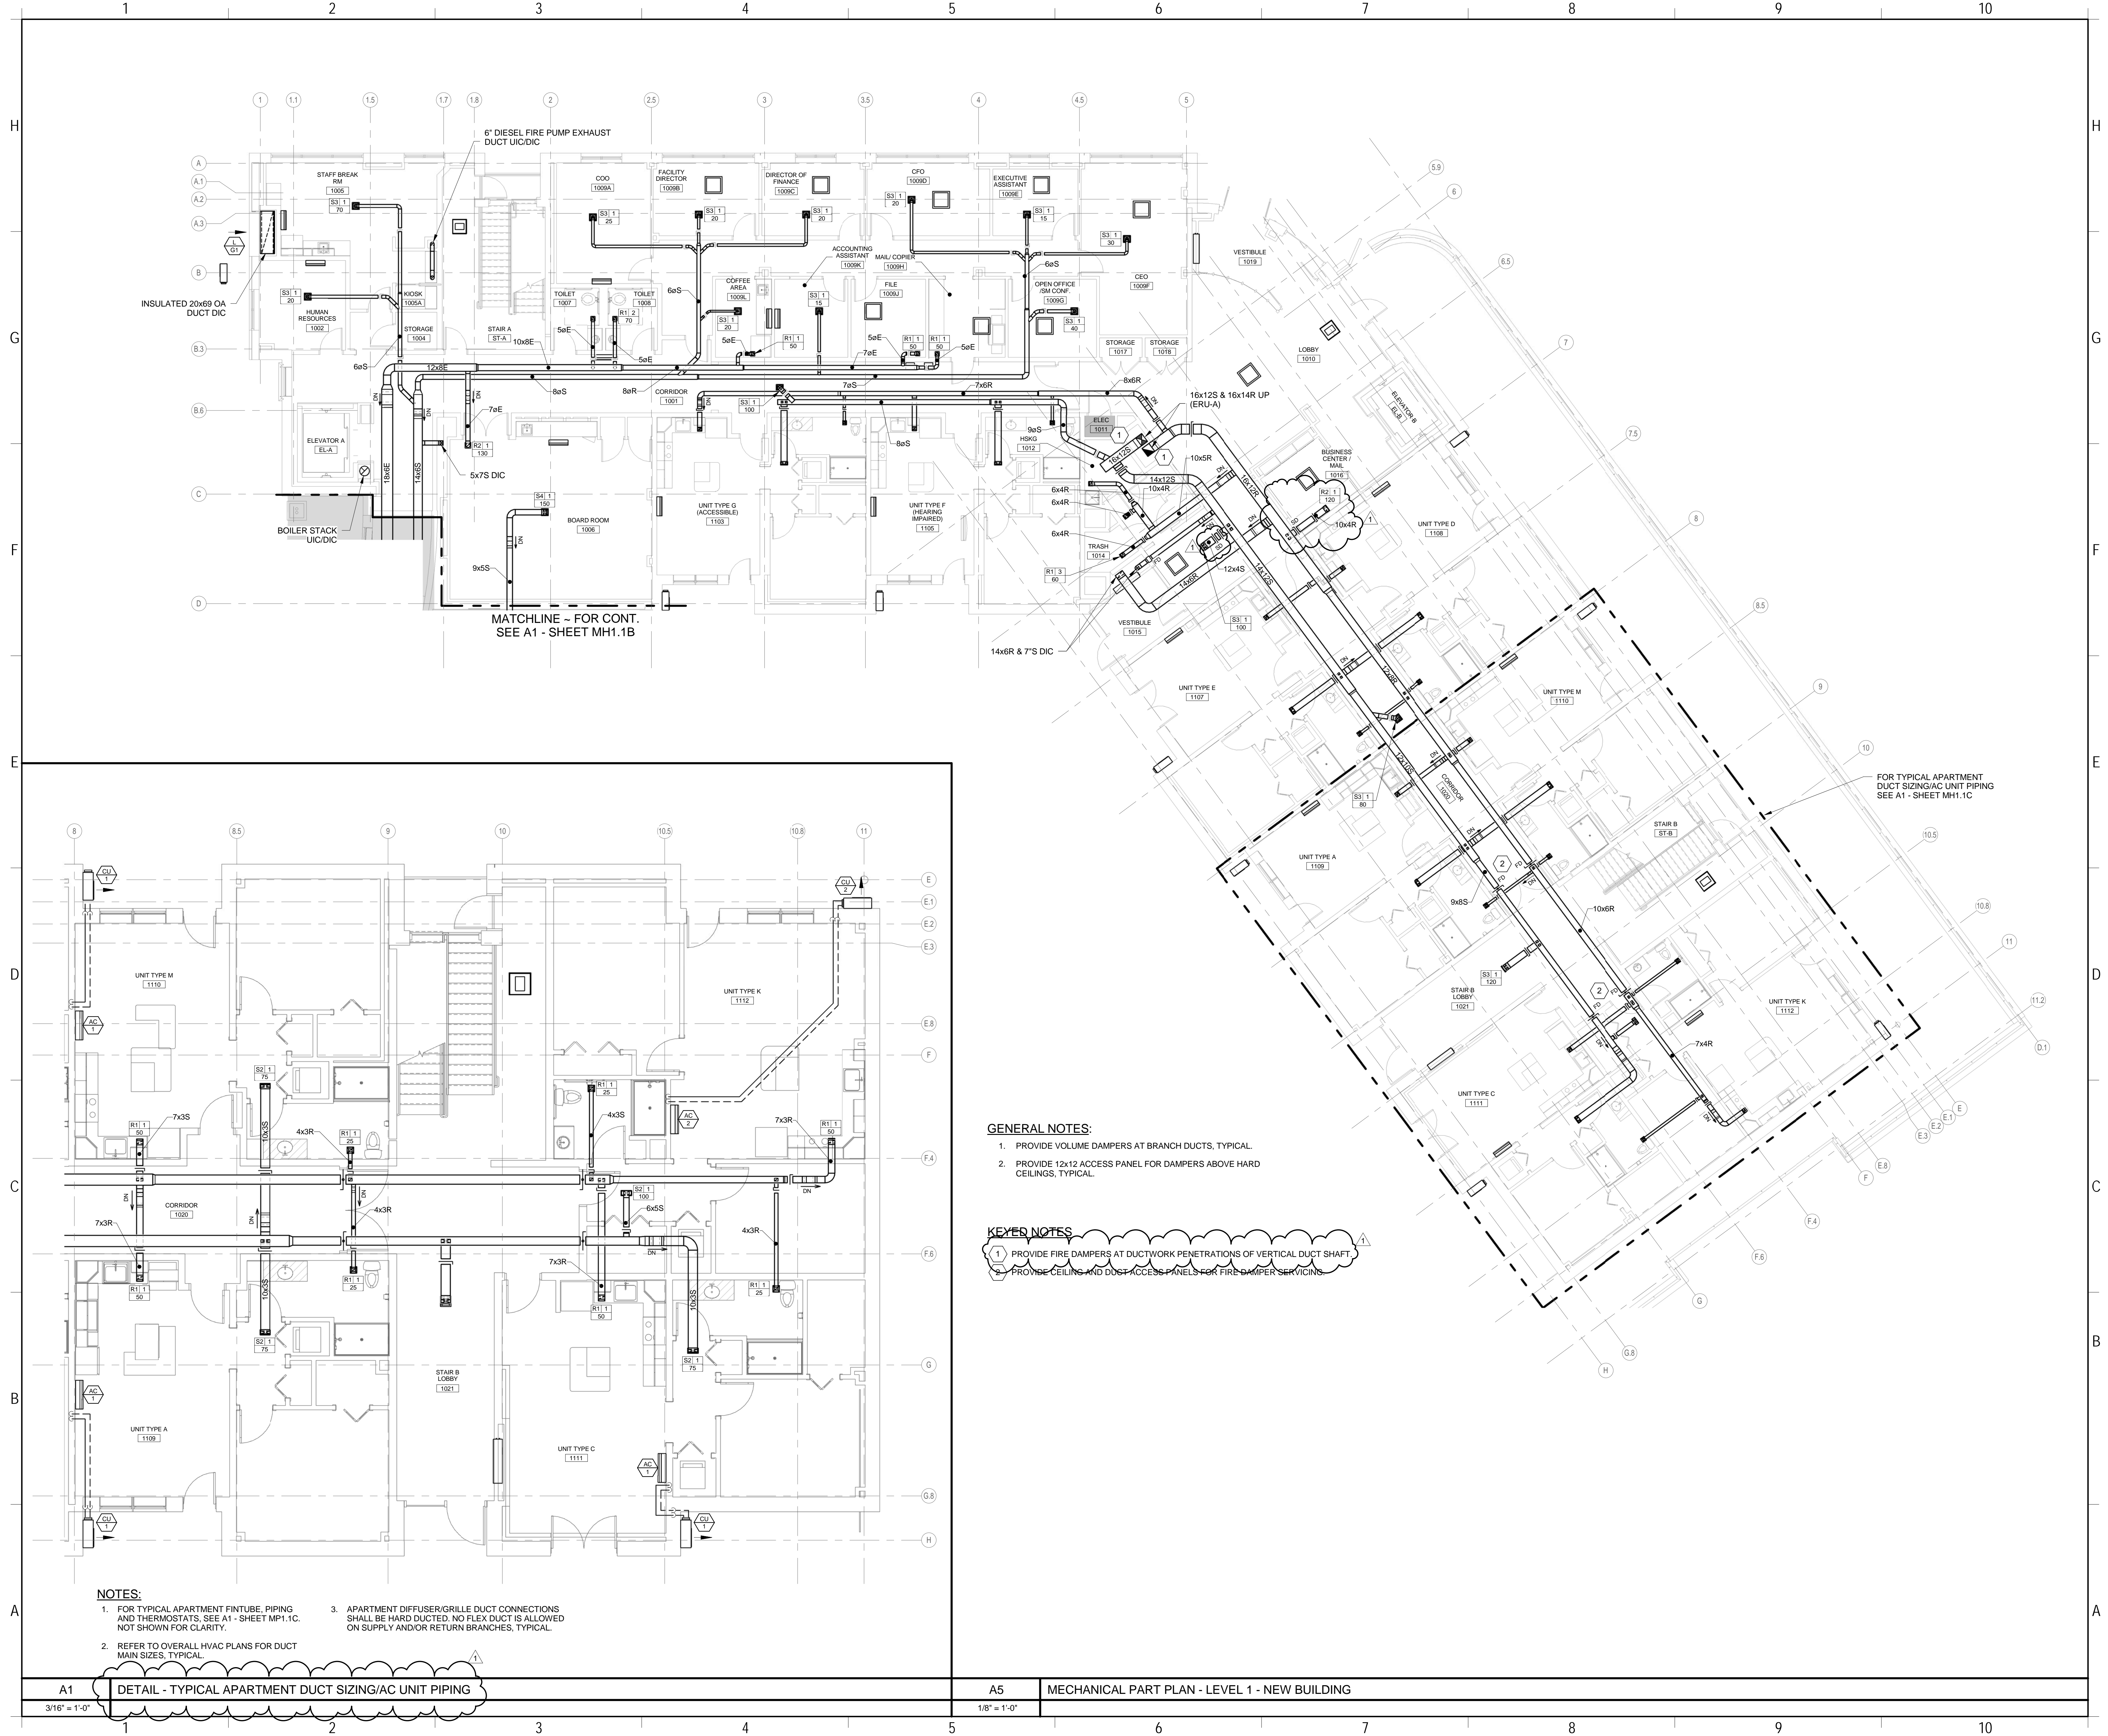

MATCHLINE - FOR CONT.
 SEE A1 - SHEET MH1.1B

FOR TYPICAL APARTMENT
 DUCT SIZING/AC UNIT PIPING
 SEE A1 - SHEET MH1.1C

- GENERAL NOTES:**
1. PROVIDE VOLUME DAMPERS AT BRANCH DUCTS, TYPICAL.
 2. PROVIDE 12x12 ACCESS PANEL FOR DAMPERS ABOVE HARD CEILINGS, TYPICAL.

- KEYED NOTES:**
1. PROVIDE FIRE DAMPERS AT DUCTWORK PENETRATIONS OF VERTICAL DUCT SHAFT.
 2. PROVIDE CEILING AND DUCT ACCESS PANELS FOR FIRE DAMPER SERVICES.

- NOTES:**
1. FOR TYPICAL APARTMENT FIN/TUBE, PIPING AND THERMOSTATS, SEE A1 - SHEET MF1.1C. NOT SHOWN FOR CLARITY.
 2. REFER TO OVERALL HVAC PLANS FOR DUCT MAIN SIZES, TYPICAL.
 3. APARTMENT DIFFUSER/GRILLE DUCT CONNECTIONS SHALL BE HARD DUCTED. NO FLEX DUCT IS ALLOWED ON SUPPLY AND/OR RETURN BRANCHES, TYPICAL.

6/29/2015 9:56:52 AM N:\Projects\2015\161-0108 - Park Danforth\00 Drawing Files - REV\17 20151008.dwg