

160 Veranda Street  
 Portland, Maine 04103  
 T: 207.221.2340  
 F: 207.221.2346  
 Web: www.allied-eng.com




Graphic Scale: 1" = 10' 0" 1" = 10' 0" 1" = 10' 0"


The Park Danforth

777 Stevens Ave, Portland, ME, 04103

NO.	DESCRIPTION	DATE
1	Addendum No. 2	2015-06-25

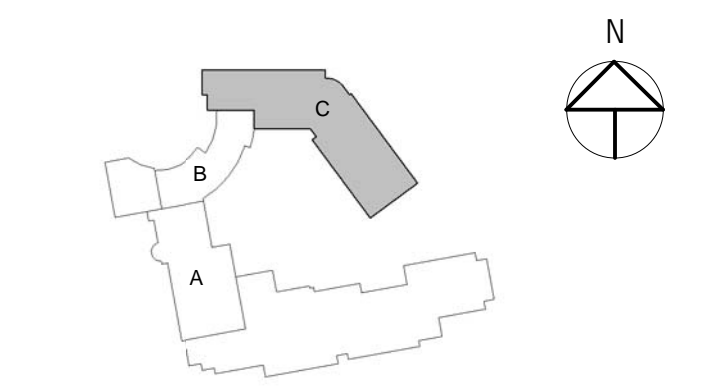

CONTENT: MECHANICAL PIPING PLAN - LEVEL 2 - NEW BUILDING	
DRAWN BY:	REW
PROJECT NO.:	
DATE:	06/05/2015
REVISED:	
SCALE:	AS NOTED
<b>MP1.2C</b>	
Project Phase: 100% CONSTRUCTION DOCUMENTS	
<small>COPYRIGHT © 2014 BY LAVALLEE BRENSINGER PROFESSIONAL ASSOCIATION. ALL RIGHTS RESERVED. NO REPRODUCTION WITHOUT PERMISSION.</small>	

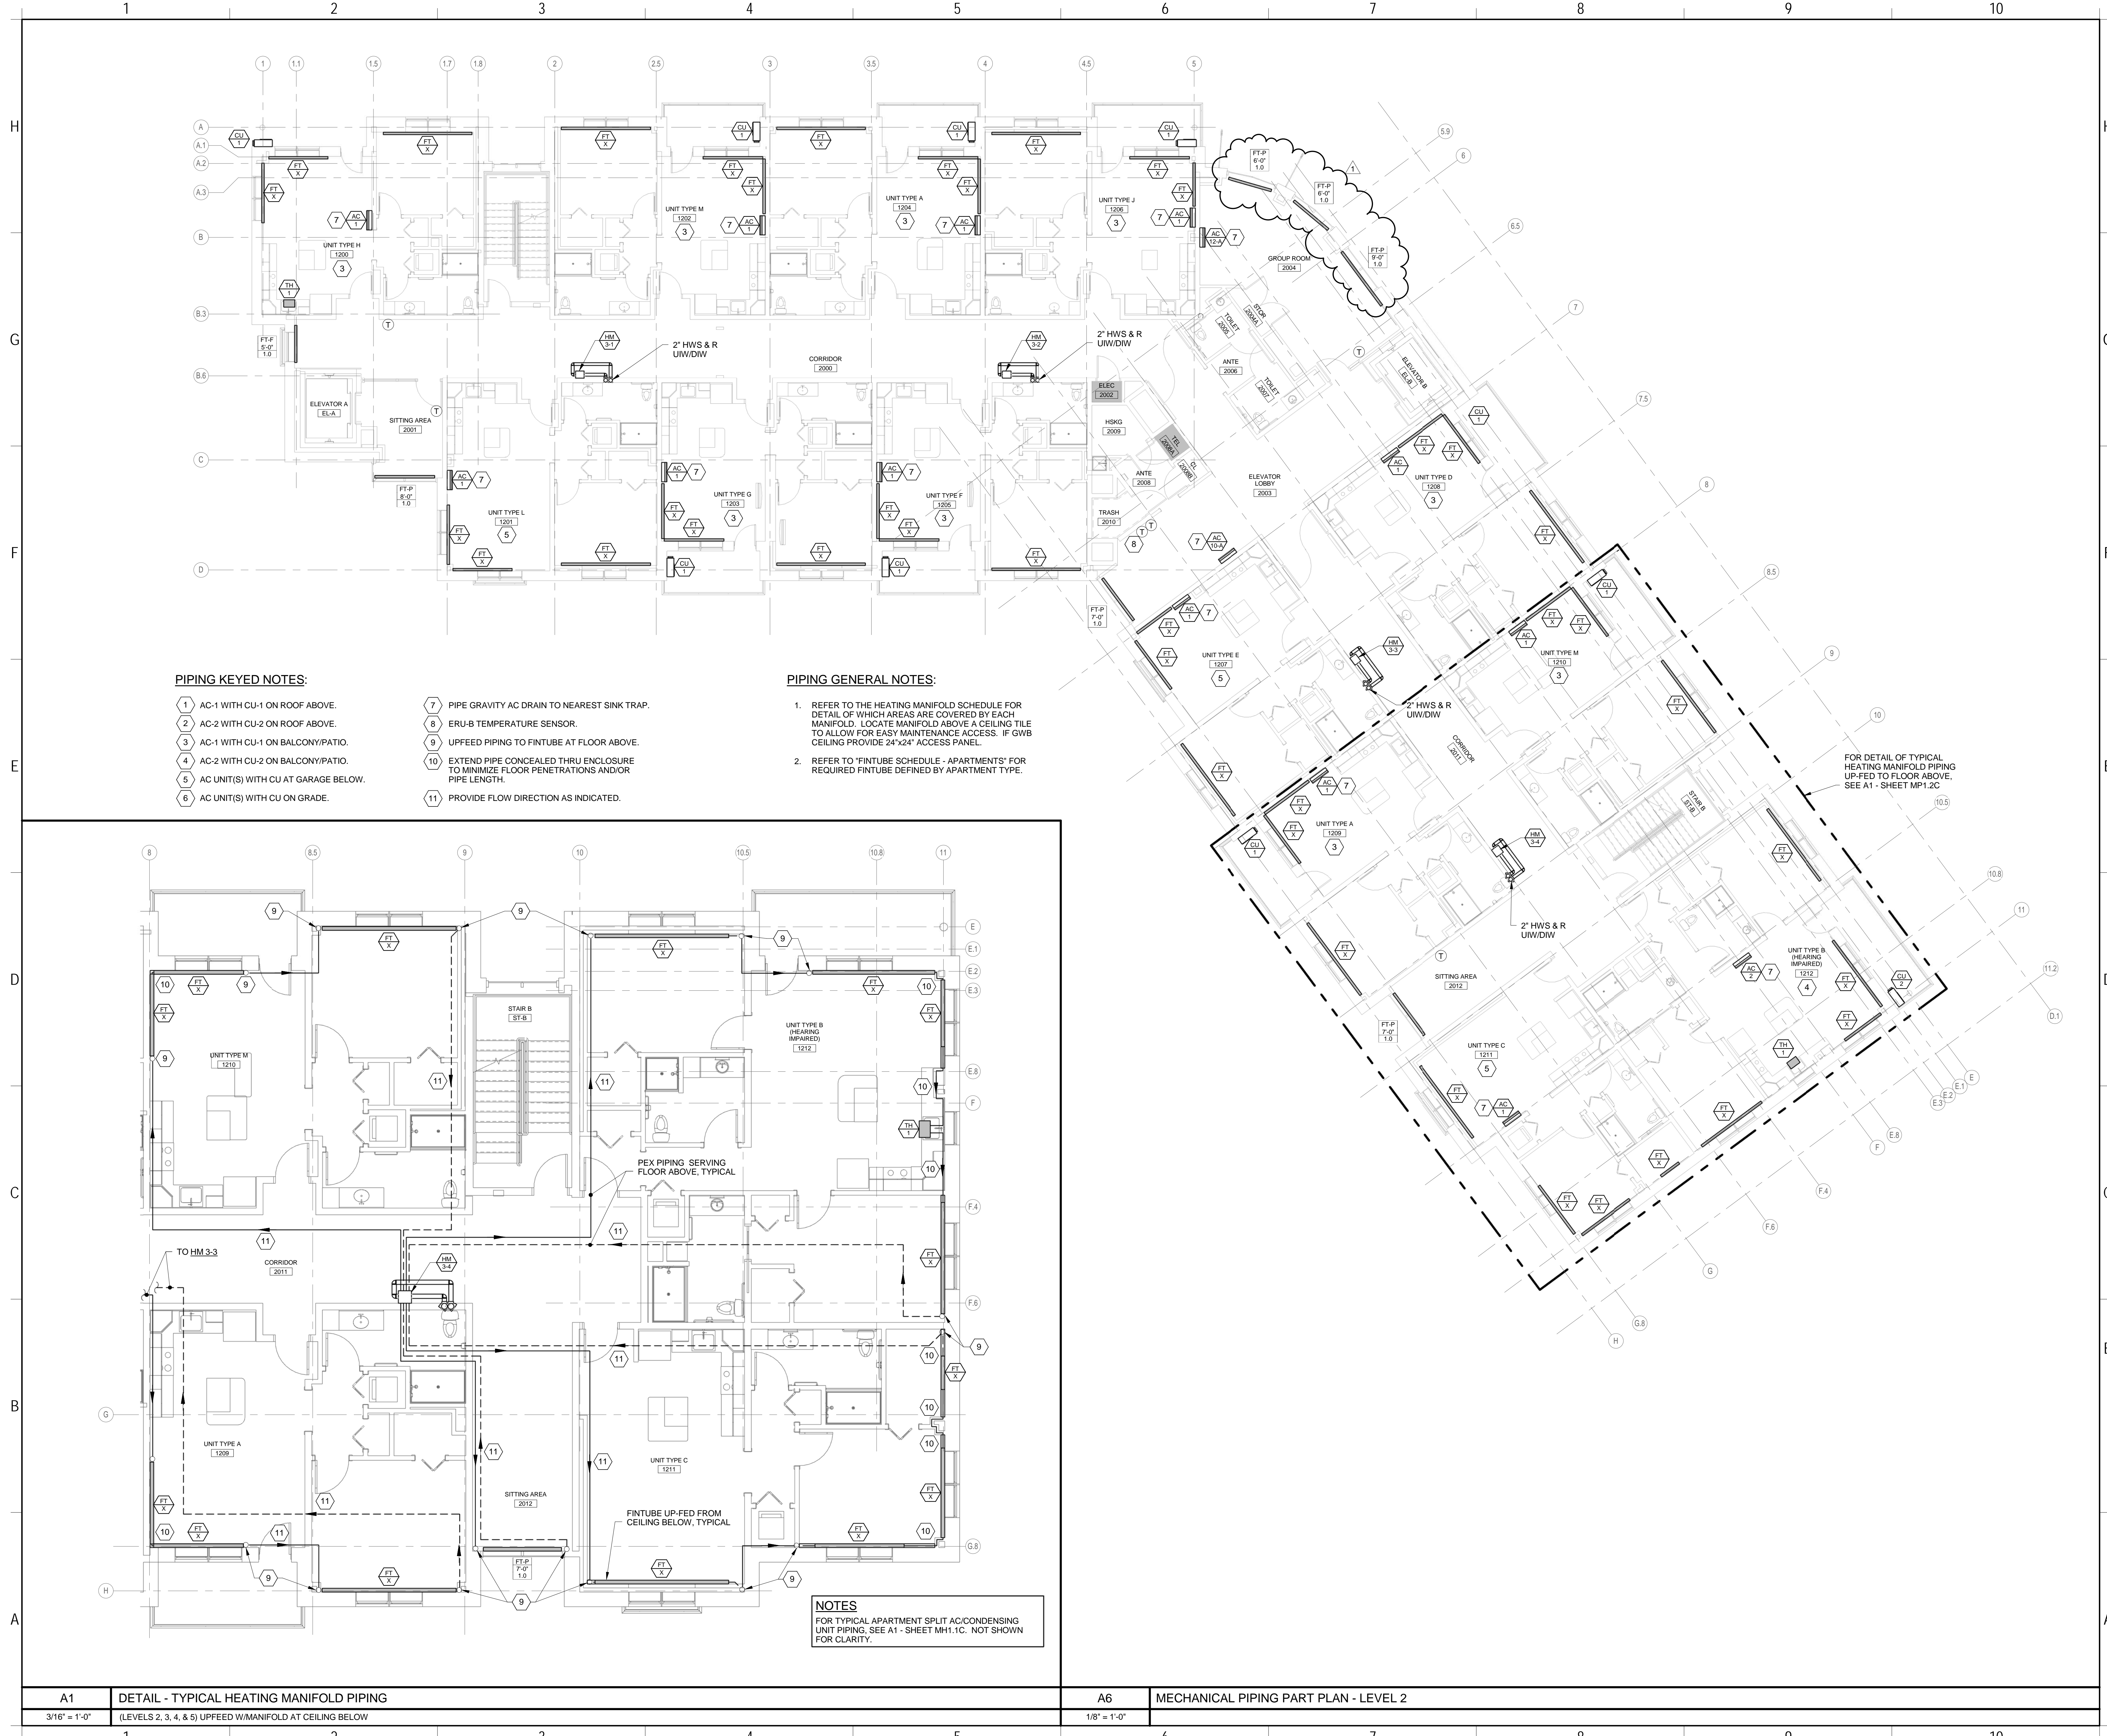

**PIPING KEYED NOTES:**

- 1 AC-1 WITH CU-1 ON ROOF ABOVE.
- 2 AC-2 WITH CU-2 ON ROOF ABOVE.
- 3 AC-1 WITH CU-1 ON BALCONY/PATIO.
- 4 AC-2 WITH CU-2 ON BALCONY/PATIO.
- 5 AC UNIT(S) WITH CU AT GARAGE BELOW.
- 6 AC UNIT(S) WITH CU ON GRADE.
- 7 PIPE GRAVITY AC DRAIN TO NEAREST SINK TRAP.
- 8 ERU-B TEMPERATURE SENSOR.
- 9 UPFEED PIPING TO FINITUBE AT FLOOR ABOVE.
- 10 EXTEND PIPE CONCEALED THRU ENCLOSURE TO MINIMIZE FLOOR PENETRATIONS AND/OR PIPE LENGTH.
- 11 PROVIDE FLOW DIRECTION AS INDICATED.

**PIPING GENERAL NOTES:**

1. REFER TO THE HEATING MANIFOLD SCHEDULE FOR DETAIL OF WHICH AREAS ARE COVERED BY EACH MANIFOLD. LOCATE MANIFOLD ABOVE A CEILING TILE TO ALLOW FOR EASY MAINTENANCE ACCESS. IF GWB CEILING PROVIDE 24"x24" ACCESS PANEL.
2. REFER TO "FINITUBE SCHEDULE - APARTMENTS" FOR REQUIRED FINITUBE DEFINED BY APARTMENT TYPE.

**NOTES**  
 FOR TYPICAL APARTMENT SPLIT AC/CONDENSING UNIT PIPING, SEE A1 - SHEET MH1.1C. NOT SHOWN FOR CLARITY.

<b>A1</b> DETAIL - TYPICAL HEATING MANIFOLD PIPING 3/16" = 1'-0"	<b>A6</b> MECHANICAL PIPING PART PLAN - LEVEL 2 1/8" = 1'-0"
---	---

6/29/2015 9:36:33 AM N:\Projects\2015\161-0108 - Park Danforth\100 Drawing Files - REV\17 2015\1008.MXD