


160 Veranda Street
 Portland, Maine 04103
 T: 207.221.2240
 F: 207.221.2246
 Web: www.allied-eng.com

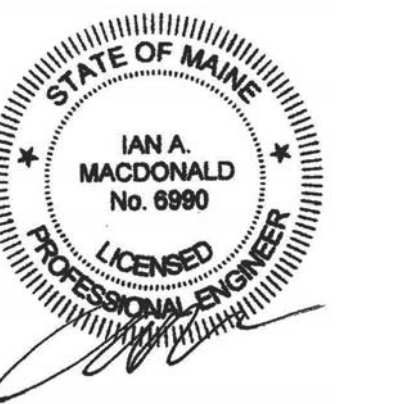


Graphic Scale: 1" = 10'-0"


The Park Danforth

777 Stevens Ave, Portland, ME, 04103

NO.	DESCRIPTION	DATE
1	Addendum No.2	2015-06-25

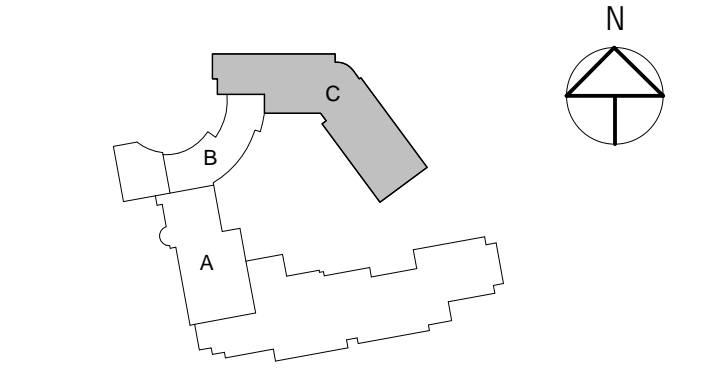

CONTENT: PLUMBING - DRAINAGE GARAGE LEVEL - NEW BUILDING	
DRAWN BY:	SGH
PROJECT NO.:	
DATE:	06/05/2015
REVISED:	
SCALE:	AS NOTED
P1.0C	
Project Phase 100% CONSTRUCTION DOCUMENTS	
<small>COPYRIGHT © 2014 BY LAVALLEE BRENSINGER PROFESSIONAL ASSOCIATION. ALL RIGHTS RESERVED. NO REPRODUCTION WITHOUT PERMISSION.</small>	

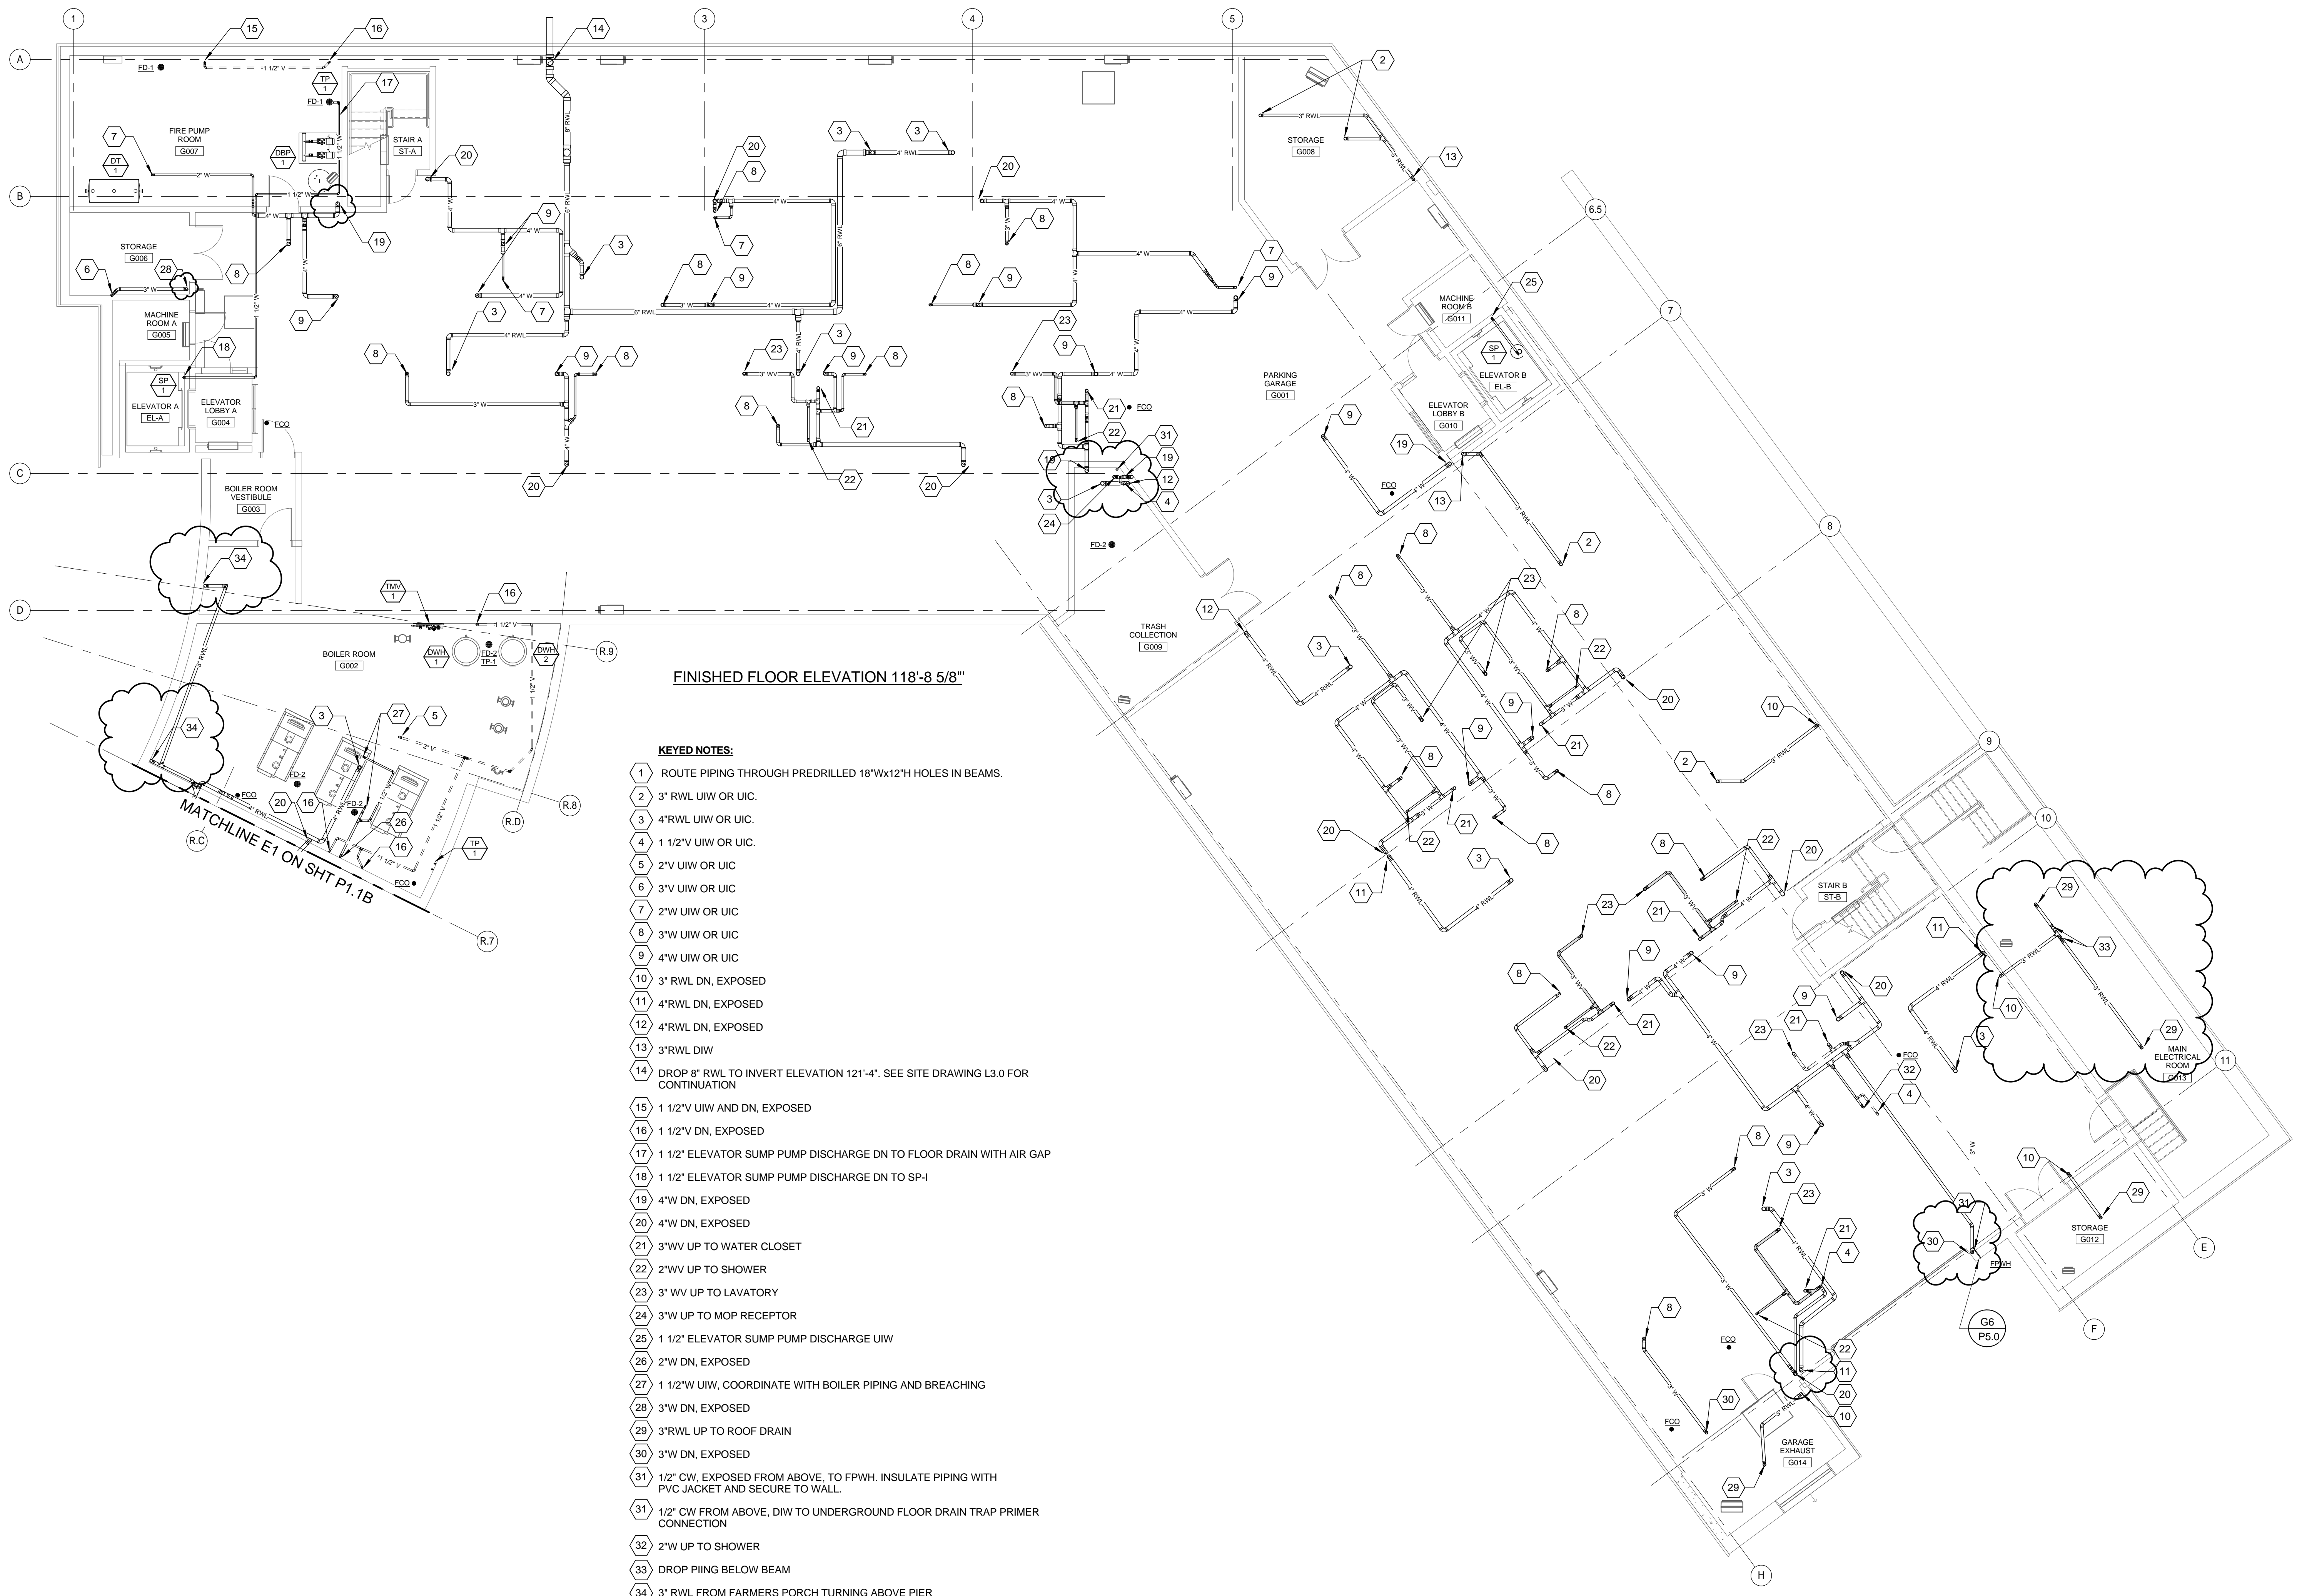

FINISHED FLOOR ELEVATION 118'-8 5/8"

- KEYED NOTES:**
- 1 ROUTE PIPING THROUGH PREDRILLED 18"Wx12"H HOLES IN BEAMS.
 - 2 3" RWL UIW OR UIC.
 - 3 4" RWL UIW OR UIC.
 - 4 1 1/2" UIW OR UIC.
 - 5 2" UIW OR UIC.
 - 6 3" UIW OR UIC.
 - 7 2" UIW OR UIC.
 - 8 3" UIW OR UIC.
 - 9 4" UIW OR UIC.
 - 10 3" RWL DN, EXPOSED
 - 11 4" RWL DN, EXPOSED
 - 12 4" RWL DN, EXPOSED
 - 13 3" RWL DIW
 - 14 DROP 8" RWL TO INVERT ELEVATION 121'-4". SEE SITE DRAWING L3.0 FOR CONTINUATION
 - 15 1 1/2" UIW AND DN, EXPOSED
 - 16 1 1/2" DN, EXPOSED
 - 17 1 1/2" ELEVATOR SUMP PUMP DISCHARGE DN TO FLOOR DRAIN WITH AIR GAP
 - 18 1 1/2" ELEVATOR SUMP PUMP DISCHARGE DN TO SP-I
 - 19 4" W DN, EXPOSED
 - 20 4" W DN, EXPOSED
 - 21 3" W UP TO WATER CLOSET
 - 22 2" W UP TO SHOWER
 - 23 3" W UP TO LAVATORY
 - 24 3" W UP TO MOP RECEPTOR
 - 25 1 1/2" ELEVATOR SUMP PUMP DISCHARGE UIW
 - 26 2" W DN, EXPOSED
 - 27 1 1/2" W UIW, COORDINATE WITH BOILER PIPING AND BRANCHING
 - 28 3" W DN, EXPOSED
 - 29 3" RWL UP TO ROOF DRAIN
 - 30 3" W DN, EXPOSED
 - 31 1/2" CW, EXPOSED FROM ABOVE, TO FPWH. INSULATE PIPING WITH PVC JACKET AND SECURE TO WALL.
 - 31 1/2" CW FROM ABOVE, DIW TO UNDERGROUND FLOOR DRAIN TRAP PRIMER CONNECTION
 - 32 2" W UP TO SHOWER
 - 33 DROP PING BELOW BEAM
 - 34 3" RWL FROM FARMERS PORCH TURNING ABOVE PIER

06/20/2015 8:51:52 AM N:\Projects\2015\11-1018 - Park Danforth\100 Drawing Files - REVIT 2015\1018P1.dwg