


160 Veranda Street
 Portland, Maine 04103
 T: 207.221.2240
 F: 207.221.2246
 Web: www.allied-eng.com

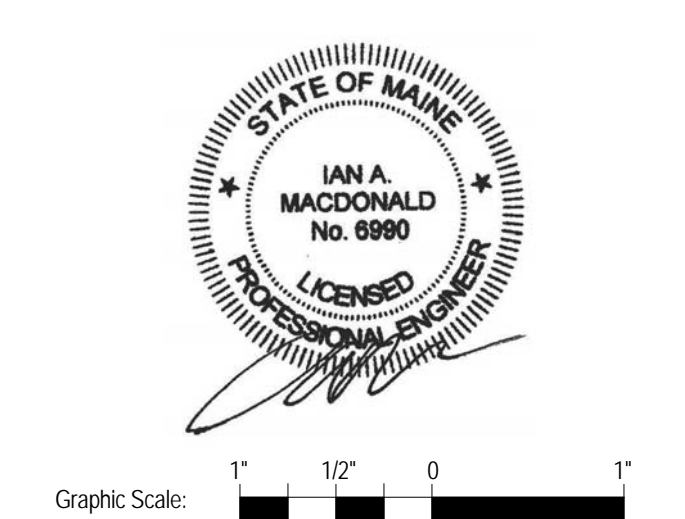


Graphic Scale: 1" = 10' 0"


The Park Danforth

777 Stevens Ave, Portland, ME, 04103



NO.	DESCRIPTION	DATE

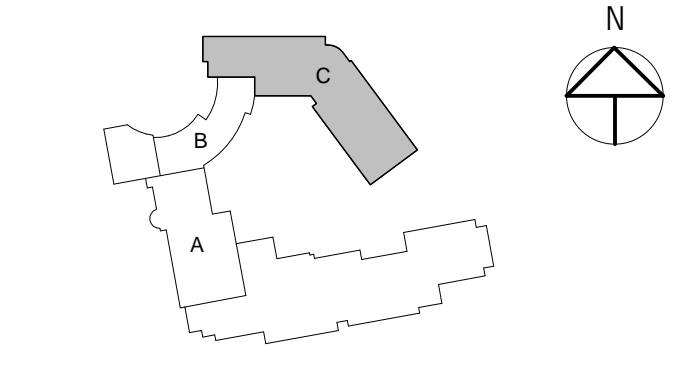

CONTENT: PLUMBING - SUPPLY LEVEL 1 - NEW BUILDING	
DRAWN BY:	SGH
PROJECT NO.:	-
DATE:	06/05/2015
REVISED:	-
SCALE:	AS NOTED
P2.1C	
Project Phase 100% CONSTRUCTION DOCUMENTS	
<small>COPYRIGHT © 2014 BY LAVALLEE BRENSINGER PROFESSIONAL ASSOCIATION. ALL RIGHTS RESERVED. NO REPRODUCTION WITHOUT PERMISSION.</small>	

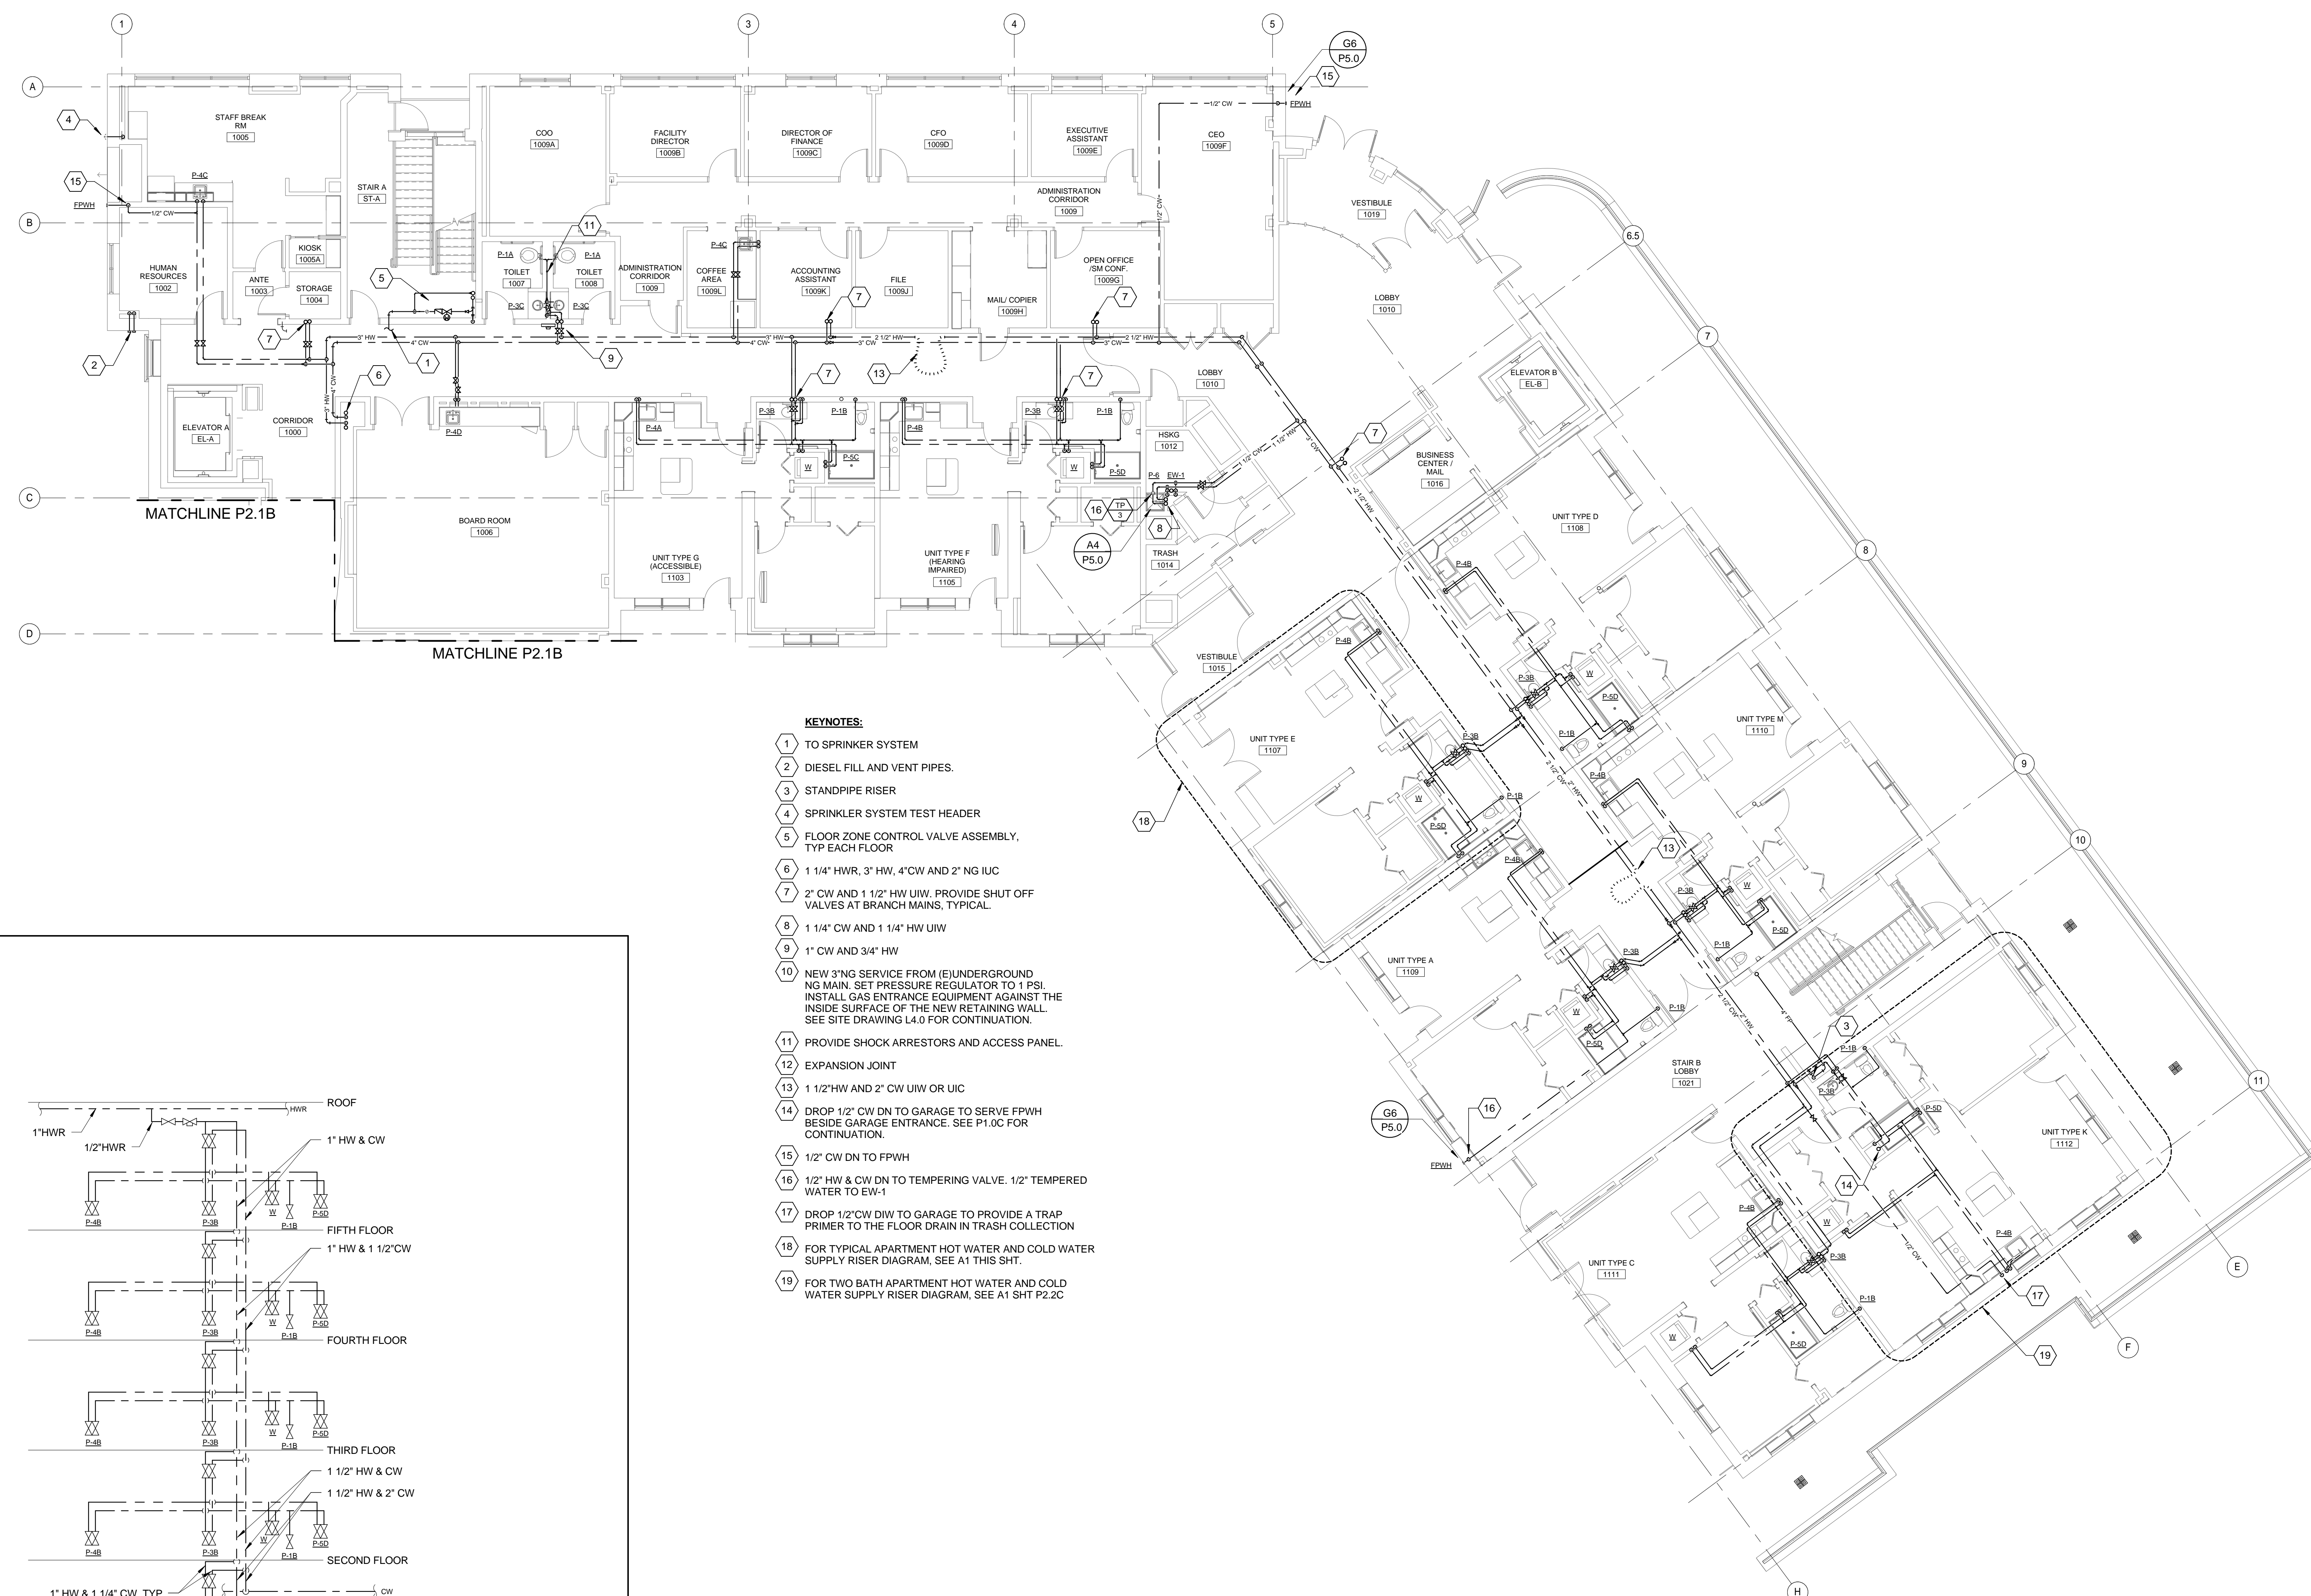

- KEYNOTES:**
- 1 TO SPRINKLER SYSTEM
 - 2 DIESEL FILL AND VENT PIPES.
 - 3 STANDPIPE RISER
 - 4 SPRINKLER SYSTEM TEST HEADER
 - 5 FLOOR ZONE CONTROL VALVE ASSEMBLY, TYP EACH FLOOR
 - 6 1 1/4" HWR, 3" HW, 4" CW AND 2" NG IUC
 - 7 2" CW AND 1 1/2" HW UIW, PROVIDE SHUT OFF VALVES AT BRANCH MAINS, TYPICAL.
 - 8 1 1/4" CW AND 1 1/4" HW UIW
 - 9 1" CW AND 3/4" HW
 - 10 NEW 3" NG SERVICE FROM (E) UNDERGROUND NG MAIN. SET PRESSURE REGULATOR TO 1 PSI. INSTALL GAS ENTRANCE EQUIPMENT AGAINST THE INSIDE SURFACE OF THE NEW RETAINING WALL. SEE SITE DRAWING L4.0 FOR CONTINUATION.
 - 11 PROVIDE SHOCK ARRESTORS AND ACCESS PANEL.
 - 12 EXPANSION JOINT
 - 13 1 1/2" HW AND 2" CW UIW OR IUC
 - 14 DROP 1/2" CW DN TO GARAGE TO SERVE FPWH BESIDE GARAGE ENTRANCE. SEE P1.0C FOR CONTINUATION.
 - 15 1/2" CW DN TO FPWH
 - 16 1/2" HW & CW DN TO TEMPERING VALVE. 1/2" TEMPERED WATER TO EW-1
 - 17 DROP 1/2" CW DIW TO GARAGE TO PROVIDE A TRAP PRIMER TO THE FLOOR DRAIN IN TRASH COLLECTION
 - 18 FOR TYPICAL APARTMENT HOT WATER AND COLD WATER SUPPLY RISER DIAGRAM, SEE A1 THIS SHT.
 - 19 FOR TWO BATH APARTMENT HOT WATER AND COLD WATER SUPPLY RISER DIAGRAM, SEE A1 SHT P2.2C

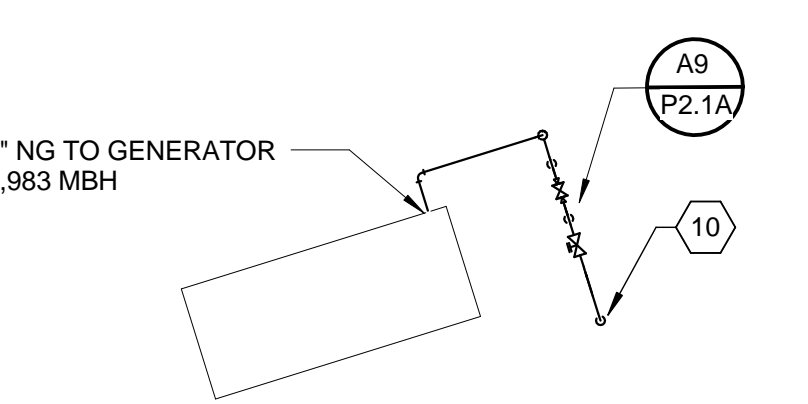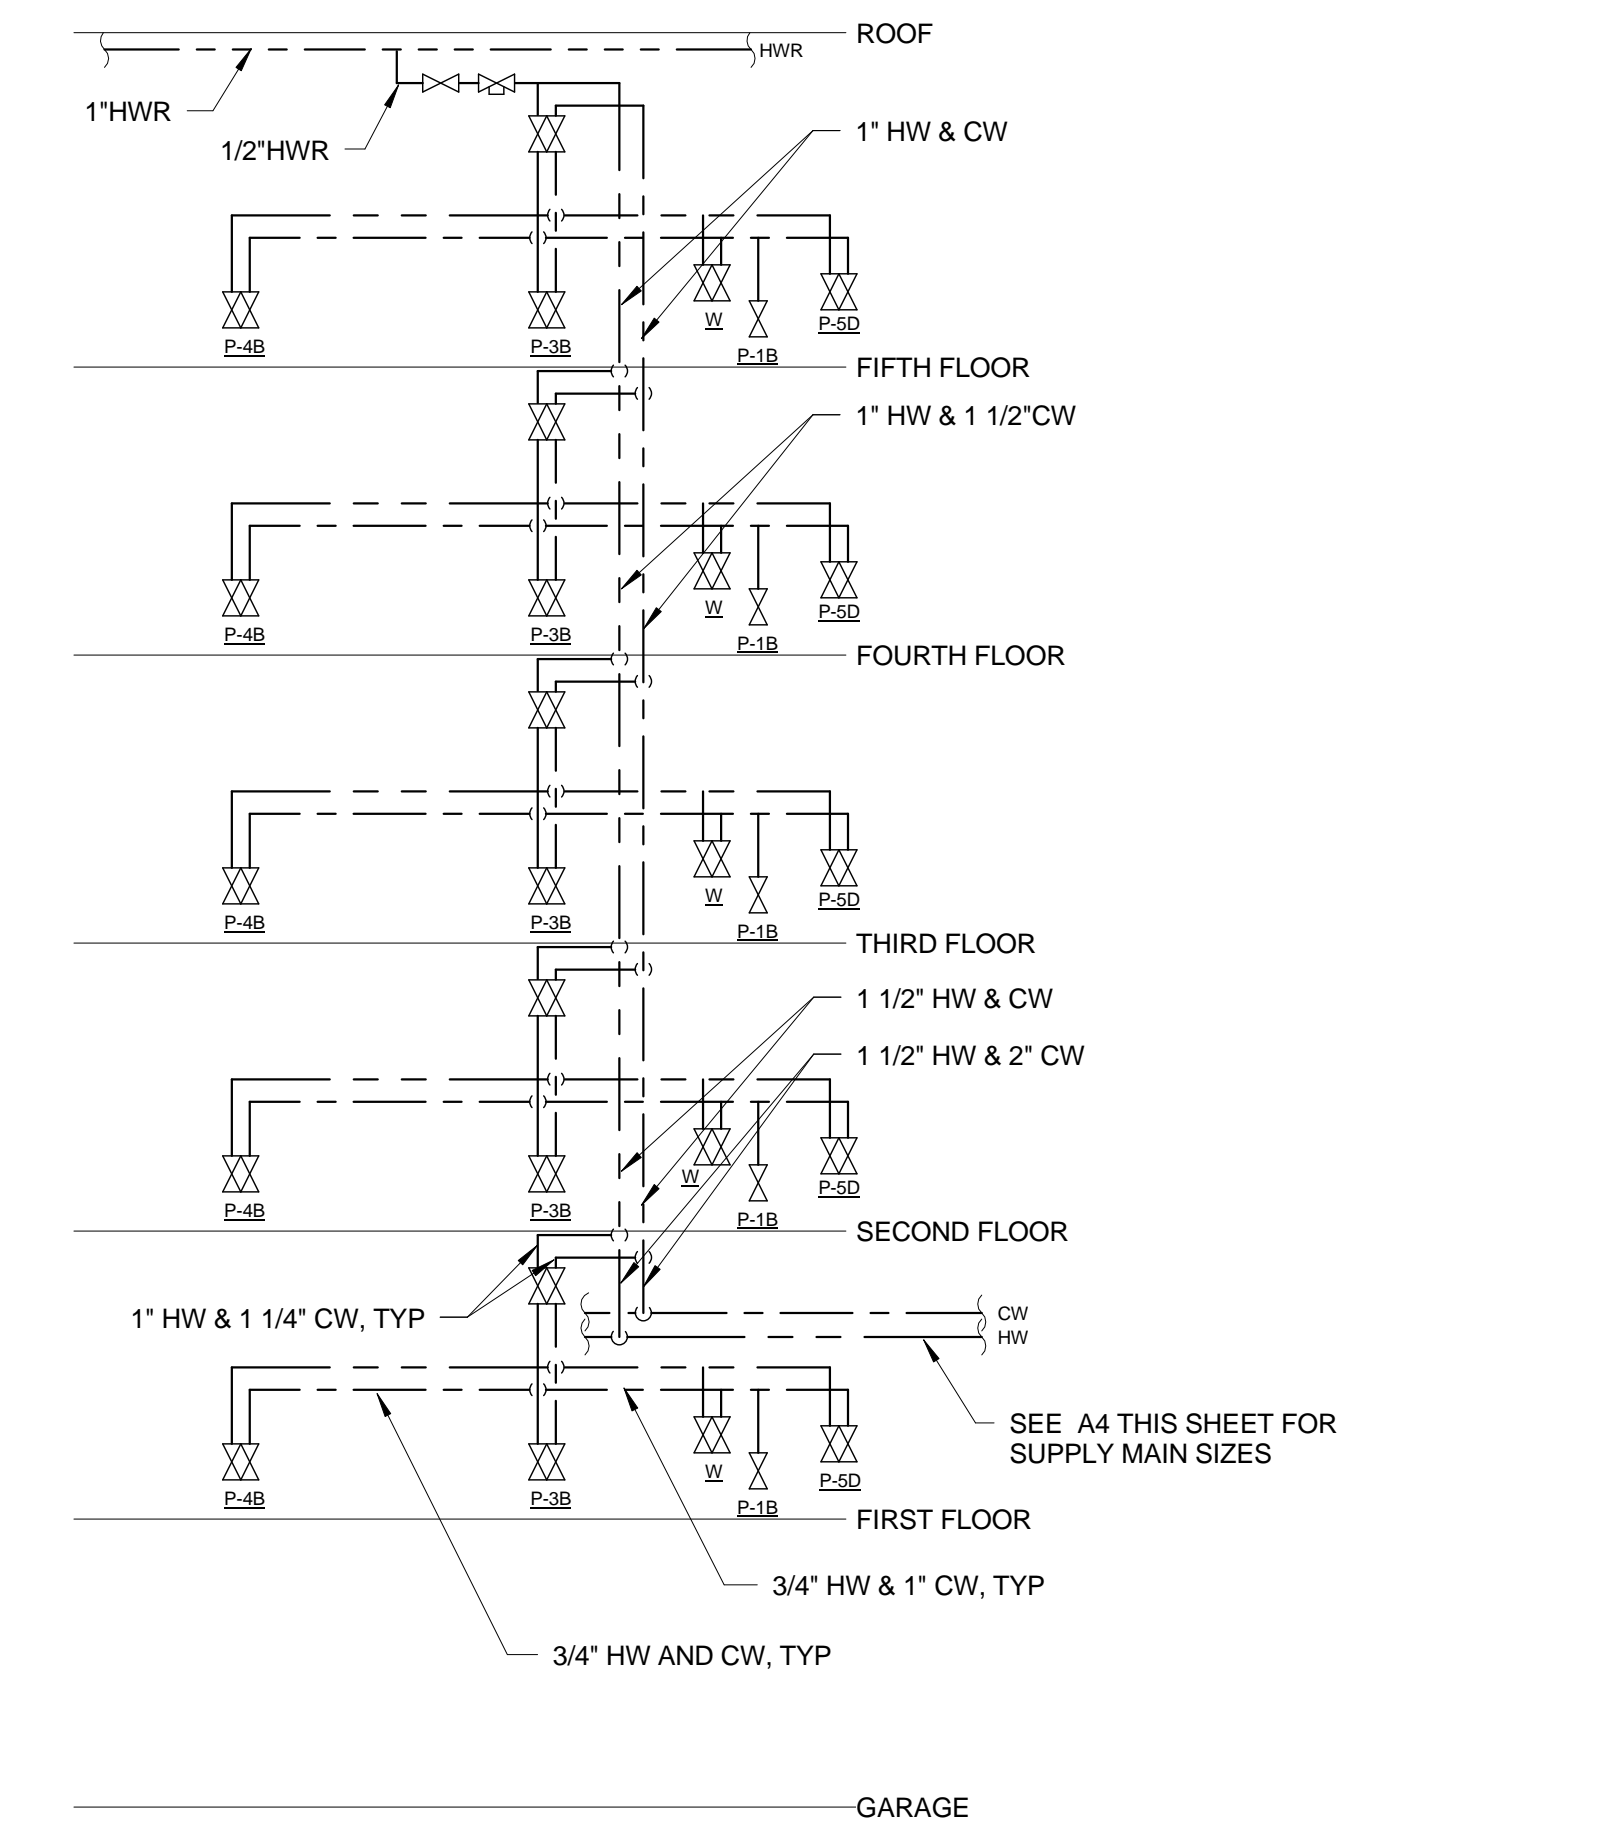

06/20/15 9:20:00 AM N:\Projects\2015\141018 - Park Danforth\00 Drawing Files - REVIT\2015\141018.rvt