
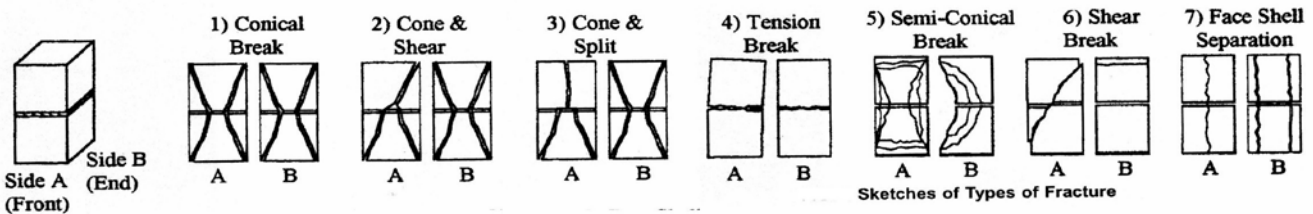


**Report of Masonry Prism
Compressive Strength Test
ASTM C1314**

Project Name: Portland, ME - The Park Danforth
Client: The Park Danforth
Supplier: Gagne Block

Project No: 14-0065.2
Date Specimens Made: 4-25-16
Block Type: 8" Stretcher Block
Design Strength N/A

Lab ID	Spec. Age (Days)	Length (in)	Width (in)	Capped Height (in)	h_p/t_p Ratio	Net Area (in ²)	Gross Area (in ²)	Load (kips)	Initial Strength (psi)	Correction Factor	Strength (psi)	Break Type
20761G	8	15.5	7.63	15.81	2.07	64.81	118.27	264.4	4080	1.05	4280	6
20762G	28											
20763G	28											

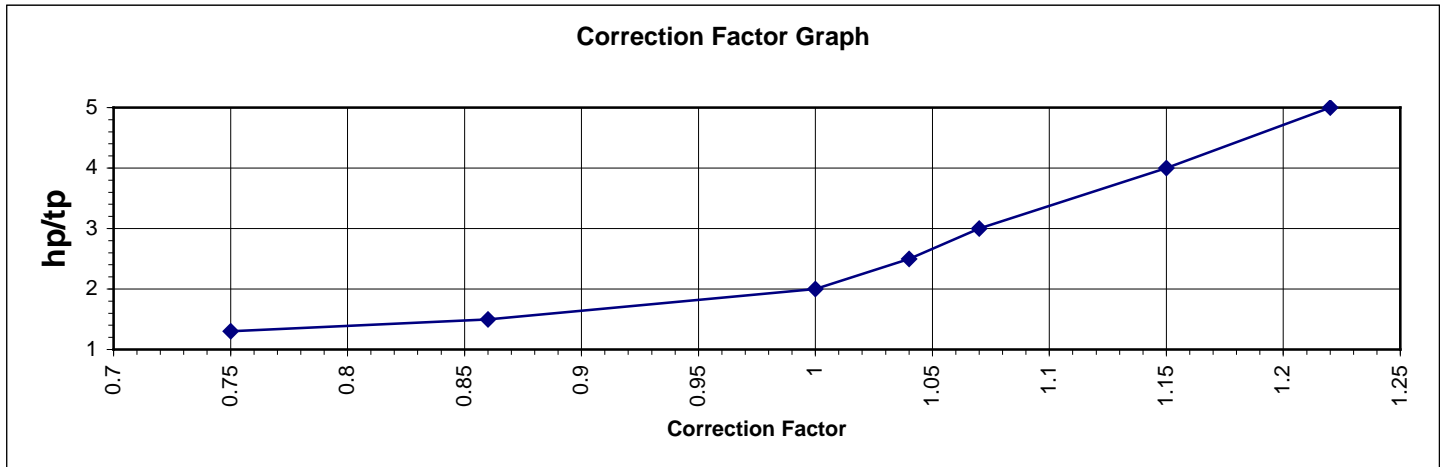

Remarks: 730 - 59