


Report of Moisture-Density

Method ASTM D-1557 MODIFIED Procedure C

Project Name PORTLAND ME - THE PARK DANFORTH - CONSTRUCTION
MATERIALS TESTING SERVICES
Client THE PARK-DANFORTH
Material Type AGGREGATE BASE
Material Source SHAW BROTHERS S-PIT

Project Number 14-0065.2
Lab ID 20078G
Date Received 10/22/2015
Date Completed 10/22/2015
Tested By PAUL SHAFFER

Moisture-Density Relationship Curve

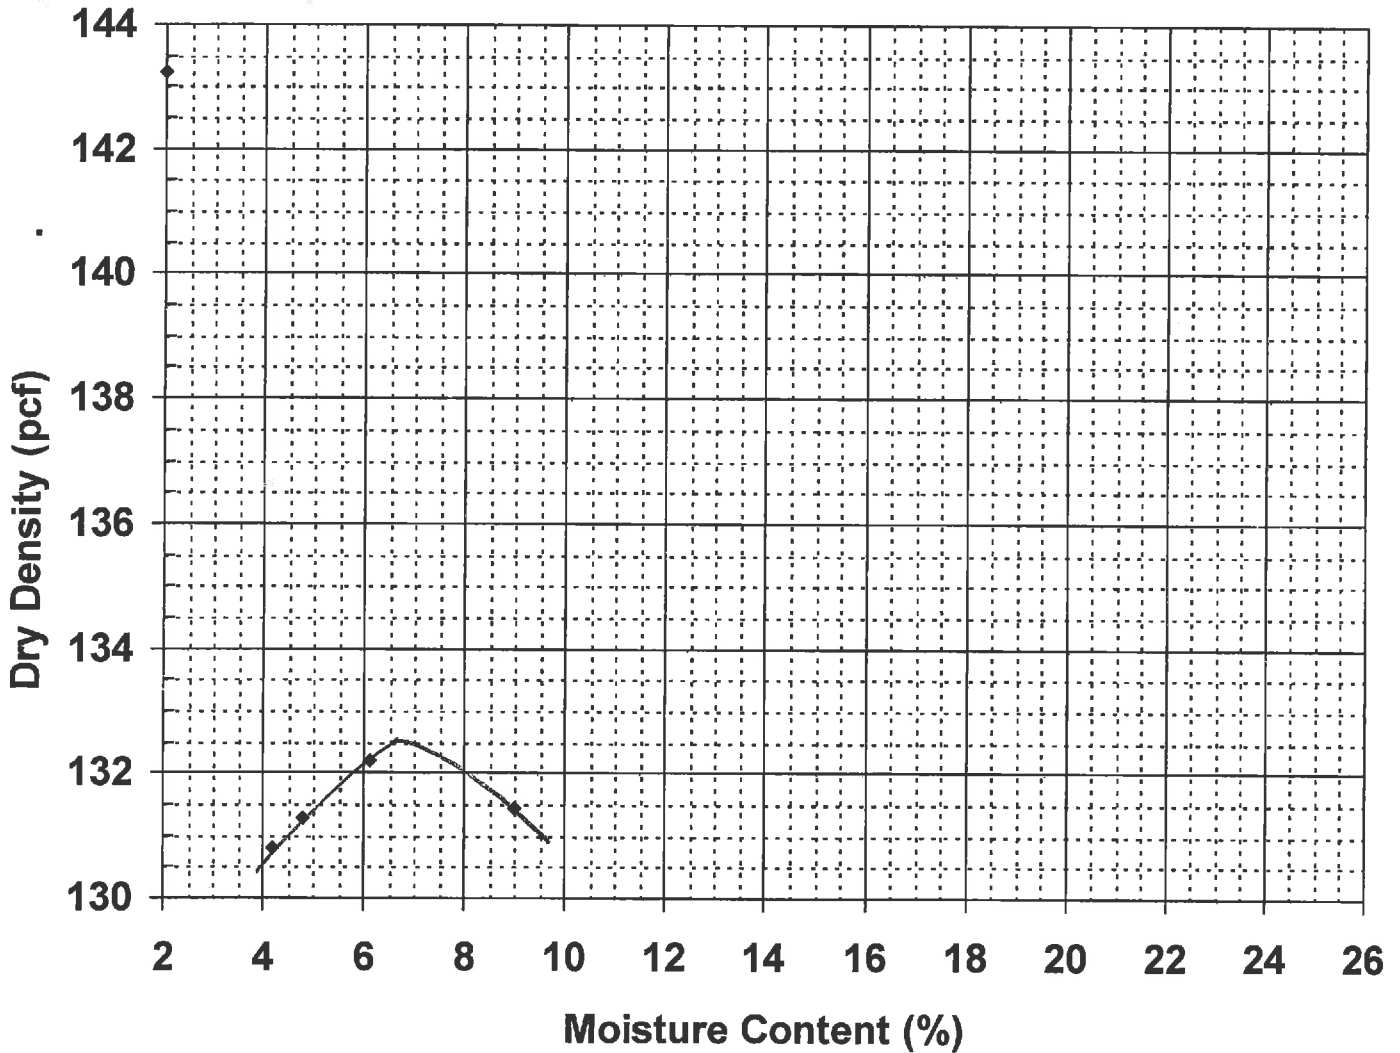

Maximum Dry Density (pcf) 132.6
Optimum Moisture Content (%) 6.5
Percent Oversized 24.3%

Corrected Dry Density (pcf) **137.9**
Corrected Moisture Content (%) **5.4**

Comments


Roger E. Domingo