

Report of Moisture-Density


Method ASTM D-1557 MODIFIED

Procedure C

Project Name PORTLAND ME - THE PARK DANFORTH - CONSTRUCTION
MATERIALS TESTING SERVICES
Client THE PARK-DANFORTH
Material Type CRUSHED GRAVEL
Material Source SHAW BROTHERS - N PIT

Project Number 14-0065.2
Lab ID 20085G
Date Received 10/22/2015
Date Completed 10/31/2015
Tested By PAUL SHAFFER

Moisture-Density Relationship Curve

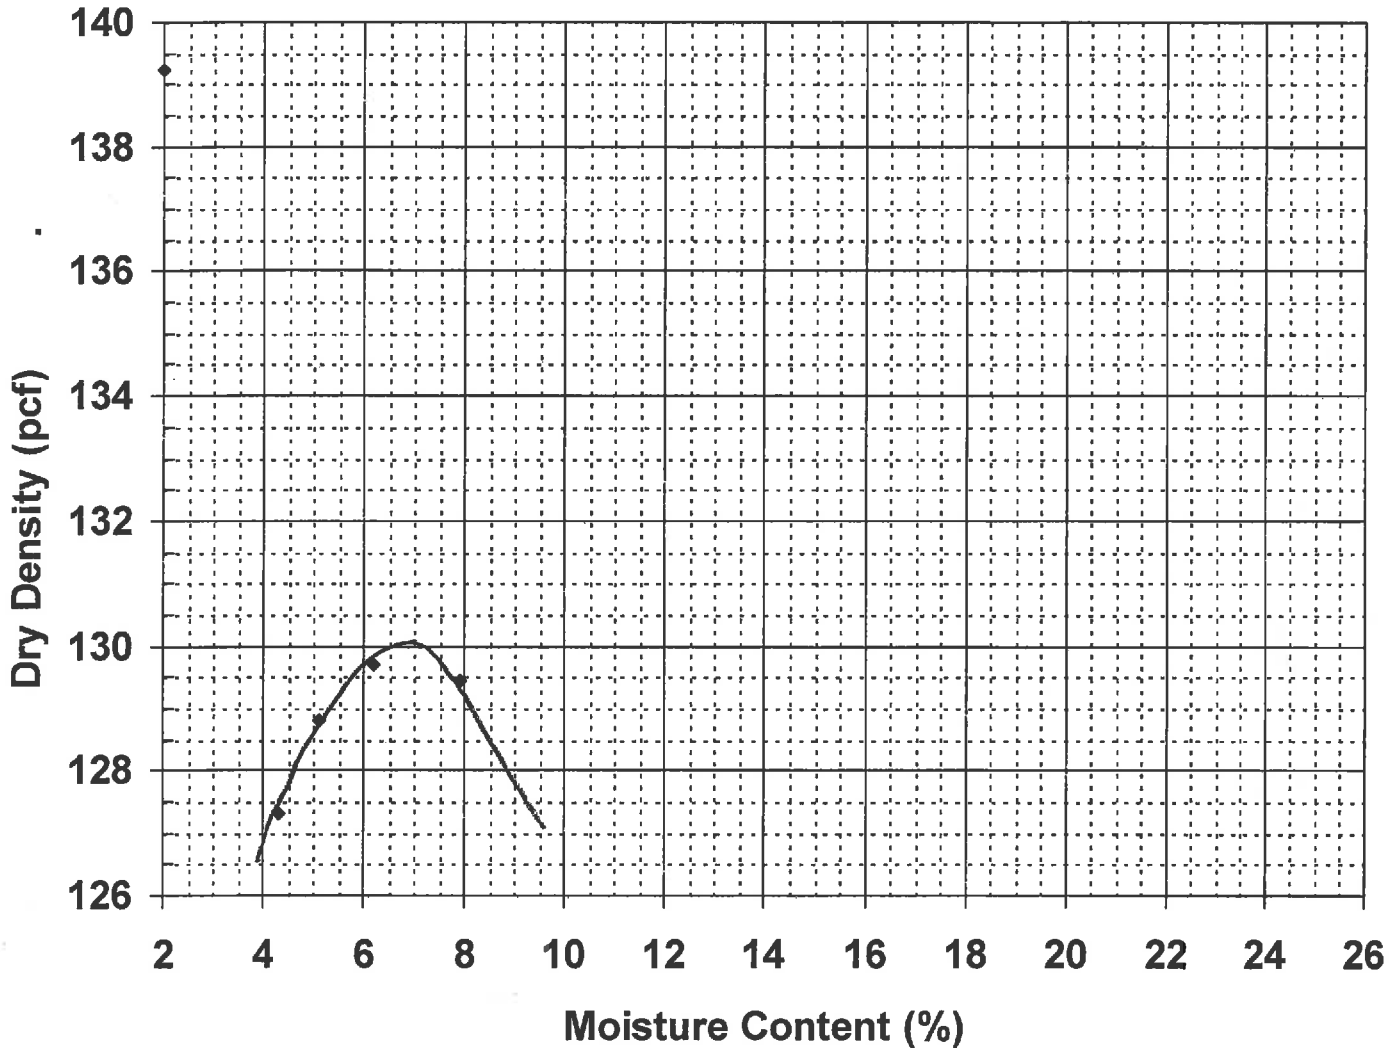

Maximum Dry Density (pcf) 130.2
Optimum Moisture Content (%) 7
Percent Oversized 30.0%

Corrected Dry Density (pcf) **137.3**
Corrected Moisture Content (%) **5.5**

Comments


Roger E. Domingo