


Report of Moisture-Density

Method **ASTM D-1557 MODIFIED** Procedure **A**

Project Name **PORTLAND ME - THE PARK DANFORTH - CONSTRUCTION MATERIALS TESTING SERVICES**
 Client **THE PARK-DANFORTH**
 Material Type **GRANULAR BORROW**
 Material Source **ON SITE BORROW**

Project Number **14-0065.2**
 Lab ID **20240G**
 Date Received **11/18/2015**
 Date Completed **11/19/2015**
 Tested By **PAUL SHAFFER**


Moisture-Density Relationship Curve

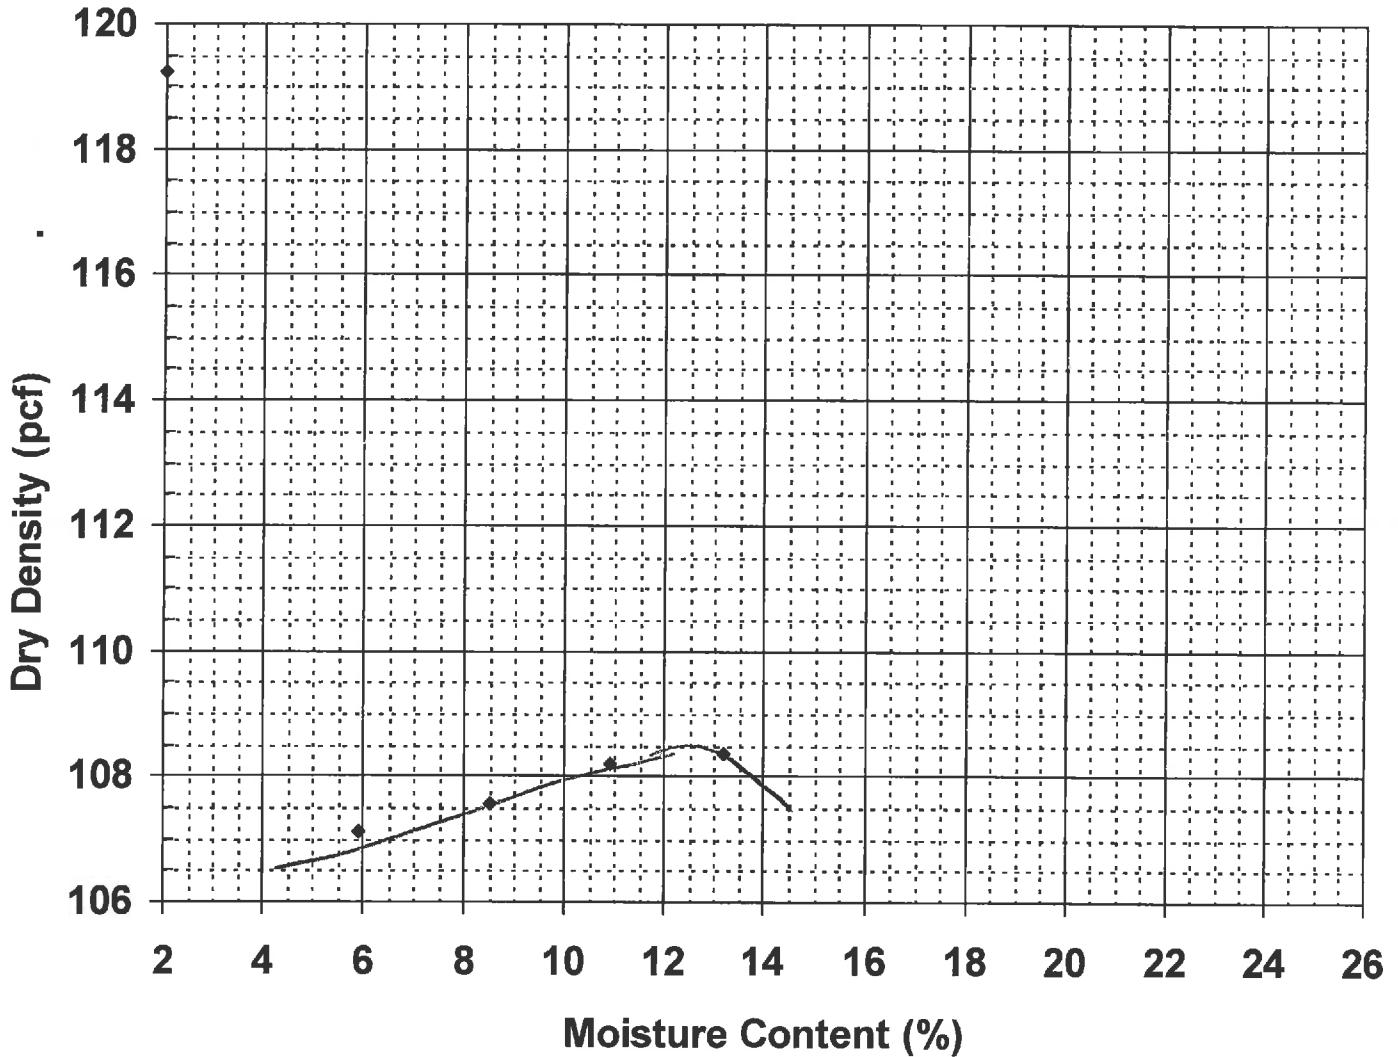

Maximum Dry Density (pcf) **108.6**
 Optimum Moisture Content (%) **12.4**
 Percent Oversized **1.1%**

Corrected Dry Density (pcf) **109**
Corrected Moisture Content (%) **12.3**

Comments

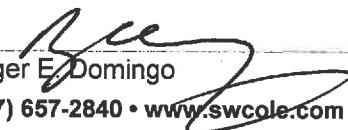
 Roger E. Domingo