


Report of Moisture-Density

Method ASTM D-1557 MODIFIED Procedure A

Project Name PORTLAND ME - THE PARK DANFORTH - CONSTRUCTION
MATERIALS TESTING SERVICES
Client THE PARK-DANFORTH
Material Type GRANULAR BORROW
Material Source SHAW BROTHERS - H PIT

Project Number 14-0065.2
Lab ID 20446G
Date Received 2/1/2016
Date Completed 2/4/2016
Tested By JUSTIN BISSON

Moisture-Density Relationship Curve

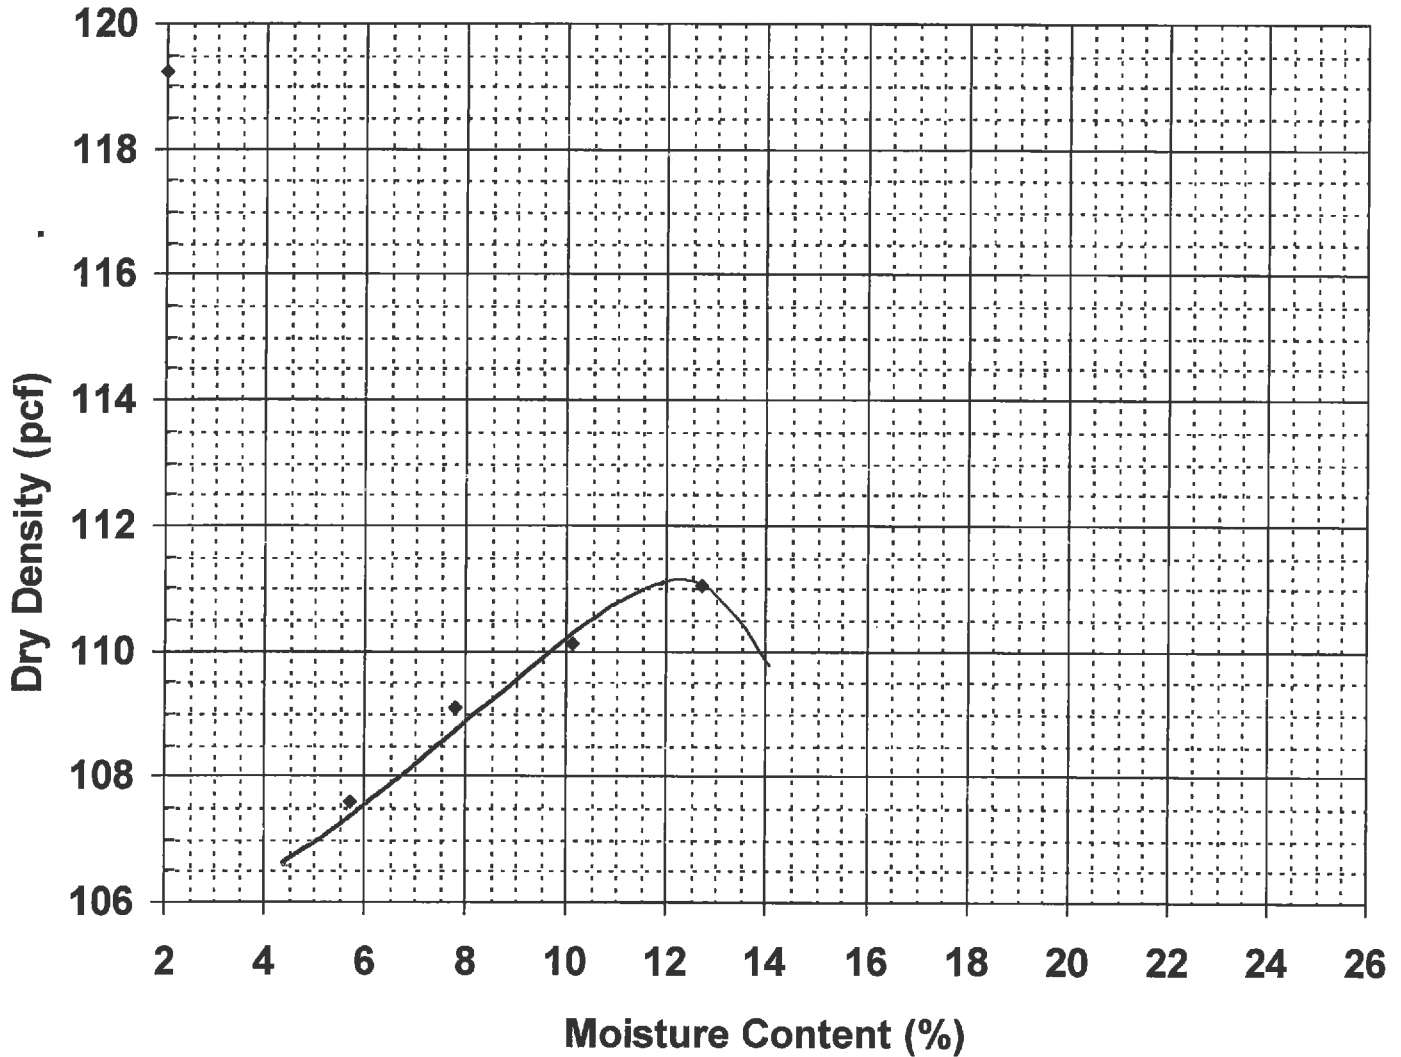

Maximum Dry Density (pcf) 111.2
Optimum Moisture Content (%) 12.2
Percent Oversized 10.0%

Corrected Dry Density (pcf) **114.6**
Corrected Moisture Content (%) **11.2**

Comments


Roger E. Domingo