


# Report of Moisture-Density

Method ASTM D-1557 MODIFIED Procedure C

Project Name	PORTLAND ME - THE PARK DANFORTH - CONSTRUCTION	Project Number	14-0065.2
	MATERIALS TESTING SERVICES	Lab ID	20541G
Client	THE PARK-DANFORTH	Date Received	3/3/2016
Material Type	GRANULAR BORROW	Date Completed	3/7/2016
Material Source	SHAW BROTHERS - H PIT	Tested By	PAUL SHAFFER

## Moisture-Density Relationship Curve

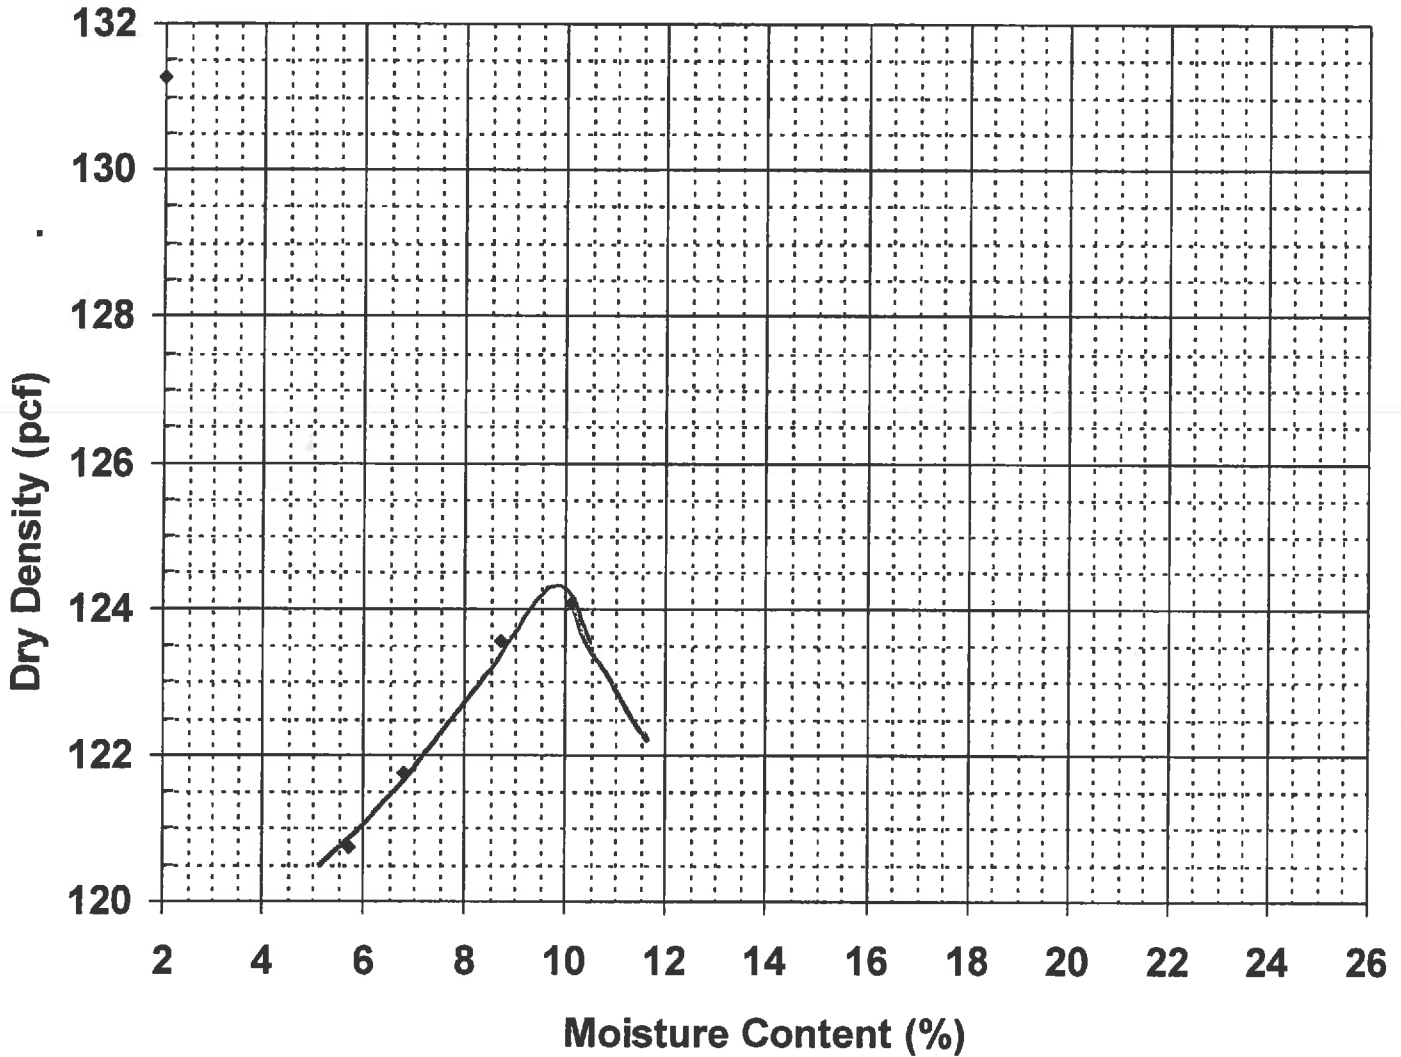

Maximum Dry Density (pcf) 124.3  
 Optimum Moisture Content (%) 9.6  
 Percent Oversized 18.4%

Corrected Dry Density (pcf) **129.3**  
Corrected Moisture Content (%) **8.2**

Comments

  
 Roger E. Domingo