

# Report of Moisture-Density


Method ASTM D-1557 MODIFIED

Procedure C

Project Name PORTLAND ME - THE PARK DANFORTH - CONSTRUCTION  
MATERIALS TESTING SERVICES  
Client THE PARK-DANFORTH  
Material Type AGGREGATE SUBBASE  
Material Source SHAW BROTHERS - S PIT

Project Number 14-0065.2  
Lab ID 21677G  
Date Received 10/10/2016  
Date Completed 10/13/2016  
Tested By JUSTIN BISSON

## Moisture-Density Relationship Curve

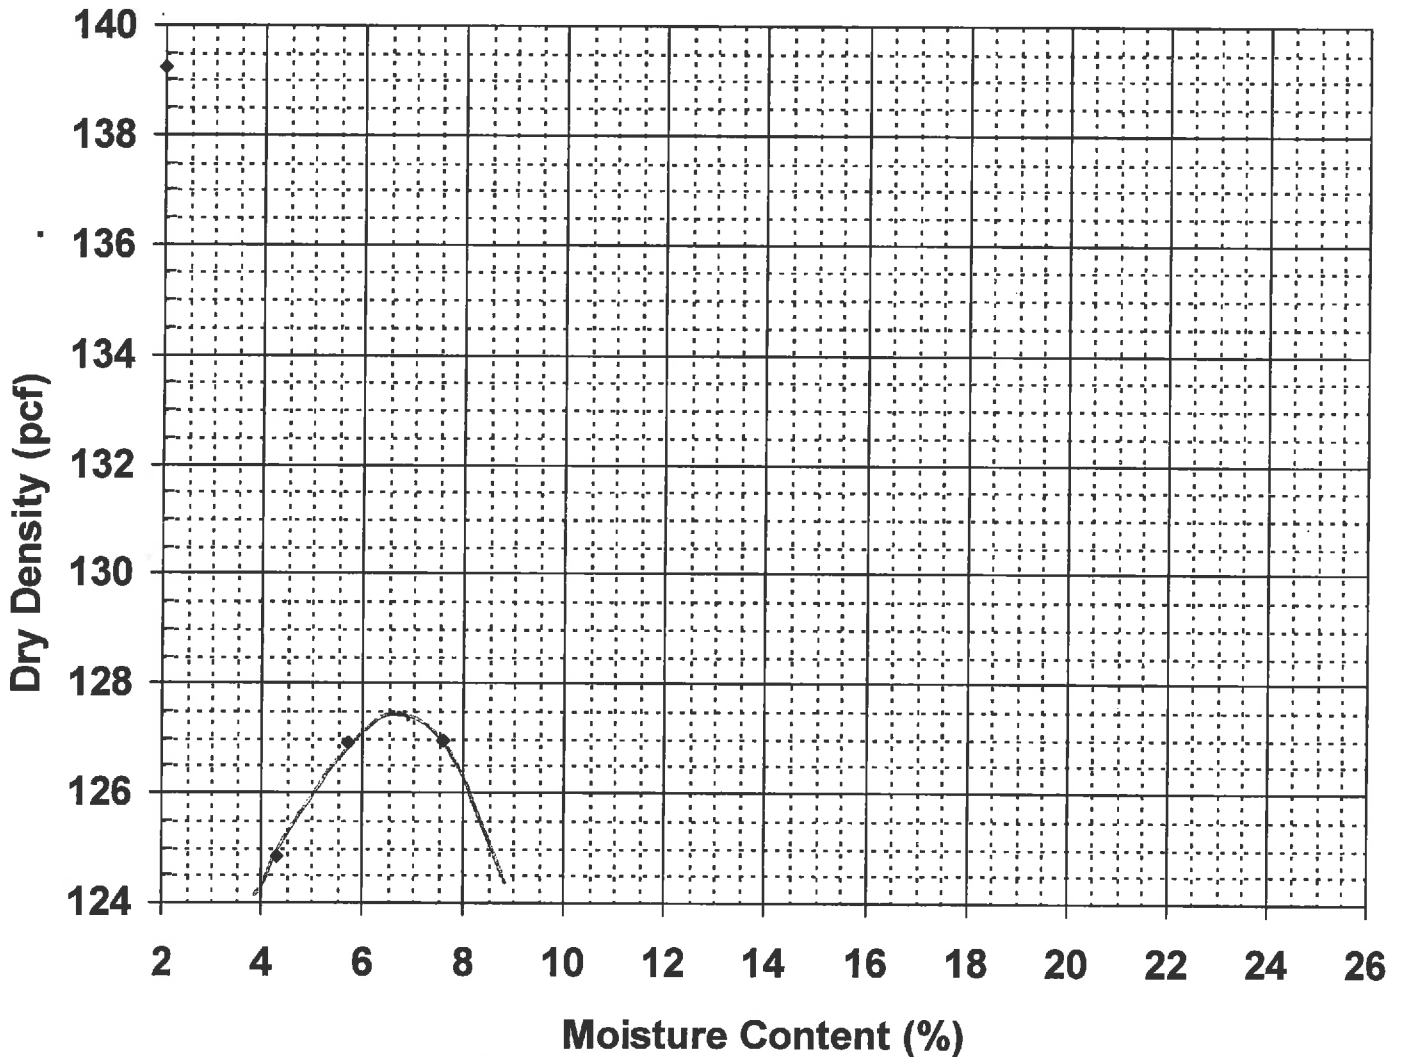

Maximum Dry Density (pcf) 127.5  
Optimum Moisture Content (%) 6.8  
Percent Oversized 30.0%

Corrected Dry Density (pcf) **135.2**  
Corrected Moisture Content (%) **5.4**

Comments

  
Roger E. Domingo