


Project Name: The Park Danforth
Project Number: 14-0065.2
Client: The Park Danforth
SFRM Supplier: Isolatek International
SFRM Installer: Northern Plasterwork
Installation Date: Week of 5-2-16

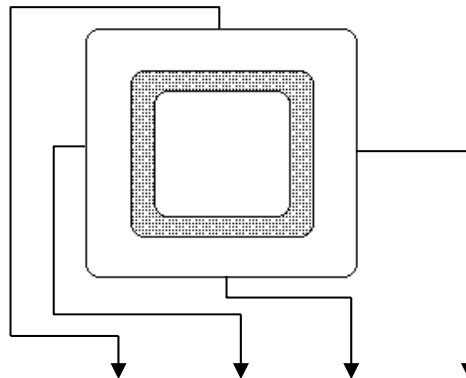

Location	Member Type	Required Thickness	1	2	3	4	Average Thickness
3 rd Floor, 4 th Framing, BF-3	HSS 5x5x5/16	1.563	2.250	2.313	1.813	1.875	1.813
			2.813	3.000	2.250	2.125	
3 rd Floor, 4 th Framing, BF-4	HSS 5x5x1/4	1.938	1.875	1.500	2.563	2.813	2.000
			2.313	1.688	2.875	3.063	
3 rd Floor, 4 th Framing, BF-10	HSS 5x5x1/4	1.938	2.000	1.875	2.313	N/A	2.000
			2.000	1.750	3.000	N/A	

ASTM E-605 8.1.2.1

For the purpose of averaging measurements, any measurement 6 mm (1/4 in.) or more, over the required design thickness, shall be recorded as the design thickness plus 6 mm. No individual measured thickness shall be more than 6 mm less, or more than 25 % less, than the required design thickness.

Comments: Outside face of BF-10 not sprayed at time of testing

Sampled by: K. Gimpel
 Reviewed by: RED