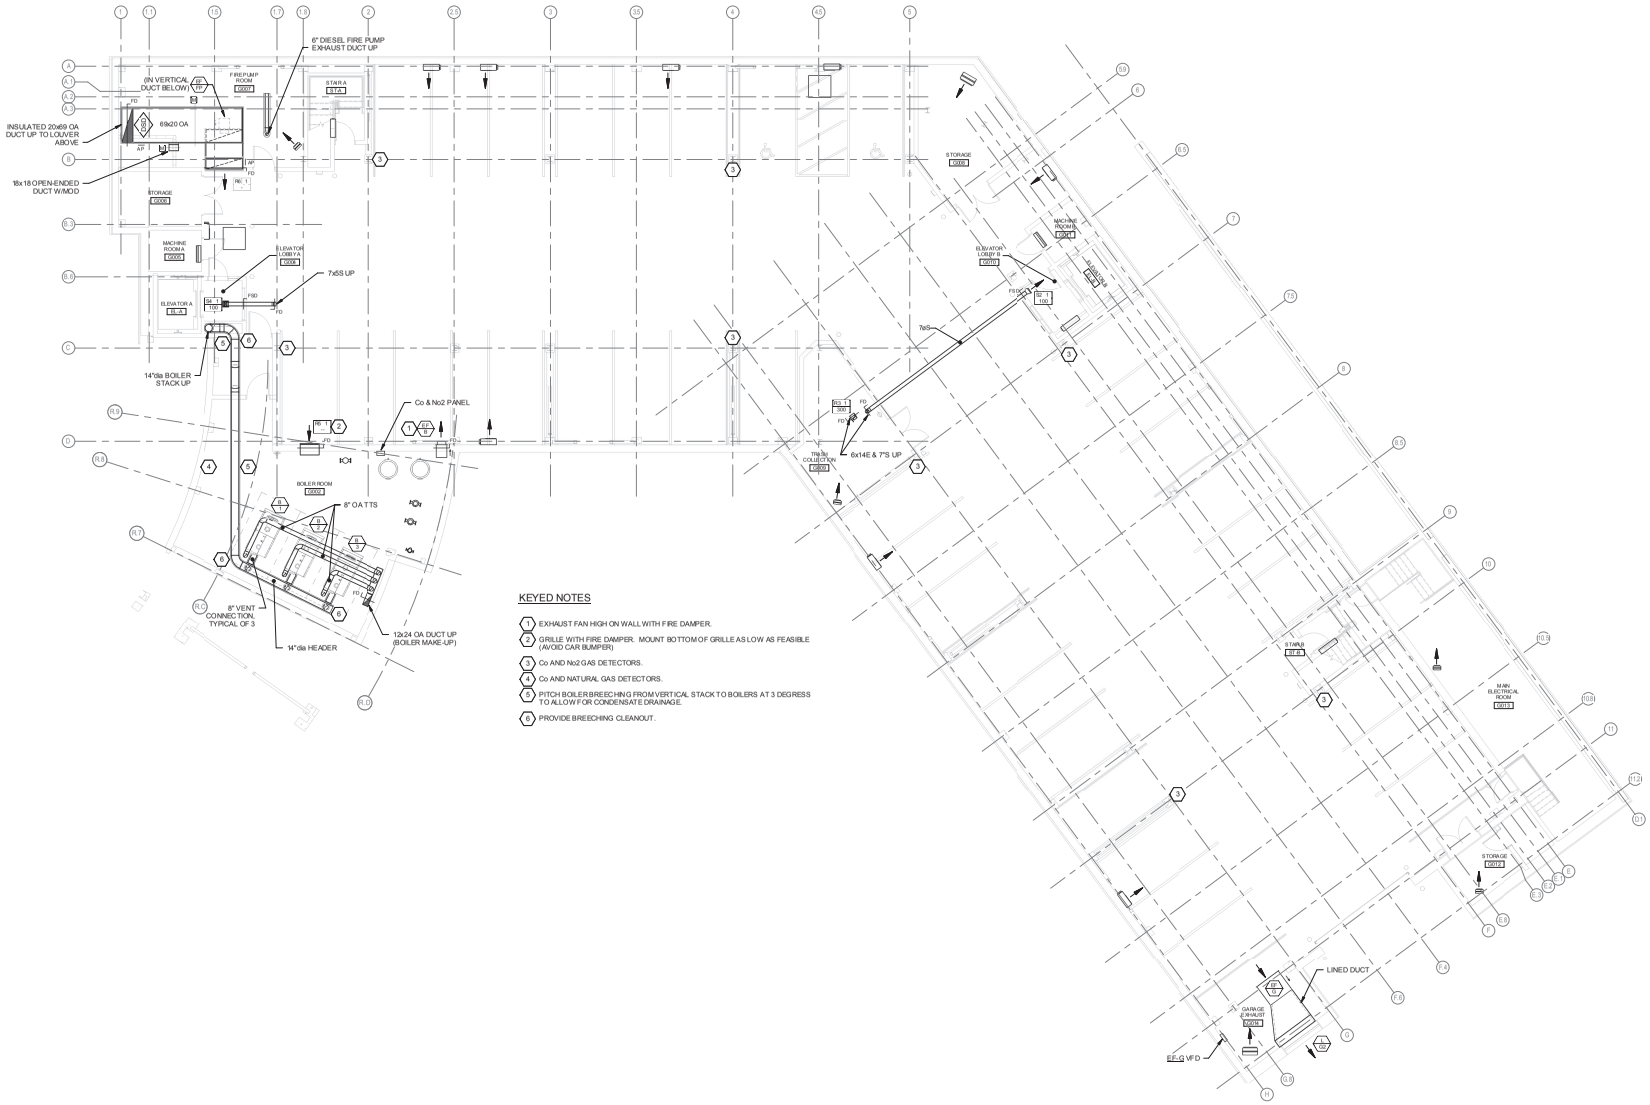

KEYED NOTES

1. EXHAUST FAN HIGH ON WALL WITH FIRE DAMPER.
2. GRILLE WITH FIRE DAMPER. MOUNT BOTTOM OF GRILLE AS LOW AS FEASIBLE (AVOID CAR BUMPER)
3. Co AND No2 GAS DETECTORS.
4. Co AND NATURAL GAS DETECTORS.
5. PITCH BOILER BREECHING FROM VERTICAL STACK TO BOILERS AT 3 DEGRESS TO ALLOW FOR CONDENSATE DRAINAGE.
6. PROVIDE BREECHING CLEANOUT.

A1	MECHANICAL PLAN - GARAGE LEVEL
1/8" = 1'-0"	

LAVALLEE|BRENSINGER ARCHITECTS
155 Dow Street, Suite 400, Manchester, NH 03101
92 Monhalle Ave., Suite 2150, Stoneham, MA 02180
NH: 603.622.5450 MA: 781.462.7283 www.LBPA.com

Allied Engineering
Structural Mechanical Electrical Commissioning
160 Veranda Street
Portland, Maine 04103
T: 207.221.2260
F: 207.221.2266
Web: www.allied-eng.com

STATE OF MAINE
IAN A. MACDONALD
No. 6980
LICENSED PROFESSIONAL ENGINEER

Graphic Scale: 1" 1/2" 0 1"

The Park Danforth

The Park Danforth - 777 Stevens Avenue, Portland, ME, 04103

777 Stevens Ave, Portland, ME, 04103

NO.	DESCRIPTION	DATE
1	Addendum No. 2	2015-06-25
2	Revised Boiler Breeching	2015-07-08

CONTENT:
MECHANICAL PLAN - GARAGE LEVEL

DRAWN BY:	REW
PROJECT NO:	12056-00
DATE:	06/05/2015
REVISED:	OCTOBER 16, 2015
SCALE:	AS SHOWN

MH1.0C

Project Phase
CONFORMANCE SET

COPYRIGHT © 2014 BY LAVALLEE/BRENSINGER PROFESSIONAL ASSOCIATION. ALL RIGHTS RESERVED. NO REPRODUCTION WITHOUT PERMISSION.

10/15/2015 9:46:10 AM N:\Projects\2014\14018 - Park Danforth\50 Drawing Files - REVIT 2015\14018.rvt