


READ STREET SELF-STORAGE

217 READ STREET
 PORTLAND, ME 04103

13102
 1-2-14

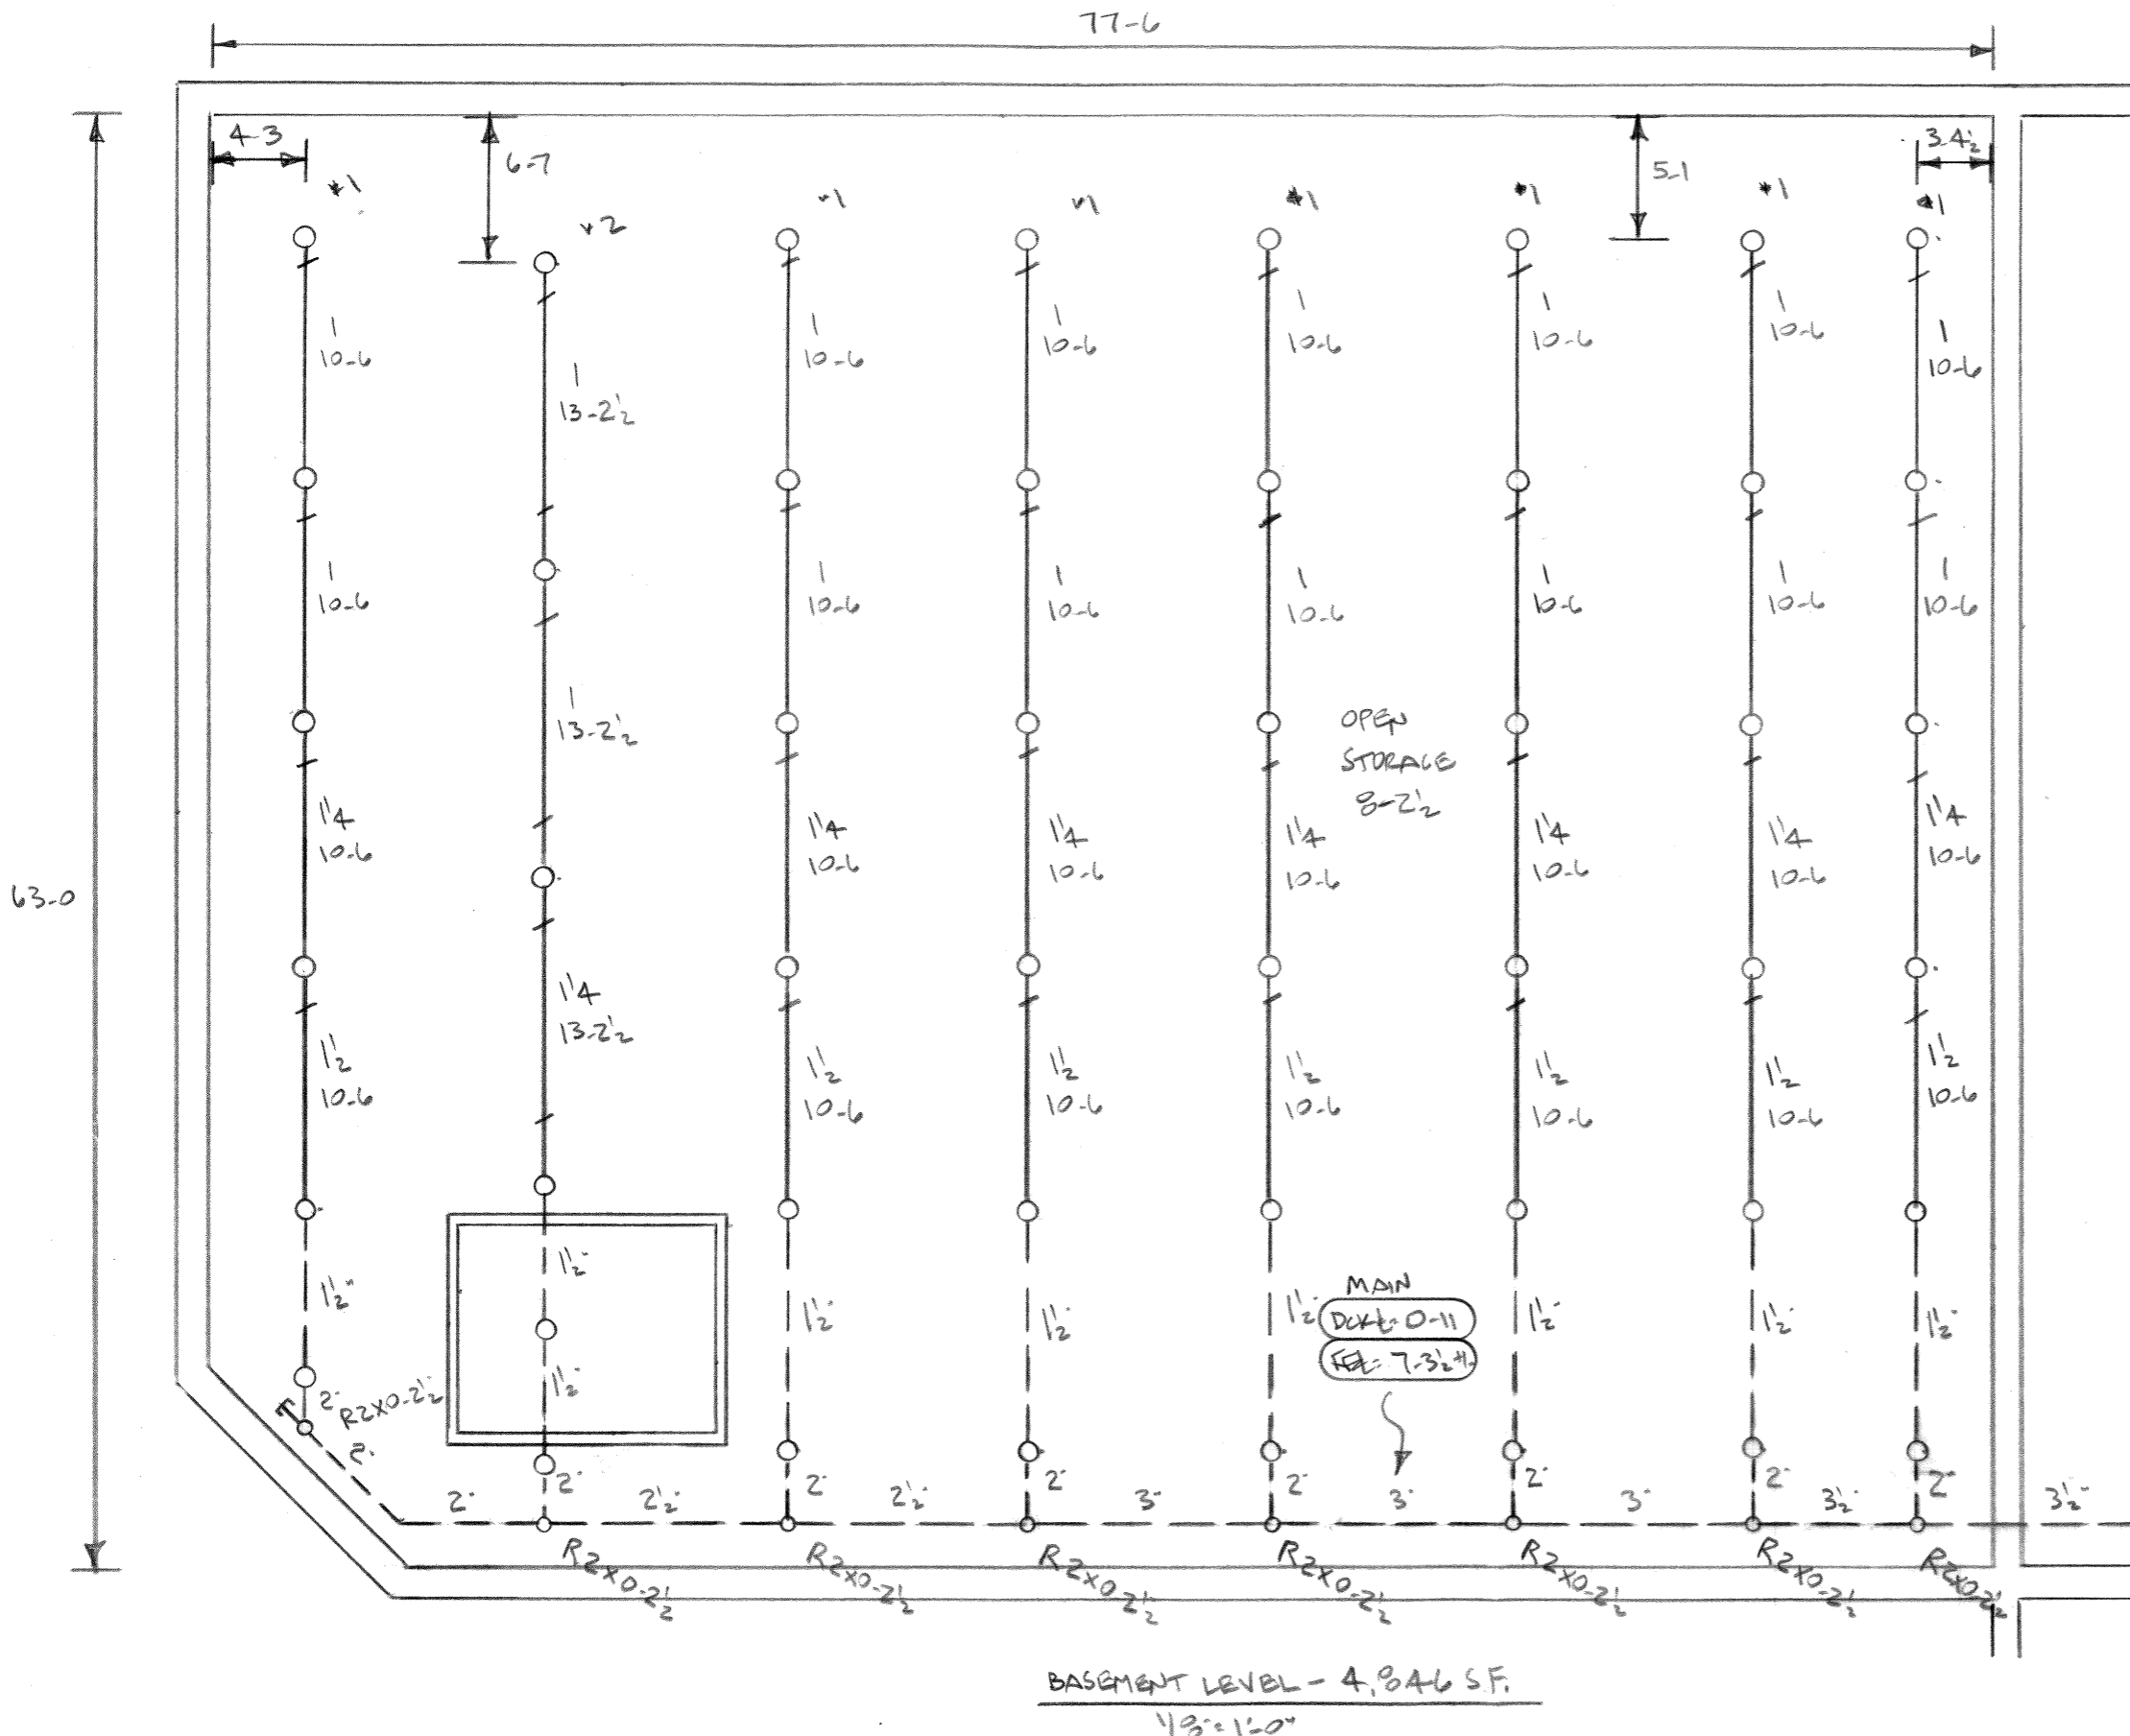

- NFPA 13 WET ORDINARY HAZARD GP 2 EXISTING PIPE SCHEDULE SYSTEM
- 18" MINIMUM CLEARANCE FROM TOP OF ANY STORAGE TO SPRINKLER DEFLECTOR
- INSTALL BRANCH LINES AT 0-4 1/2 TO 0-5 1/2 FROM DECK TO & OF PIPING

1/2" x 1/2" OR BRASS UPRIGHTS
 RELIABLE FIRST K=5.6 RA1425

BASEMENT LEVEL - 4,846 SF.
 1/3" = 1'-0"