



# Envelope Compliance Certificate

## Section 1: Project Information

Energy Code: **2009 IECC**  
 Project Title: Autozone Store #3879  
 Project Type: New Construction

Construction Site:  
 1207 forest Avenue  
 Portland, ME 04103

Owner/Agent:  
 Autozone Store Development  
 123 S. Front Street  
 Memphis , TN 38103

Designer/Contractor:  
 Danny Doss  
 Advanced Consulting Engineers, Inc.  
 132 Kelley Drive  
 Rogers, AR 72757  
 479-631-1712  
 acei@advengineers.com

Building Location (for weather data): Portland, Maine  
 Climate Zone: 6a  
 Vertical Glazing / Wall Area Pct.: 10%

**Building Use: Activity Type(s)** **Floor Area**  
 1-Retail : Nonresidential 7009

## Section 2: Envelope Assemblies and Requirements Checklist

Envelope **PASSES**: Design 9% better than code

### Envelope Assemblies:

Component Name/Description	Gross Area or Perimeter	Cavity R-Value	Cont. R-Value	Proposed U-Factor	Budget U-Factor <sup>(e)</sup>
Orientation: NORTH					
Rear Wall: Other Mass Wall, Heat capacity 7.8, [Bldg. Use 1 - Retail] (b)	1024	---	---	0.077	0.080
Door 3: Insulated Metal, Swinging, [Bldg. Use 1 - Retail]	21	---	---	0.190	0.700
Door 4: Insulated Metal, Non-Swinging, [Bldg. Use 1 - Retail]	42	---	---	0.950	0.500
Orientation: EAST					
Right Side Wall: Other Mass Wall, Heat capacity 7.8, [Bldg. Use 1 - Retail] (b)	1840	---	---	0.077	0.080
Orientation: SOUTH					
Store Front Wall: Other Mass Wall, Heat capacity 7.8, [Bldg. Use 1 - Retail] (b)	1024	---	---	0.077	0.080
Window 1: Metal Frame, Perf. Specs.: Product ID N/A, SHGC 0.35, PF 1.30, [Bldg. Use 1 - Retail] (c)	361	---	---	0.330	0.550
Door 5: Glass (> 50% glazing):Metal Frame, Entrance Door, Perf. Specs.: Product ID N/A, SHGC 0.35, PF 1.30, [Bldg. Use 1 - Retail] (c)	42	---	---	0.330	0.800
Orientation: WEST					
Left Side Wall: Other Mass Wall, Heat capacity 7.8, [Bldg. Use 1 - Retail] (b)	1840	---	---	0.077	0.080
Window 1: Metal Frame, Perf. Specs.: Product ID N/A, SHGC 0.35, PF 1.30, [Bldg. Use 1 - Retail] (c)	110	---	---	0.330	0.550
Door 1: Glass (> 50% glazing):Metal Frame, Perf. Specs.: Product ID N/A, SHGC 0.35, PF 1.30, [Bldg. Use 1 - Retail] (c)	42	---	---	0.330	0.800
Door 2: Insulated Metal, Swinging, [Bldg. Use 1 - Retail]	21	---	---	0.190	0.700
Orientation: UNSPECIFIED ORIENTATION					
Roof 1: Insulation Entirely Above Deck, [Bldg. Use 1 - Retail]	7381	---	30.0	0.032	0.048
Floor 1: Slab-On-Grade:Unheated, [Bldg. Use 1 - Retail]	358	---	---	---	---

- (a) Budget U-factors are used for software baseline calculations ONLY, and are not code requirements.
- (b) 'Other' components require supporting documentation for proposed U-factors.
- (c) Fenestration product performance must be certified in accordance with NFRC and requires supporting documentation.

**Air Leakage, Component Certification, and Vapor Retarder Requirements:**

- 1. All joints and penetrations are caulked, gasketed or covered with a moisture vapor-permeable wrapping material installed in accordance with the manufacturer's installation instructions.
- 2. Windows, doors, and skylights certified as meeting leakage requirements.
- 3. Component R-values & U-factors labeled as certified.
- 4. No roof insulation is installed on a suspended ceiling with removable ceiling panels.
- 5. 'Other' components have supporting documentation for proposed U-Factors.
- 6. Insulation installed according to manufacturer's instructions, in substantial contact with the surface being insulated, and in a manner that achieves the rated R-value without compressing the insulation.
- 7. Stair, elevator shaft vents, and other outdoor air intake and exhaust openings in the building envelope are equipped with motorized dampers.
- 8. Cargo doors and loading dock doors are weather sealed.
- 9. Recessed lighting fixtures installed in the building envelope are Type IC rated as meeting ASTM E283, are sealed with gasket or caulk.
- 10. Building entrance doors have a vestibule equipped with self-closing devices.

*Exceptions:*

- Building entrances with revolving doors.
- Doors not intended to be used as a building entrance.
- Doors that open directly from a space less than 3000 sq. ft. in area.
- Doors used primarily to facilitate vehicular movement or materials handling and adjacent personnel doors.
- Doors opening directly from a sleeping/dwelling unit.

**Section 3: Compliance Statement**

*Compliance Statement:* The proposed envelope design represented in this document is consistent with the building plans, specifications and other calculations submitted with this permit application. The proposed envelope system has been designed to meet the 2009 IECC requirements in COMcheck Version 4.0.2.2 and to comply with the mandatory requirements in the Requirements Checklist.

Danny E. Doss - P.E.


Name - Title

*Danny E. Doss*  
Signature

04/14/16  
Date

**Project Notes:**

Provided By:  
Jonathan Doss  
Advanced Energy Solutions  
P.O. Box 427  
Rogers, Arkansas 72757-0427

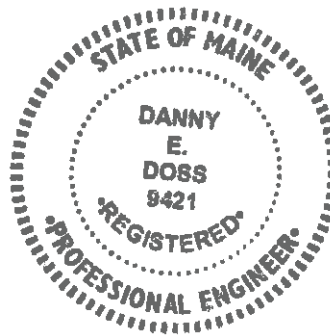



# COMcheck Software Version 4.0.2.2 Interior Lighting Compliance Certificate

## Section 1: Project Information

Energy Code: **2009 IECC**  
Project Title: Autozone Store #3879  
Project Type: New Construction

Construction Site:  
1207 forest Avenue  
Portland, ME 04103

Owner/Agent:  
Autozone Store Development  
123 S. Front Street  
Memphis , TN 38103

Designer/Contractor:  
Danny Doss  
Advanced Consulting Engineers, Inc.  
132 Kelley Drive  
Rogers, AR 72757  
479-631-1712  
acei@advengineers.com

## Section 2: Interior Lighting and Power Calculation

A Area Category	B Floor Area (ft <sup>2</sup> )	C Allowed Watts / ft <sup>2</sup>	D Allowed Watts (B x C)
Retail	7009	1.5	10514
Total Allowed Watts =			10514

## Section 3: Interior Lighting Fixture Schedule

A Fixture ID : Description / Lamp / Wattage Per Lamp / Ballast	B Lamps/ Fixture	C # of Fixtures	D Fixture Watt.	E (C X D)
Retail (7009 sq ft.)				
Linear Fluorescent 5: M: Suspended 4ft. Fluorescent: 48" T8 28W (Super T8): Electronic:	2	6	56	336
T8 / T12 Fluorescent 2: C: Wall Mounted Fluorescent: 48" T8 32W: Electronic:	1	2	32	64
T8 / T12 Fluorescent 3: G: Suspended 8ft. Fluorescent: 96" T8 75W: Electronic:	2	26	47.5	1235
T8 / T12 Fluorescent 1: A: Suspended 8ft. Fluorescent: 96" T8 75W: Electronic:	2	74	95	7030
T8 / T12 Fluorescent 4: H: Suspended 8ft. Fluorescent: 96" T8 75W: Electronic:	2	26	47.5	1235
Total Proposed Watts =			9900	

## Section 4: Requirements Checklist

Interior Lighting **PASSES**: Design 6% better than code

### Lighting Wattage:

1. Total proposed watts must be less than or equal to total allowed watts.

Allowed Watts	Proposed Watts	Complies
10514	9900	YES

### Controls, Switching, and Wiring:

2. Daylight zones under skylights more than 15 feet from the perimeter have lighting controls separate from daylight zones adjacent to vertical fenestration.
3. Daylight zones have individual lighting controls independent from that of the general area lighting.

#### Exceptions:

- Contiguous daylight zones spanning no more than two orientations are allowed to be controlled by a single controlling device.
- Daylight spaces enclosed by walls or ceiling height partitions and containing two or fewer light fixtures are not required to have a separate switch for general area lighting.

4. Independent controls for each space (switch/occupancy sensor).

*Exceptions:*

- Areas designated as security or emergency areas that must be continuously illuminated.
- Lighting in stairways or corridors that are elements of the means of egress.
5. Master switch at entry to hotel/motel guest room.
6. Individual dwelling units separately metered.
7. Medical task lighting or art/history display lighting claimed to be exempt from compliance has a control device independent of the control of the nonexempt lighting.
8. Each space required to have a manual control also allows for reducing the connected lighting load by at least 50 percent by either controlling all luminaires, dual switching of alternate rows of luminaires, alternate luminaires, or alternate lamps, switching the middle lamp luminaires independently of other lamps, or switching each luminaire or each lamp.

*Exceptions:*

- Only one luminaire in space.
- An occupant-sensing device controls the area.
- The area is a corridor, storeroom, restroom, public lobby or sleeping unit.
- Areas that use less than 0.6 Watts/sq.ft.
9. Automatic lighting shutoff control in buildings larger than 5,000 sq.ft.

*Exceptions:*

- Sleeping units, patient care areas; and spaces where automatic shutoff would endanger safety or security.
10. Photocell/astromical time switch on exterior lights.

*Exceptions:*

- Lighting intended for 24 hour use.
11. Tandem wired one-lamp and three-lamp ballasted luminaires (No single-lamp ballasts).

*Exceptions:*

- Electronic high-frequency ballasts; Luminaires on emergency circuits or with no available pair.

## Section 5: Compliance Statement


**Compliance Statement:** The proposed lighting design represented in this document is consistent with the building plans, specifications and other calculations submitted with this permit application. The proposed lighting system has been designed to meet the 2009 IECC requirements in COMcheck Version 4.0.2.2 and to comply with the mandatory requirements in the Requirements Checklist.

Danny E. Doss - P.E.

Name - Title

Signature

Date

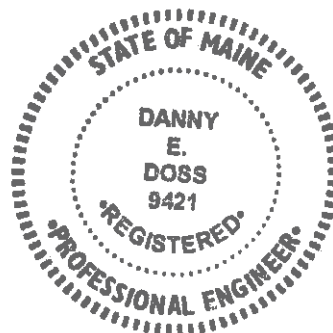



# Exterior Lighting Compliance Certificate

## Section 1: Project Information

Energy Code: **2009 IECC**  
Project Title: Autozone Store #3879  
Project Type: New Construction  
Exterior Lighting Zone: 2 (Neighborhood business district)

Construction Site:  
1207 forest Avenue  
Portland, ME 04103

Owner/Agent:  
Autozone Store Development  
123 S. Front Street  
Memphis , TN 38103

Designer/Contractor:  
Danny Doss  
Advanced Consulting Engineers, Inc.  
132 Kelley Drive  
Rogers, AR 72757  
479-631-1712  
acei@advengineers.com

## Section 2: Exterior Lighting Area/Surface Power Calculation

A Exterior Area/Surface	B Quantity	C Allowed Watts / Unit	D Tradable Wattage	E Allowed Watts (B x C)	F Proposed Watts
Illuminated length of facade wall or surface	358 ft	2.5	No	895	220
				Total Tradable Watts* =	0
				Total Allowed Watts =	895
				Total Allowed Supplemental Watts** =	600

\* Wattage tradeoffs are only allowed between tradable areas/surfaces.

\*\* A supplemental allowance equal to 600 watts may be applied toward compliance of both non-tradable and tradable areas/surfaces.

## Section 3: Exterior Lighting Fixture Schedule

A Fixture ID : Description / Lamp / Wattage Per Lamp / Ballast	B Lamps/ Fixture	C # of Fixtures	D Fixture Watt.	E (C X D)
Illuminated length of facade wall or surface (358 ft) Non-tradable Wattage				
LED 1: D: LED Other Fixture Unit 40W:	1	5	40	200
LED 3: L: LED Other Fixture Unit 16W:	1	1	20	20
Total Tradable Proposed Watts =				0

## Section 4: Requirements Checklist

### Lighting Wattage:

1. Within each non-tradable area/surface, total proposed watts must be less than or equal to total allowed watts. Across all tradable areas/surfaces, total proposed watts must be less than or equal to total allowed watts.

Compliance: Passes.

### Controls, Switching, and Wiring:

2. All exemption claims are associated with fixtures that have a control device independent of the control of the nonexempt lighting.
3. Lighting not designated for dusk-to-dawn operation is controlled by either a a photosensor (with time switch), or an astronomical time switch.
4. Lighting designated for dusk-to-dawn operation is controlled by an astronomical time switch or photosensor.
5. All time switches are capable of retaining programming and the time setting during loss of power for a period of at least 10 hours.

**Exterior Lighting Efficacy:**

- 6. All exterior building grounds luminaires that operate at greater than 100W have minimum efficacy of 60 lumen/watt.

*Exceptions:*

- Lighting that has been claimed as exempt and is identified as such in Section 3 table above.
- Lighting that is specifically designated as required by a health or life safety statute, ordinance, or regulation.
- Emergency lighting that is automatically off during normal building operation.
- Lighting that is controlled by motion sensor.

**Section 5: Compliance Statement**


*Compliance Statement:* The proposed exterior lighting design represented in this document is consistent with the building plans, specifications and other calculations submitted with this permit application. The proposed lighting system has been designed to meet the 2009 IECC requirements in COMcheck Version 4.0.2.2 and to comply with the mandatory requirements in the Requirements Checklist.

Danny E. Doss - P.E.

Name - Title

*Danny E. Doss*  
Signature

04/14/16  
Date

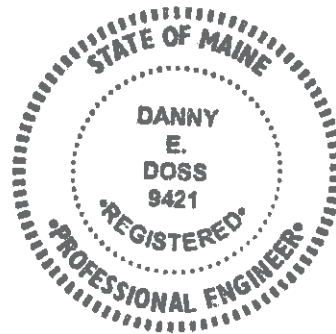



COMcheck Software Version 4.0.2.2

# Mechanical Compliance Certificate

## Section 1: Project Information

Energy Code: 2009 IECC  
Project Title: Autozone Store #3879  
Project Type: New Construction

Construction Site:  
1207 forest Avenue  
Portland, ME 04103

Owner/Agent:  
Autozone Store Development  
123 S. Front Street  
Memphis, TN 38103

Designer/Contractor:  
Danny Doss  
Advanced Consulting Engineers, Inc.  
132 Kelley Drive  
Rogers, AR 72757  
479-631-1712  
acei@advengineers.com

## Section 2: General Information

Building Location (for weather data): Portland, Maine  
Climate Zone: 6a

## Section 3: Mechanical Systems List

### Quantity System Type & Description

- 2 HVAC System 1 (Single Zone) :  
Heating: 1 each - Central Furnace, Gas, Capacity = 100 kBtu/h  
Proposed Efficiency = 80.00% Et, Required Efficiency = 80.00% Et  
Cooling: 1 each - Single Package DX Unit, Capacity = 98 kBtu/h, Air-Cooled Condenser, Air Economizer  
Proposed Efficiency = 12.00 EER, Required Efficiency = 11.00 EER  
Fan System: None
- 1 Water Heater 1- 4 Gal Mini Tank:  
Electric Storage Water Heater, Capacity: 4 gallons  
No minimum efficiency requirement applies

## Section 4: Requirements Checklist

### Requirements Specific To: HVAC System 1 :

- 1. Equipment minimum efficiency: Central Furnace (Gas): 80.00 % Et (or 78% AFUE)
- 2. Equipment minimum efficiency: Single Package Unit: 11.00 EER
- 3. Integrated economizer is required for this location and system.
- 4. Cooling system provides a means to relieve excess outdoor air during economizer operation.
- 5. Hot gas bypass prohibited unless system has multiple steps of unloading or continuous capacity modulation
- 6. Hot gas bypass limited to 50% of total cooling capacity

### Requirements Specific To: Water Heater 1- 4 Gal Mini Tank :

- 1. Water heating equipment meets minimum efficiency requirements: No efficiency requirements for water heater with storage capacity less than 20 gallons.
- 2. First 8 ft of outlet piping is insulated
- 3. Hot water storage temperature controls that allow setpoint of 90°F for non-dwelling units and 110°F for dwelling units.
- 4. Heat traps provided on inlet and outlet of storage tanks

### Generic Requirements: Must be met by all systems to which the requirement is applicable:

- 1. Plant equipment and system capacity no greater than needed to meet loads  
*Exception(s):*

- Standby equipment automatically off when primary system is operating
- Multiple units controlled to sequence operation as a function of load
- 2. Minimum one temperature control device per system
- 3. Minimum one humidity control device per installed humidification/dehumidification system
- 4. Load calculations per ASHRAE/ACCA Standard 183.
- 5. Automatic Controls: Setback to 55°F (heat) and 85°F (cool); 7-day clock, 2-hour occupant override, 10-hour backup  
Exception(s):
  - Continuously operating zones
- 6. Outside-air source for ventilation; system capable of reducing OSA to required minimum
- 7. R-5 supply and return air duct insulation in unconditioned spaces  
R-8 supply and return air duct insulation outside the building  
R-8 insulation between ducts and the building exterior when ducts are part of a building assembly  
Exception(s):
  - Ducts located within equipment
  - Ducts with interior and exterior temperature difference not exceeding 15°F.
- 8. Mechanical fasteners and sealants used to connect ducts and air distribution equipment
- 9. Ducts sealed - longitudinal seams on rigid ducts; transverse seams on all ducts; UL 181A or 181B tapes and mastics
- 10. Hot water pipe insulation: 1.5 in. for pipes <=1.5 in. and 2 in. for pipes >1.5 in.  
Chilled water/refrigerant/brine pipe insulation: 1.5 in. for pipes <=1.5 in. and 1.5 in. for pipes >1.5 in.  
Steam pipe insulation: 1.5 in. for pipes <=1.5 in. and 3 in. for pipes >1.5 in.  
Exception(s):
  - Piping within HVAC equipment.
  - Fluid temperatures between 55 and 105°F.
  - Fluid not heated or cooled with renewable energy.
  - Piping within room fan-coil (with AHRI440 rating) and unit ventilators (with AHRI840 rating).
  - Runouts <4 ft in length.
- 11. Operation and maintenance manual provided to building owner
- 12. Thermostatic controls have 5°F deadband  
Exception(s):
  - Thermostats requiring manual changeover between heating and cooling
  - Special occupancy or special applications where wide temperature ranges are not acceptable and are approved by the authority having jurisdiction.
- 13. Balancing devices provided in accordance with IMC 603.17
- 14. Demand control ventilation (DCV) present for high design occupancy areas (>40 person/1000 ft<sup>2</sup> in spaces >500 ft<sup>2</sup>) and served by systems with any one of 1) an air-side economizer, 2) automatic modulating control of the outdoor air damper, or 3) a design outdoor airflow greater than 3000 cfm.  
Exception(s):
  - Systems with heat recovery.
  - Multiple-zone systems without DDC of individual zones communicating with a central control panel.
  - Systems with a design outdoor airflow less than 1200 cfm.
  - Spaces where the supply airflow rate minus any makeup or outgoing transfer air requirement is less than 1200 cfm.
- 15. Motorized, automatic shutoff dampers required on exhaust and outdoor air supply openings  
Exception(s):
  - Gravity dampers acceptable in buildings <3 stories
- 16. Automatic controls for freeze protection systems present
- 17. Exhaust air heat recovery included for systems 5,000 cfm or greater with more than 70% outside air fraction or specifically exempted  
Exception(s):
  - Hazardous exhaust systems, commercial kitchen and clothes dryer exhaust systems that the International Mechanical Code prohibits the use of energy recovery systems.
  - Systems serving spaces that are heated and not cooled to less than 60°F.
  - Where more than 60 percent of the outdoor heating energy is provided from site-recovered or site solar energy.
  - Heating systems in climates with less than 3600 HDD.
  - Cooling systems in climates with a 1 percent cooling design wet-bulb temperature less than 64°F.
  - Systems requiring dehumidification that employ energy recovery in series with the cooling coil.
  - Laboratory fume hood exhaust systems that have either a variable air volume system capable of reducing exhaust and makeup air volume to 50 percent or less of design values or, a separate make up air supply meeting the following makeup air requirements: a) at least 75 percent of exhaust flow rate, b) heated to no more than 2°F below room setpoint temperature, c) cooled to no lower than 3°F above room setpoint temperature, d) no humidification added, e) no simultaneous heating and cooling.




## Section 5: Compliance Statement

**Compliance Statement:** The proposed mechanical design represented in this document is consistent with the building plans, specifications and other calculations submitted with this permit application. The proposed mechanical systems have been designed to meet the 2009 IECC requirements in COMcheck Version 4.0.2.2 and to comply with the mandatory requirements in the Requirements Checklist.

Danny E. Doss - P.E.

Name - Title



Signature

04/14/16

Date

## Section 6: Post Construction Compliance Statement

- HVAC record drawings of the actual installation, system capacities, calibration information, and performance data for each equipment provided to the owner.
- HVAC O&M documents for all mechanical equipment and system provided to the owner by the mechanical contractor.
- Written HVAC balancing and operations report provided to the owner.

The above post construction requirements have been completed.

Principal Mechanical Designer-Name

Signature

Date

