

DISPLAY THIS CARD ON PRINCIPAL FRONTAGE OF WORK  
CITY OF PORTLAND  
BUILDING INSPECTION

Please Read Application And Notes, If Any, Attached

This is to certify that FIRST BAPTIST CHURCH  
has permission to replacement of existing dry  
AT 326 CANCORD  
CITY OF PORTLAND  
Permit Number: 060373

provided that the person or persons of the provisions of the Statutes of the construction, maintenance and this department.  
Accepting this permit shall comply with all ordinances of the City of Portland regulating structures, and of the application on file in

Apply to Public Works for street line and grade if nature of work requires such information.

OTHER REQUIRED APPROVALS  
Fire Dept. Carey 3-30-06  
Health Dept.  
Appeal Board  
Other

ification of inspection must be taken when permit is issued or closed-in. 4  
UR NO OTHER APPROVALS REQUIRED

A certificate of occupancy must be procured by owner before this building or part thereof is occupied.

*[Signature]*  
Director - Building & Inspection Services

PENALTY FOR REMOVING THIS CARD



# General Building Permit Application

If you or the property owner owes real estate or personal property taxes or user charges on any property within the City, payment arrangements must be made before permits of any kind are accepted.

Location/Address of Construction: 360 Curco Rd., Portland, ME 04103

Total Square Footage of Proposed Structure: \_\_\_\_\_

Square Footage of Lot: \_\_\_\_\_

Tax Assessor's Chart, Block & Lot: 153 Chart# A Block# 001 Lot#

Owner: First Baptist Church Telephone: (207) 773-3123

Lessee/Buyer's Name (If Applicable): \_\_\_\_\_

Applicant name, address & telephone: Simplex Grinnell  
30 Thomas Drive  
Westbrook, ME 04092  
 (207) 842-6440

Cost Of Work: \$ 1,954.00

Fee: \$ 39.00

C of O Fee: \$ \_\_\_\_\_

Current Specific use: Church

If vacant, what was the previous use? Church

Proposed Specific use: Church

Project description: Replacement of existing dry chemical kitchen hood fire suppression system with a new wet chemical system per UL300, NFPA 17A and NFPA 96

Contractor's name, address & telephone: (same as applicant)

Who should we contact when the permit is ready: Tim Hinman

Mailing address: Phone: 207-482-3335


Please submit all of the information outlined in the Commercial Application Checklist. Failure to do so will result in the automatic denial of your permit.

In order to be sure the City fully understands the full scope of the project, the Planning and Development Department may request additional information prior to the issuance of a permit. For further information visit us on-line at [www.portlandmaine.gov](http://www.portlandmaine.gov), stop by the Building Inspections office, room 315 City Hall or call 874-8703.

I hereby certify that I am the Owner of record of the named property, or that the owner of record authorizes the proposed work and that I have been authorized by the owner to make this application as his/her authorized agent. I agree to conform to all applicable laws of this jurisdiction. In addition, if a permit for work described in this application is issued, I certify that the Code Official's authorized representative shall have the authority to enter all areas covered by this permit at any reasonable hour to enforce the provisions of the codes applicable to this permit.

Signature of applicant: [Signature]

Date: 3-21-06

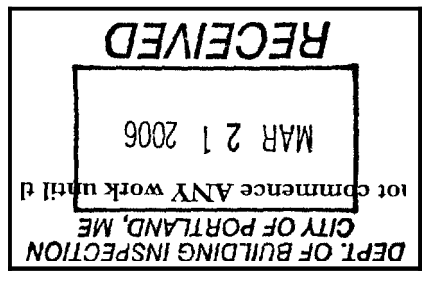

This is not a permit; you may not commence ANY work until a permit is issued.

OC

**SimplexGrinnell**  
**20 Thomas Dr.**  
**Westbrook, ME 04092**  
**Tel: 207-842-6440**

## **CERTIFICATE OF INSTALLATION**

Customer Address	First Baptist Church 360 Canco Rd. Portland, ME 04103
Property inspected	(same)
Hazard location	6' long kitchen hood
System location	Cylinder wall-mounted behind right side of the hood approximately 3' from the right edge of the hood.
System Type	Pyro-Chem model PCL600, UL300 wet chemical per NFPA 17A & 96
System size	3-gallon (1 cylinder)
Remarks	A. System includes: (1) 3-gallon cylinder, (5) discharge nozzles, (2) fusible link detectors, (1) pull station and (1) mechanical gas shutoff valve (in the ceiling above the left side of the hood). B. System nozzles include: (1) 1H nozzle for the plenum, (1) 2D nozzles for the exhaust duct and (3) 2H nozzles for the 6-burner range. C. A micro-switch is available at the system controls to facilitate an alarm system connection if applicable. D. A Class K extinguisher provided for the kitchen to replace the regular dry chemical BC extinguisher.
Installation date	March, 2006
Next inspection due	Semi-annual: Sept. 2006, March. 2007 etc.
Installed by	Installation/inspection by Tom Zielinski