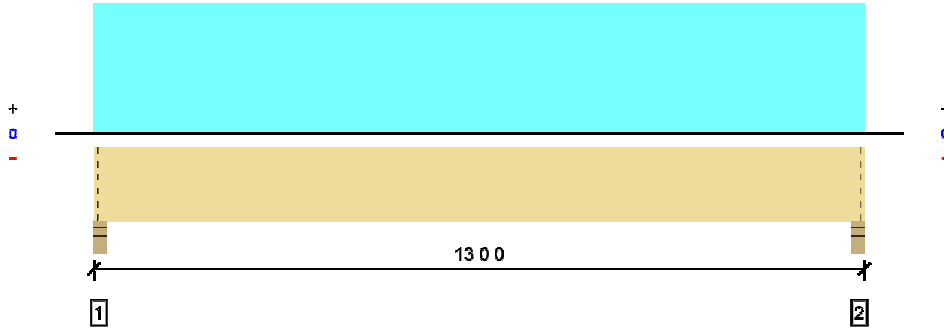


01: Level			
Member Name	Results	Current Solution	Comments
Roof: Drop Beam	Passed	2 Piece(s) 1 3/4" x 9 1/2" 2.0E Microllam® LVL	
entry door header	Passed	2 Piece(s) 2 x 10 Spruce-Pine-Fir No. 1 / No. 2	
Garage door header	Passed	2 Piece(s) 2 x 12 Spruce-Pine-Fir No. 1 / No. 2	

Forte Software Operator	Job Notes
Chris Burnett Hammond Lumber Company (207) 495-3303 cburnett@hammondlumber.com	Keller job 12 Loraine st Portland, Me

Overall Length: 13 0 0



All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.; Drawing is Conceptual

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	3251 @ 0 2 0	5206 (3.50")	Passed (62%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	2709 @ 1 1 0	7265	Passed (37%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	10032 @ 6 6 0	13541	Passed (74%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.464 @ 6 6 0	0.633	Passed (L/328)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.614 @ 6 6 0	0.844	Passed (L/248)	--	1.0 D + 1.0 S (All Spans)

System : Roof
 Member Type : Drop Beam
 Building Use : Residential
 Building Code : IBC 2009
 Design Methodology : ASD
 Member Pitch: 0/12

- Deflection criteria: LL (L/240) and TL (L/180).
- Bracing (Lu): All compression edges (top and bottom) must be braced at 12 1 4 o/c unless detailed otherwise. Proper attachment and positioning of lateral bracing is required to achieve member stability.

Supports	Bearing			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Total	
1 - Stud wall - SPF	3.50"	3.50"	2.19"	794	2457	3251	Blocking
2 - Stud wall - SPF	3.50"	3.50"	2.19"	794	2457	3251	Blocking

- Blocking Panels are assumed to carry no loads applied directly above them and the full load is applied to the member being designed.

Loads	Location (Side)	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 0 0 to 13 0 0	N/A	9.7		
1 - Uniform (PSF)	0 0 0 to 13 0 0 (Front)	7 6 0	15.0	50.4	Roof snow

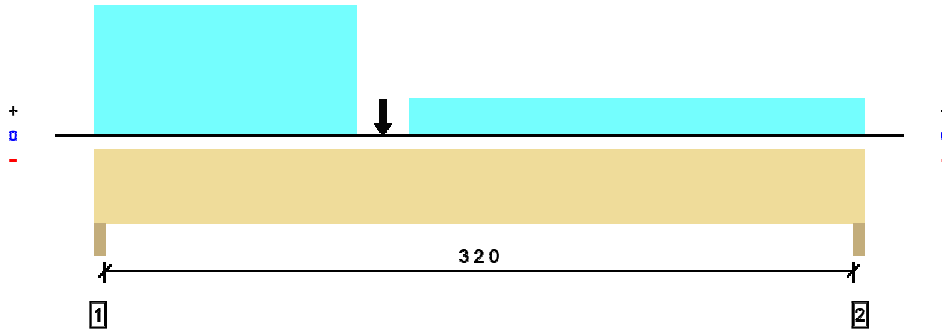
Weyerhaeuser Notes

Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Refer to current Weyerhaeuser literature for installation details. (www.woodbywy.com) Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ES under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports refer to http://www.woodbywy.com/services/s_CodeReports.aspx.

The product application, input design loads, dimensions and support information have been provided by Forte Software Operator



Forte Software Operator	Job Notes
Chris Burnett Hammond Lumber Company (207) 495-3303 cburnett@hammondlumber.com	Keller job 12 Loraine st Portland, Me

2 piece(s) 2 x 10 Spruce-Pine-Fir No. 1 / No. 2
Overall Length: 3 8 0


All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.; Drawing is Conceptual

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	2642 @ 0 1 8	3825 (3.00")	Passed (69%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	2167 @ 1 0 4	2872	Passed (75%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	2870 @ 1 4 8	3946	Passed (73%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.013 @ 1 9 3	0.114	Passed (L/999+)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.018 @ 1 9 3	0.171	Passed (L/999+)	--	1.0 D + 1.0 S (All Spans)

 System : Wall
 Member Type : Header
 Building Use : Residential
 Building Code : IBC 2009
 Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Bracing (Lu): All compression edges (top and bottom) must be braced at 3 8 0 o/c unless detailed otherwise. Proper attachment and positioning of lateral bracing is required to achieve member stability.
- Applicable calculations are based on NDS.

Supports	Bearing			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Total	
1 - Trimmer - SPF	3.00"	3.00"	2.07"	647	1995	2642	None
2 - Trimmer - SPF	3.00"	3.00"	1.50"	370	1121	1491	None

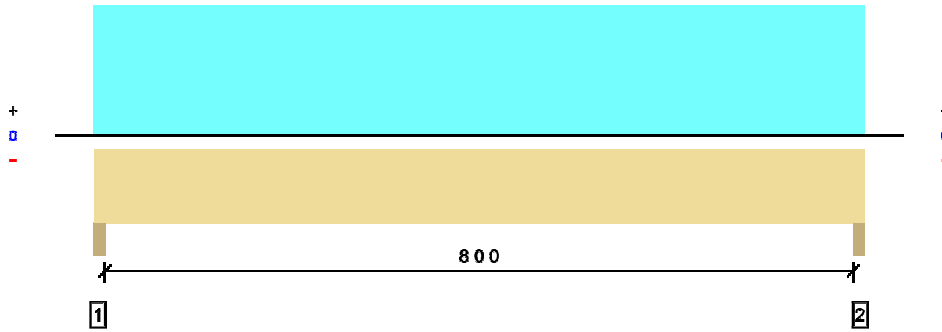
Loads	Location (Side)	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 0 0 to 3 8 0	N/A	7.0		
1 - Uniform (PSF)	0 0 0 to 1 3 0	7 0 0	15.0	50.4	Roof snow
2 - Uniform (PSF)	1 6 0 to 3 8 0	2 0 0	15.0	50.4	Roof snow
3 - Point (lb)	1 4 8	N/A	794	2457	Linked from: Roof: Drop Beam, Support 2

Weyerhaeuser Notes
Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Refer to current Weyerhaeuser literature for installation details. (www.woodbywy.com) Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ES under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports refer to http://www.woodbywy.com/services/s_CodeReports.aspx . The product application, input design loads, dimensions and support information have been provided by Forte Software Operator



Forte Software Operator	Job Notes
Chris Burnett Hammond Lumber Company (207) 495-3303 cburnett@hammondlumber.com	Keller job 12 Loraine st Portland, Me

 4/18/2017 10:50:51 AM
 Forte v5.1, Design Engine: V6.5.1.1

2 piece(s) 2 x 12 Spruce-Pine-Fir No. 1 / No. 2
Overall Length: 8 6 0


All locations are measured from the outside face of left support (or left cantilever end). All dimensions are horizontal.; Drawing is Conceptual

Design Results	Actual @ Location	Allowed	Result	LDF	Load: Combination (Pattern)
Member Reaction (lbs)	592 @ 0 1 8	3825 (3.00")	Passed (15%)	--	1.0 D + 1.0 S (All Spans)
Shear (lbs)	427 @ 1 2 4	3493	Passed (12%)	1.15	1.0 D + 1.0 S (All Spans)
Moment (Ft-lbs)	1186 @ 4 3 0	5306	Passed (22%)	1.15	1.0 D + 1.0 S (All Spans)
Live Load Defl. (in)	0.021 @ 4 3 0	0.275	Passed (L/999+)	--	1.0 D + 1.0 S (All Spans)
Total Load Defl. (in)	0.029 @ 4 3 0	0.412	Passed (L/999+)	--	1.0 D + 1.0 S (All Spans)

 System : Wall
 Member Type : Header
 Building Use : Residential
 Building Code : IBC 2009
 Design Methodology : ASD

- Deflection criteria: LL (L/360) and TL (L/240).
- Bracing (Lu): All compression edges (top and bottom) must be braced at 8 6 0 o/c unless detailed otherwise. Proper attachment and positioning of lateral bracing is required to achieve member stability.
- Applicable calculations are based on NDS.

Supports	Bearing			Loads to Supports (lbs)			Accessories
	Total	Available	Required	Dead	Snow	Total	
1 - Trimmer - SPF	3.00"	3.00"	1.50"	164	428	592	None
2 - Trimmer - SPF	3.00"	3.00"	1.50"	164	428	592	None

Loads	Location (Side)	Tributary Width	Dead (0.90)	Snow (1.15)	Comments
0 - Self Weight (PLF)	0 0 0 to 8 6 0	N/A	8.6		
1 - Uniform (PSF)	0 0 0 to 8 6 0	2 0 0	15.0	50.4	Gable snow

Weyerhaeuser Notes
Weyerhaeuser warrants that the sizing of its products will be in accordance with Weyerhaeuser product design criteria and published design values. Weyerhaeuser expressly disclaims any other warranties related to the software. Refer to current Weyerhaeuser literature for installation details. (www.woodbywy.com) Accessories (Rim Board, Blocking Panels and Squash Blocks) are not designed by this software. Use of this software is not intended to circumvent the need for a design professional as determined by the authority having jurisdiction. The designer of record, builder or framer is responsible to assure that this calculation is compatible with the overall project. Products manufactured at Weyerhaeuser facilities are third-party certified to sustainable forestry standards. Weyerhaeuser Engineered Lumber Products have been evaluated by ICC ES under technical reports ESR-1153 and ESR-1387 and/or tested in accordance with applicable ASTM standards. For current code evaluation reports refer to http://www.woodbywy.com/services/s_CodeReports.aspx . The product application, input design loads, dimensions and support information have been provided by Forte Software Operator



Forte Software Operator	Job Notes
Chris Burnett Hammond Lumber Company (207) 495-3303 cburnett@hammondlumber.com	Keller job 12 Loraine st Portland, Me