

SMOKE

BARRIER

CONSTRUCT 1 HR SMOKE

CONC RAT SLAB AND

UNDERSIDE OF CONC

|GRADE BEAM -

SMOKE /


**BARRIER** 

BARRIER BETWEEN TOP OF

20 MINUTE ACCESS PANEL -

## NOTE: LOCATION OF 1 HOUR SMOKE WALL SHALL EITHER ALIGN BELOW SMOKE WALL ON FIRST FLOOR OR HAVE 1 HOUR SMOKE BARRIER APPLIED TO UNDERSIDE OF FLOOR FRAMING BETWEEN THE TWO. CONTRACTOR SHALL EXPOSE CONDITIONS AND COORDINATE DIRECTION WITH ARCHITECT

SCALE: 1/8" = 1'-0

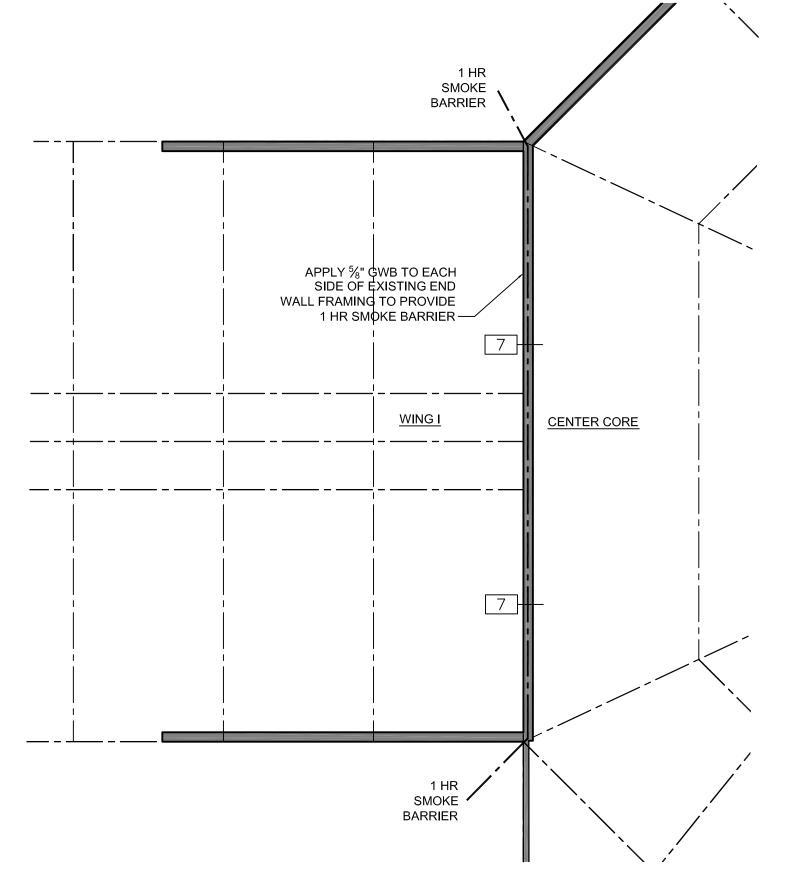

NOTE: LOCATION OF 1 HOUR SMOKE WALL SHALL EITHER ALIGN BELOW SMOKE WALL ON FIRST FLOOR OR HAVE 1 HOUR SMOKE BARRIER APPLIED TO UNDERSIDE OF FLOOR FRAMING BETWEEN THE TWO. CONTRACTOR SHALL EXPOSE CONDITIONS AND COORDINATE DIRECTION WITH ARCHITECT

WATERCLOSET: AMERICAN STANDARD 3043.001 W/ COMFORT SEAT C106SSC

WATERCLOSET VALVE: SELECTRONIC FLOWISE 6065.121.002

SHOWER: CLARION 3837BF34. ADD 4" THRESHOLDS IN NON-ADA BATHROOMS.

SHOWER VALVE: GROHE GROHFLEX 35026 VALVE BOX, 1999867 CONTROLS, HANDHELD SHOWER UNIT AND SS

LAVATORY: ROMA MARBLE 810P INTEGRAL OVAL SINK

WITH BACK AND SIDE SPLASHES. LAVATORY FAUCET: GROHE 32710 CHROME .5 GPM

AERATOR AND GRID STRAINER.

NURSE AREA SINK: JUST SL-ADA-2125-A-GR STAINLESS STEEL

NURSE AREA FAUCET: SYMMONS S-23-3-10

ADA SINKS & LAVS: TRUEBRO MODEL #103E-Z PIPE PROTECTION.

30 X 60 SHOWER HYDRO SYSTEMS HS-6030-BF

## **PLUMBING NOTES:**

PLUMBING SYSTEM SHALL BE DESIGN BUILD AND SHALL MEET THE STATE OF MAINE PLUMBING CODE, CITY OF PORTLAND & DHHS REQUIREMENTS.

DESIGN AND CONSTRUCTION SHALL INCLUDE SUPPLY AND WASTE LINES FROM THE INTERSECTION OF WING I AND THE CENTRAL CORE OF THE BUILDING.

EXISTING CAST IRON WASTE PIPE CAN BE REPLACED WITH PVC AS NECESSARY.

EXISTING COPPER WATER PIPE CAN BE REPLACED WITH PEX TUBING AS NECESSARY.

1). ALL DOORS ARE TO BE PROVIDED WITH ADAAG COMPLIANT HARDWARE

2). ALL DOORS AND FRAMES SHALL HAVE A FIRE-RATING CONSISTENT WITH THE WALL IN WHICH IT IS PLACED, WALLS WITH FIRE OR SMOKE PROTECTION CHARACTERISTICS SHALL EMPLOY DOORS WITH LIKE CHARACTERISTICS.

3). ALL DOOR HARDWARE SHALL INCLUDE LEVER-TYPE LATCH SET, AUTOMATIC CLOSER AND SMOKE SEALS WHEN DOOR . THIS SHALL BE INCORPORATED INTO ALL RATED DOOR

4.) LOCATIONS OF LIFE SAFETY AND SIGNAL DEVICES AS MINIMUM QUANTITIES AND LOCATED AS SUCH. FINAL DETERMINATION SHALL BE AS AS APPROVED BY LOCAL FIRE OFFICIAL REVIEW AND SIGN OFF.

5.) PROVIDE ADAAG COMPLIANT BRAILLE SIGNAGE PER 2010 ADAAG REGULATIONS, PROVIDE FOR THE FOLLOWING SPACES; ELEVATOR, STAIRS / EXITS, TOILET ROOMS AND BREAK ROOM, MOUNT AT 4'-6" A.F.F.

6.) INTERIOR AND ADAAG SIGNAGE SHALL BE PROVIDED BY WELCH STENCIL COMPANY OF SCARBOROUGH, MAINE. THIS SHALL BE ACCOMPLISHED BY THE USE OF A \$1500 ALLOWANCE AND REQUIRE SUBMITTALS FOR ARCHITECT AND OWNER REVIEW AND

7.) ALL PENETRATIONS OF FIRE RATED WALLS AND CEILINGS SHALL BE SEALED WITH UL APPROVED FIRE SEALANT AND FIRE STOPPING MATERIALS.

8.) ALL DIMENSIONS ARE MEASURED FROM CENTERLINE OF STUD WITH THE EXCEPTION OF EXTERIOR WALLS, MILLWORK AND CASEWORK. FINAL DIMENSIONS SHOULD BE DETERMINED BY FIELD MEASUREMENT PRIOR TO FABRICATION AND INSTALLATION OF ALL STOREFRONT, WINDOWS, MILLWORK AND CASEWORK.

9.) WINDOW TREATMENTS AND OFFICE FURNISHINGS SHALL BE FURNISHED BY OWNER AND REQUIRE COORDINATION OF FURNISHINGS PLAN BY THE CONTRACTOR AND SUB CONTRACTORS.

10.) ALL NEW PARTITIONS SHALL EXTEND TO THE UNDERSIDE OF THE DECK ABOVE AND CONSIST OF 3-5/8" OR 6" LIGHT GAGE METAL FRAMING @ 16" OC AND 5/8" TYPE "X" GWB ON EACH SIDE AND 3-1/2"SOUND ATTENUATION BATT WITHIN. FIRE STOP AND FIRE CAULK ALL JOINTS AND PENETRATIONS IN ALL PARTITIONS PROVIDED WITH FIRE RATINGS.




5 FUNDY ROAD FALMOUTH, ME 04105

Fax: 207-699-5564

Online @ foresidearchitects.com

Project Status: PERMIT & **BID SET** 

Project Number:



Phone: 207-781-3344

Seaside Rehabilitation and Healthcare Center 850 Baxter Boulevard Portland, Maine

Drawing Name:

FIRST FLOOR PLAN

Scale: AS NOTED

Date:

02/07/14

SHEET:

\ PLUMBING SCHEDULE & NOTES SCALE: NTS