


6" WET RISER WITH AL. VA. AND 4" FDC

11/2" ANTIFREEZE LOOP TO REAR CANOPY

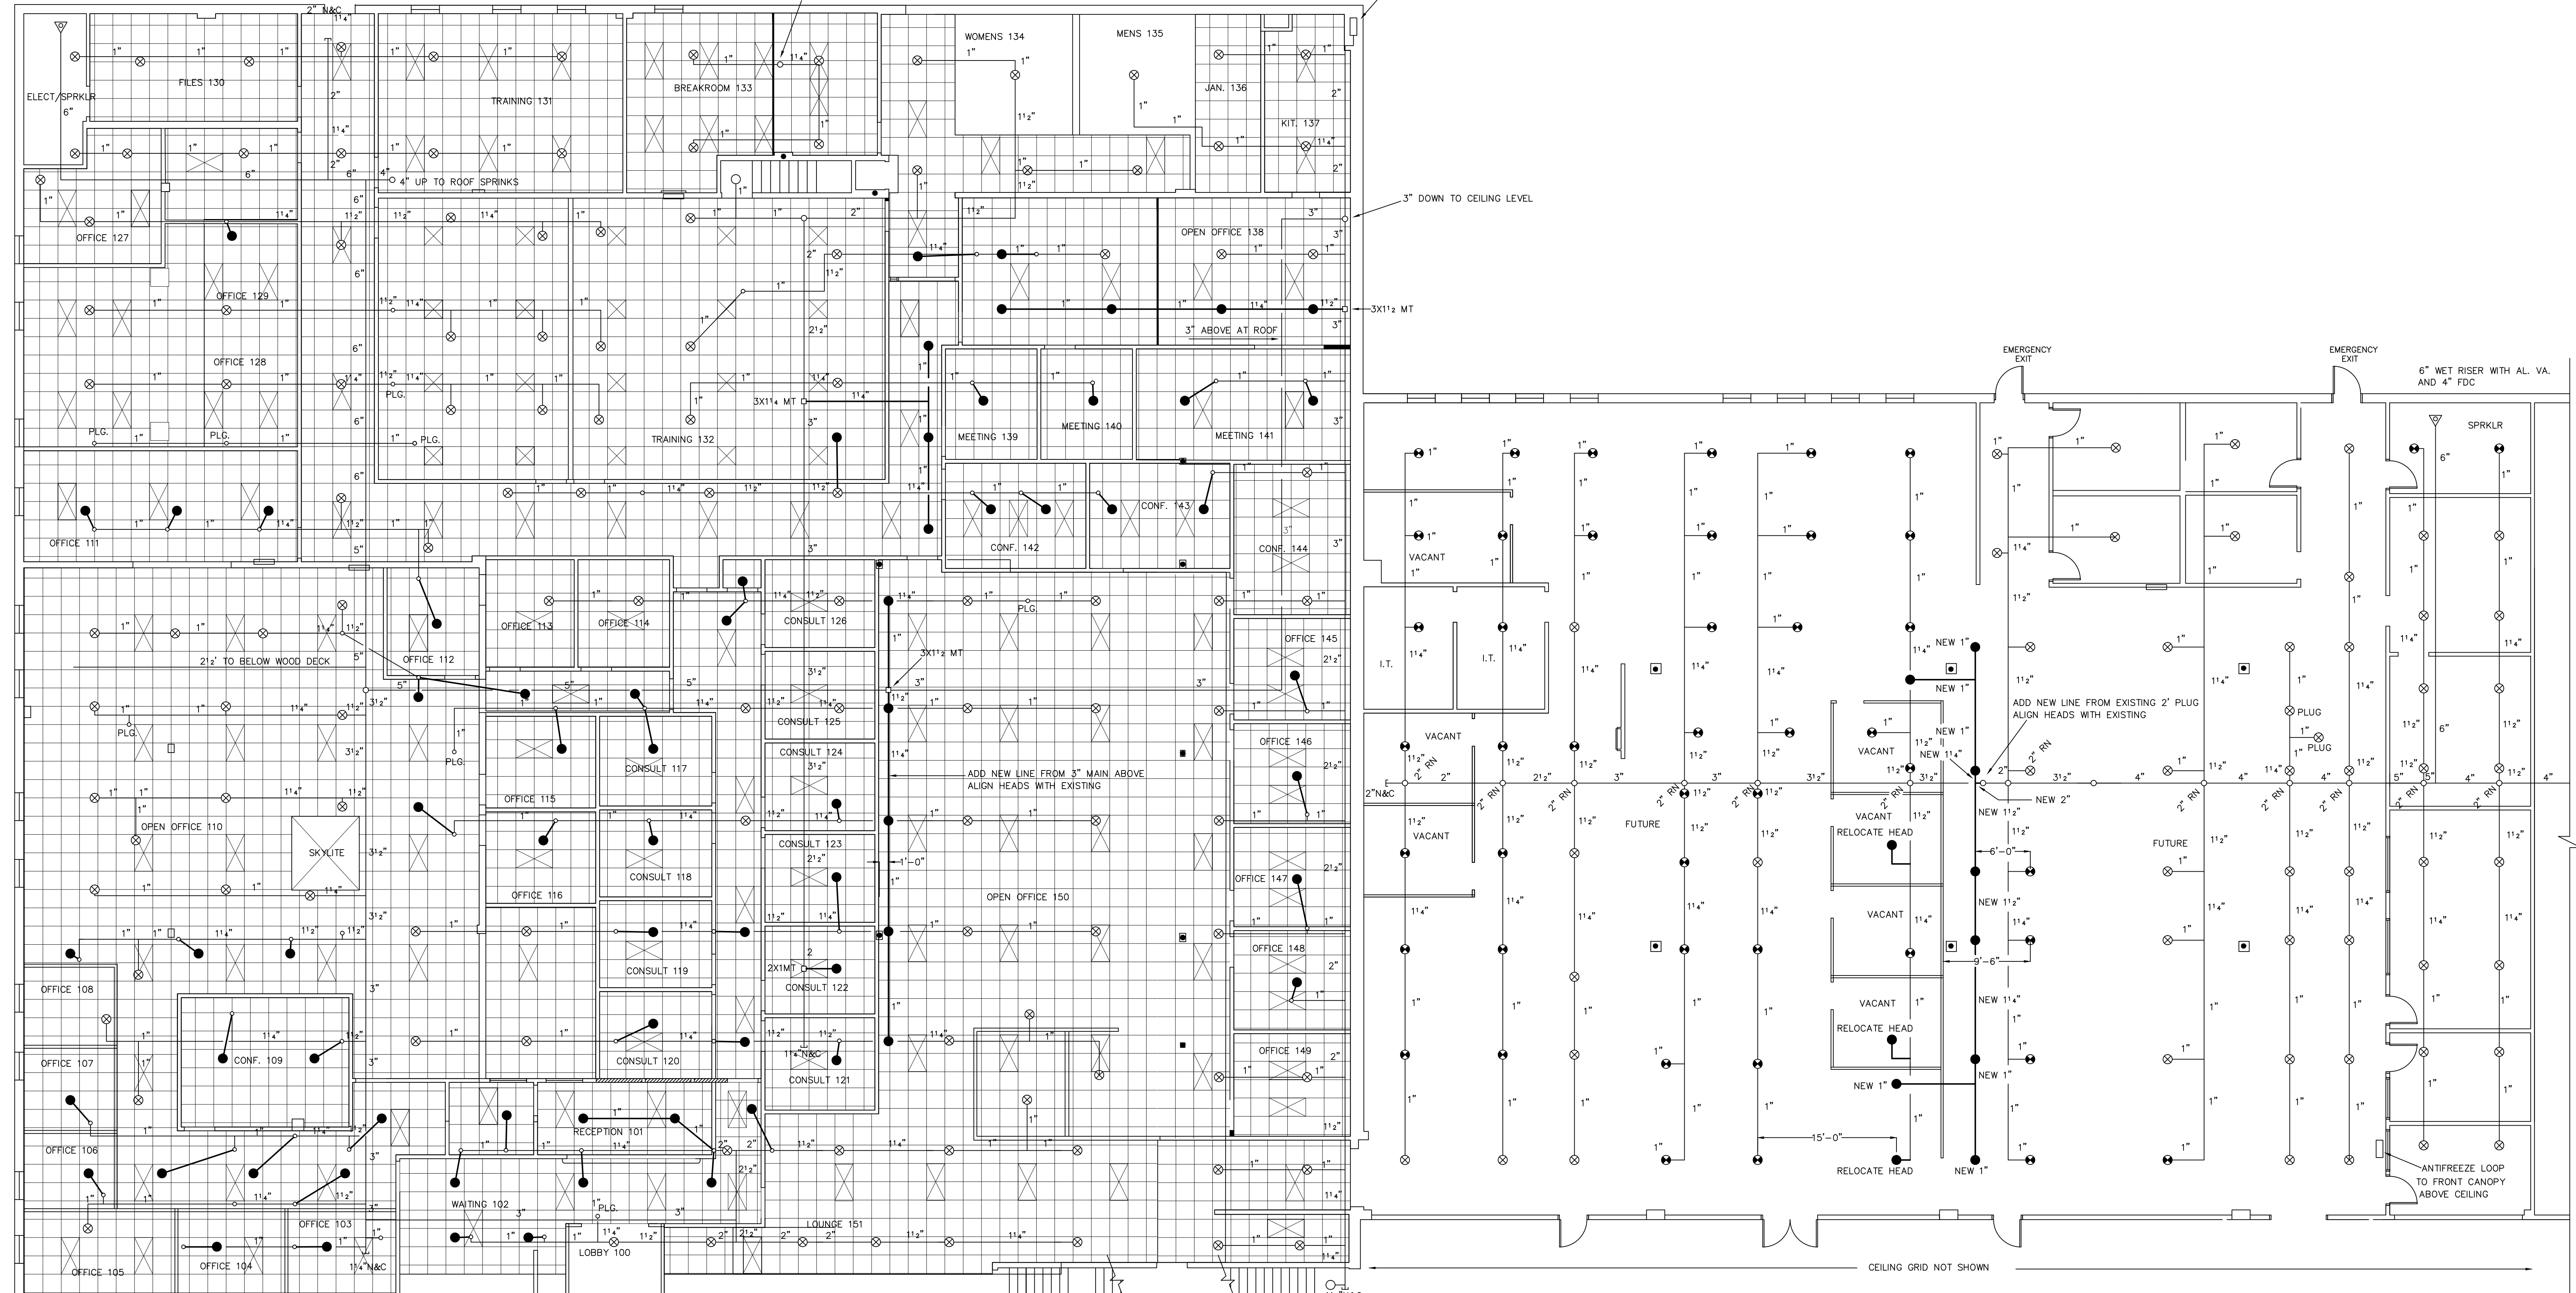


LEGEND

- NEW OR RELOCATED 155" RECESSED Q R WHITE PENDENT
- NEW 155" RECESSED Q R WHITE PENDENT AT EXISTING HEAD LOCATION
- ⊗ EXISTING 155" RECESSED Q R WHITE PENDENT TO REMAIN
- EXISTING 155" Q R BRASS UPRIGHT TO REMAIN
- RISE OR DROP NIPPLE
- X" EXISTING PIPE AND SIZE
- X" NEW PIPE AND SIZE
- ALL NEW "ARM OVERS" ARE 1"

SYSTEM CLASSIFICATION

RENOVATE THE TWO EXISTING WET, PIPE SCHEDULE SYSTEMS TO ACCOMMODATE THE NEW TENANT PARTITION LAYOUT. ALL WORK TO MEET NFPA #13, THE STATE OF MAINE, AND THE CITY OF PORTLAND CODES. RELOCATE 63 SPRINKLERS. ADD 20 NEW SPRINKLERS AND PIPING. CHANGE 47 EXISTING SPRINKLERS FROM STANDARD RESPONSE TO QUICK RESPONSE.

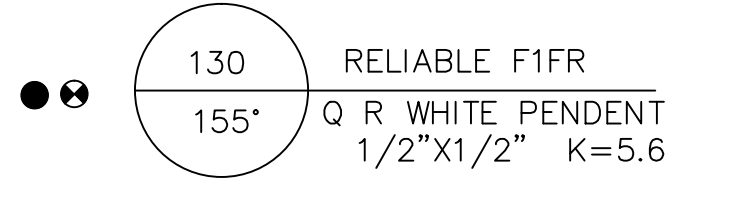

GENERAL NOTES

ALL DIMENSIONS ARE CENTER TO CENTER U/N
 ALL 2" AND SMALLER PIPE TO SCH 40 BLACK STEEL
 ALL 2" AND SMALLER FITTINGS SHALL BE SCREWED STD. WT. C.I. BLACK U/N
 ALL HANGER SPACING AND SIZES TO CONFORM TO NFPA #13.
 SUFFICIENT HEAT TO PREVENT FREEZING OF THE WET PIPE SPRINKLER SYSTEM IS REQUIRED TO BE FURNISHED BY THE BUYER/OWNER.

DEAN & ALLYN, INC.
FIRE PROTECTION • SPECIAL HAZARD

PO BOX 709, GRAY, MAINE 04039
 (207)657-5646 FAX:(207)657-5647
 FIRE PROTECTION SUBCONTRACTOR: DEAN & ALLYN, INC.
 STATE OF MAINE CONTRACTOR'S LICENSE NUMBER 262
 EXPIRATION DATE: JUNE 30, 2015

NO. OF SPRINKLERS SHOWN ON THIS SHEET		130
NO. OF SPRINKLERS ON THIS JOB		130
CONTRACT NO.		C141242

REVISIONS	DATE	APPROVED BY	DATE	SURVEYED BY	HAK [2-23-14]	TITLE
					HAK [2-30-14]	
					DAS XXXX	
					AT DEAN & ALLYN, INC	
					SCALE 1/8"=1'-0" U/N	
					SHEET NO. 1 OF 1	

SPURWINK SERVICES
 901 WASHINGTON AVE.
 PORTLAND MAINE