

FAVREAU'S ELECTRIC, INC.

37 Jordan Avenue
P.O. Box 598
BRUNSWICK, MAINE 04011

LETTER OF TRANSMITTAL

(207) 725-2005

TO

HEBERT CONSTRUCTION

9 GOULD ROAD

LEWISTON, MAINE 04240

DATE DECEMBER 17, 2019	JOB NO.
ATTENTION TIM HEBERT, DAVID MOORE	
RE: 901 WASHINGTON AVE,	
FIRE ALARM	
FINAL RECORD OF COMPLETION	

WE ARE SENDING YOU ☒ Attached ☐ Under separate cover via _____ the following items:

- ☐ Shop drawings ☐ Prints ☐ Plans ☐ Samples ☐ Specifications
☐ Copy of letter ☐ Change order ☒ RECORD OF COMPLETION

COPIES	DATE	NO.	DESCRIPTION
1	12/17/19		8 PAGES FIRE ALARM FINAL RECORD OF TESTING & COMPLETION

THESE ARE TRANSMITTED as checked below:

- ☐ For approval ☐ Approved as submitted ☐ Resubmit _____ copies for approval
☒ For your use ☐ Approved as noted ☐ Submit _____ copies for distribution
☒ As requested ☐ Returned for corrections ☐ Return _____ corrected prints
☐ For review and comment ☐ _____
☐ FOR BIDS DUE _____ ☐ PRINTS RETURNED AFTER LOAN TO US

REMARKS

ATTACHED PLEASE FIND FIRE ALARM RECORD OF TESTING
AND COMPLETION FOR PROJECT CLASCOUT

COPY TO _____

SIGNED:

TOBIE A. KAY

If enclosures are not as noted, kindly notify us at once.

Record of Completion

Presented To

JB Brown & Sons

For

ME Medical Vocational

901 Washington Ave
Portland ME 04101
USA

This site has been inspected and tested in compliance with applicable standards.

Completed
Monday, December 16, 2019

Test Session: 12/16/19 System Adds

ACCEPTED BY

JB Brown & Sons
PO Box 207
Portland ME 04112
USA

TESTED BY

Anthony Morris
Norris Inc
2257 Broadway
South Portland ME 4106
USA

Norris Inc



Norris Inc.

Advancing security, life safety and communications.

Inspection Location and Organizations

Building Information

PROPERTY	ME Medical Vocational	CONTACT	Willow Williams
ADDRESS	901 Washington Ave	PHONE	(207) 200-2181
CITY/STATE/ZIP	Portland, ME 04101	MOBILE	
COUNTRY	USA	EMAIL	willow.williams@jbbrown.com

Installer Information

NAME	Norris Inc
ADDRESS	2257 Broadway South Portland ME 4106
PHONE	(207) 883-3473
EMAIL	NICentralOperations@norrisinc.com

Service Company Information

NAME	Norris Inc
ADDRESS	2257 Broadway South Portland ME 4106
PHONE	(207) 883-3473
EMAIL	NICentralOperations@norrisinc.com

Testing Company Information

NAME	Norris Inc
ADDRESS	2257 Broadway South Portland ME 4106
PHONE	(207) 883-3473
EMAIL	NICentralOperations@norrisinc.com
CONTRACT DATE	

Secondary Power

TYPE	Battery - Sealed Lead-Acid	DESCRIPTION	FCPS Batteries Rm 116
NOMINAL VOLTAGE	0	LOAD VOLTAGE	
AMP HOURS	0	STANDBY HOURS	0
ALARM MINUTES	0	CHARGER VOLTAGE	
BATTERY LOCATION			

Description of Service

This is an existing system.
Permit #
NFPA72 Edition:
Number of devices participating in Alarm Verification: 0

Remote Annunciator Summary

Initiating Device Summary

EQUIPMENT TYPE	TOTAL
Alarm Notification Appliance	12
Initiating Device	5
Fire Control Panel	3
Power Supplies	1

Notification Device Summary

Norris Inc

EQUIPMENT TYPE	TOTAL
Alarm Notification Appliance	12
Initiating Device	5
Fire Control Panel	3
Power Supplies	1

Device Summary

EQUIPMENT TYPE	TOTAL
Alarm Notification Appliance	12
Initiating Device	5
Fire Control Panel	3
Power Supplies	1

Certification Information

Certification

The equipment specified herein was inspected and tested according to the NFPA 72 standard for fire alarm and signaling systems, with the inspection completed on Monday, December 16, 2019

INSTALLED BY

12/16/2019
Favreau Electric
Installer

TESTED BY



12/16/2019
Anthony Morris
Technician

ACCEPTED BY

ACCEPTED BY

12/16/2019

12/16/2019
PFD
AHJ


Testing Details

Fire Control Panel

Passed

EQUIPMENT TYPE	ADDRESS	DESCRIPTION	METHOD	DATE/TIME
FCPS		New FCPS in MMC Vocational Electric Rm 116	Manual	12/16/2019 12:01 PM

Comment:

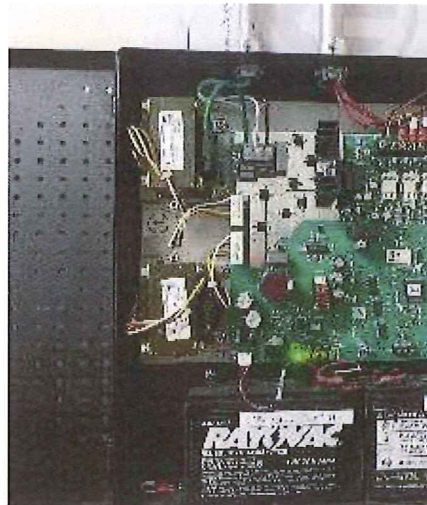


Fire Alarm Panel

Bosch Radionics

Manual

12/16/2019 12:01 PM

Comment:

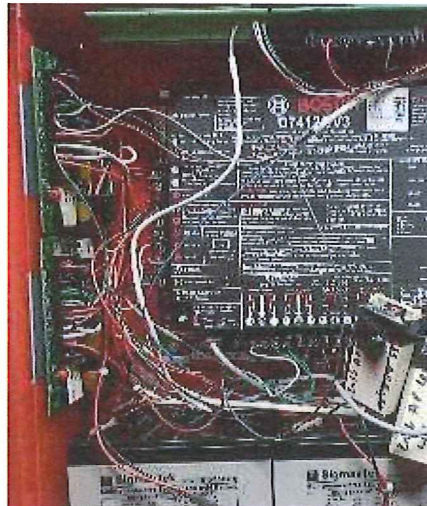

Remote Annunciator

Main Entry Waiting 101 Existing

Manual

12/16/2019 12:01 PM

Power Supplies

Passed

EQUIPMENT TYPE	ADDRESS	DESCRIPTION	METHOD	DATE/TIME
Battery - Sealed Lead-acid		FCPS Batteries Rm 116	Manual	12/16/2019 12:01 PM
	Comment:	New 12-16-19		

Norris Inc

Initiating Device

Passed

EQUIPMENT TYPE	ADDRESS	DESCRIPTION	METHOD	DATE/TIME
Smoke Detector - General	Z26-5	Existing Smoke Electric Rm 116	Manual	12/16/2019 12:00 PM
Smoke Detector - General	Z26-4	Existing Smoke Open Office 101	Manual	12/16/2019 12:00 PM
Smoke Detector - General	Z26-3	Existing Smoke Open Office 101	Manual	12/16/2019 12:00 PM
Manual Pull Station	Z27-6	Main Entry by Waiting 101	Manual	12/16/2019 12:00 PM
Manual Pull Station	Z27-5	Lobby 124	Manual	12/16/2019 12:00 PM

Alarm Notification Appliance

Passed

EQUIPMENT TYPE	ADDRESS	DESCRIPTION	METHOD	DATE/TIME
Audible And Visible		Corridor 110 to Restrooms	Manual	12/16/2019 12:00 PM
Audible And Visible		Open Office 103 Side Wall	Manual	12/16/2019 12:00 PM
Audible And Visible		Open Office 103 Front Wall	Manual	12/16/2019 12:00 PM
Visible		Conference Rm	Manual	12/16/2019 12:00 PM
Audible And Visible		Lobby 124	Manual	12/16/2019 12:00 PM
Visible		Interview Rm 123	Manual	12/16/2019 12:00 PM
Visible		Interview Rm 122	Manual	12/16/2019 12:01 PM
Visible		Corridor 118 OS Rm 122	Manual	12/16/2019 12:01 PM
Visible		Interview Rm 121	Manual	12/16/2019 12:01 PM
Visible		Bathroom 114	Manual	12/16/2019 12:01 PM
Audible And Visible		Corridor 115 OS Bathroom 114	Manual	12/16/2019 12:01 PM
Visible		Interview Rm 119	Manual	12/16/2019 12:01 PM

Device/Equipment Details

Fire Control Panel

ADDRESS	DESCRIPTION	Manufacturer	Model	SERIAL	INSTALL DATE
FCPS					
	New FCPS in MMC Vocational Electric Rm 116	Notifier	24S8		12/16/2019
Fire Alarm Panel					
	Bosch Radionics	Bosch	D7412GV3		12/16/2019
Remote Annunciator					
	Main Entry Waiting 101 Existing	Radionics			12/16/2019

Power Supplies

ADDRESS	DESCRIPTION	Manufacturer	Model	SERIAL	INSTALL DATE
Battery - Sealed Lead-acid					
	FCPS Batteries Rm 116	Rayovac	12V-7AH		12/16/2019

Initiating Device

ADDRESS	DESCRIPTION	Manufacturer	Model	SERIAL	INSTALL DATE
Manual Pull Station					
Z27-6	Main Entry by Waiting 101	Notifier	NBG-12L		12/16/2019
Z27-5	Lobby 124	Notifier	NBG-12L		12/16/2019
Smoke Detector - General					
Z26-3	Existing Smoke Open Office 101				12/16/2019
Z26-4	Existing Smoke Open Office 101				12/16/2019
Z26-5	Existing Smoke Electric Rm 116				12/16/2019

Alarm Notification Appliance

ADDRESS	DESCRIPTION	Manufacturer	Model	SERIAL	INSTALL DATE
Audible And Visible					
	Corridor 115 OS Bathroom 114	Wheelock	HSR		12/16/2019
	Open Office 103 Side Wall	Wheelock	HSR		12/16/2019
	Open Office 103 Front Wall	Wheelock	HSR		12/16/2019
	Lobby 124	Wheelock	HSR		12/16/2019
	Corridor 110 to Restrooms	Wheelock	HSR		12/16/2019
Visible					
	Interview Rm 122	Wheelock	STR		12/16/2019
	Interview Rm 121	Wheelock	STR		12/16/2019
	Bathroom 114	Wheelock	STR		12/16/2019
	Corridor 118 OS Rm 122	Wheelock	STR		12/16/2019
	Interview Rm 119	Wheelock	STR		12/16/2019
	Interview Rm 123	Wheelock	STR		12/16/2019
	Conference Rm	Wheelock	STR		12/16/2019

Supplementary Information