

FIXTURE SCHEDULE-COMMON AREAS

TYPE	MANUFACTURER	CATALOG NUMBER	VOLT	LAMP	DESCRIPTION
B1	LITHONIA	AF218DT-IPC	120	(2)P1418/SP35	RECESSED PL, SHOWER ROOM
B2	PROGRESS	P9210-28	120	(2)P1418/SP35	UP LIGHT IN SKYLIGHT
B3	LITHONIA	RP-218SE-PBL2	120	(4)P25-18/SP35	RECESSED SPRT LIGHT, ELEV LOBBY, 4FT
C1	LITHONIA	GT232	120	(2)P32-18/SP35	CORRIDORS, RECESSED 1X4
C2	LITHONIA	2PAX8332-180	120	(2)P32-18/SP35	RECESSED 2X4 PARABOLIC, OFFICES/CORRIDORS
C3	INDY	728R-SA	120	(2)P1418/SP35	CORRIDORS, RECESSED PL, DOWN LIGHT
C3*	INDY	728R-SA	120	(2)P1418/SP35	CORRIDORS, RECESSED PL, DOWN LIGHT
C4	LITHONIA	2AV-33Z-SBL	120	(2)P17-18/SP35	RECESSED 2X2 UP/DN W/LOUVER, PUBLIC ROOMS
C4*	LITHONIA	2AV-33Z-SBL	120	(2)P17-18/SP35	RECESSED 2X2 UP/DN W/LOUVER, PUBLIC ROOMS
C5	LITHONIA	2M2L1	120	(2)P13-18/SP35	STAIRS, SURFACE 2X2 FLR
C6	PROGRESS	P7128-10	120	(1)160W/A/18/FR	APARTMENT ENTRY WALL SCONCE
C7	PROGRESS	P7196-MEB	120	(2)P13/SP35	CORRIDOR WALL SCONCE, ADA EXTENDS 4"
C8*	PROGRESS	PR1676/PR0696-21	120	(1)WR18/50	RECEPTION AREA, LOW VOLTAGE, DOWN LIGHT
C8	LITHONIA	2C7432-FW	120	(4)P32-18/SP35	RECESSED 2X4 ALUMINUM LENSED/CASKETED, KITCHEN
C9	PROGRESS	P7226-8EB	120	(2)P17/18	VANITY LIGHT PUBLIC TOILETS
CW	PROGRESS	P2897-10	120	(1)90W/A19	DINING ROOM WALL SCONCE
CW	BY OWNER	-	120	-	DINING ROOM CHANDELER
S52	LITHONIA	SS232	120	(2)P32-18/SP35	ATTACHED STAIR, LENGTH AS REQUIRED
F	NUTONE	94120	120	(1)250W	BATH HEAT LAMP UNIT
SL-1	PROGRESS	P6674-31	120	(1)75W/PAR	WALL MOUNT CYLINDER
SL-2	PROGRESS	P6814-31	120	(1)90W/A19	WALL LIGHT AT ENTRANCES
SL-3	PROGRESS	P5745-31	120	(2)90W/A19	CEILING LIGHT AT PORCH, FIRST AND SECOND FLOORS
S55	LITHONIA	SST-SERIES	120	(2)P32-18	STAGGERED FLUORESCENT LENGTH AS REQUIRED
UC	LITHONIA	2U220	120	(2)P15-18/SP35	UNDERCABINET LIGHT, 2FT
UC	LITHONIA	LES-ELN	120	LED	EXIT SIGN
4	LITHONIA	8EM2V	120	AS REQUIRED	EMERGENCY LIGHT


FIXTURE SCHEDULE-APARTMENTS

TYPE	MANUFACTURER	CATALOG NUMBER	VOLT	LAMP	DESCRIPTION
U1	PROGRESS	P3418-10	120	(2)75W/A19	BATHROOM VANITY LIGHT
U2	PROGRESS	P3288-15	120	(4)90W/A19/FROSTED	BATHROOM CEILING LIGHT
U3	PROGRESS	P7372-30	120	(1)22(1)320W-CIRCLINE	BATHROOM CEILING LIGHT
U4	NOT USED	-	120	-	-
U5	PROGRESS	P3418-10	120	(2)75W/A19	KITCHEN/LIVING ROOM LIGHT
U6	PROGRESS	PR821-30	120	(2)P17/SP35	NIGHT LIGHT, SINGLE SIDE
U7	PROGRESS	PR811-60	120	(1)A19/75W	SHOWER LIGHT

PROVIDE MASTER/SLAVE BALLAST AND WIRING AS REQUIRED TO MEET ENERGY CODES REGARDLESS SHOWN OR NOT SHOWN. BALLASTS SHALL BE IN COMPLIANCE WITH LOCAL UTILITY COMPANY REBATE PROGRAMS. FLUORESCENT FIXTURES SHALL HAVE ELECTRONIC BALLASTS THD LESS THAN 24.5

SYMBOL LIST

○	CEILING MOUNTED LIGHT FIXTURE.
□	WALL MOUNTED LIGHT FIXTURE.
□	2'X2' OR 2'X4' FLUORESCENT LIGHT FIXTURE.
□	1'X4' FLUORESCENT WALL/CEILING MOUNTED LIGHT FIXTURE.
□	SINGLE POLE LIGHT SWITCH
S	THREE-WAY LIGHT SWITCHES
S ₀	DIMMER SWITCH MINIMUM 1000W OR AS REQUIRED PER CIRCUIT
□	DUPLEX RECEPTACLE, 120V/18" AFT.
□	DUPLEX RECEPTACLE WITH GROUND FAULT INTERRUPTER 8" ABOVE COUNTER TO Ⓢ
□	DUPLEX RECEPTACLE, 120V/18" AFT., ONE OUTLET SWITCHED
□	120V DOUBLE DUPLEX CONVENIENCE RECEPTACLE
□	DUPLEX RECEPTACLE ABOVE COUNTER, 8" ABOVE COUNTER TO Ⓢ
□	DUPLEX CONVENIENCE RECEPTACLE - 18" AFT UNLESS OTHERWISE NOTED
□	120V CONVENIENCE RECEPTACLE - 18" AFT UNLESS OTHERWISE NOTED
□	TELEPHONE JACK COMPLETE W/JACK AND COVER, (W" WALL MOUNTED @ 4'-0" A.F.F)
□	DATA OUTLET, COMPLETE W/JACK AND COVER, HEIGHT AT 18" TO Ⓢ AFT.
□	CABLE TV OUTLET, COMPLETE W/JACK AND COVER, HEIGHT AT 18" TO Ⓢ AFT.
□	MOTOR
□	FUSED DISCONNECT SWITCH, (OR RAIN-PROOF).
□	STARTER
□	SYSTEM TYPE SMOKE DETECTOR
□	DUCT SMOKE DETECTOR W/REMOTE TEST SWITCH
□	HEAT DETECTOR
□	FIRE ALARM PULL AND A/V DEVICE
□	FIRE ALARM PULL STATION CENTERLINE 4'-0" AFT
□	FIRE ALARM AUDIO/VISUAL UNIT, MTD. @ 6'-8" AFT
□	FIRE ALARM LIGHT, MTD. @ 6'-8" AFT
□	110V LOCAL TYPE SMOKE DETECTOR W/BATTERY
□	FIRE ALARM HORN
□	DOOR CHIME
□	KEY PAD
□	DOOR BELL
□	DOOR CONTACT
□	MAGNETIC DOOR HOLDER
□	MASTER BOX
□	TYPICAL WIRING, DIAGONAL LINES INDICATES QUANTITY OF CONDUCTORS.
□	HOMERUN TO PANEL WITH ISOLATED GROUND CONDUCTORS (HOT, NEUTRAL, GROUND)
□	HOMERUN TO PANEL WITH CONDUCTORS (HOT, NEUTRAL, GROUND)
□	JUNCTION BOX
□	LIGHTING & POWER PANEL, RECESSED
□	FIRE ALARM CONTROL PANEL
□	FIRE ALARM ANNUNCIATOR
□	TAMPER SWITCH
□	FLOW SWITCH
□	RACEWAY CONCEALED IN CEILING, PLENUM OR WALLS
□	RACEWAY CONCEALED IN SLAB (FLOOR)
□	TIME SWITCH
□	DRY TYPE TRANSFORMER
□	120V PLUGMOLD - 38" AFT UNLESS OTHERWISE NOTED
□	UNIVERSAL MOUNTING EXIT SIGN (DOUBLE FACED), ARROWS AS INDICATED.
□	EMERGENCY BATTERY UNIT WITH MOUNTING BRACKET AND VOLTMETER.
□	OCCUPANCY SENSOR
□	SPEAKER

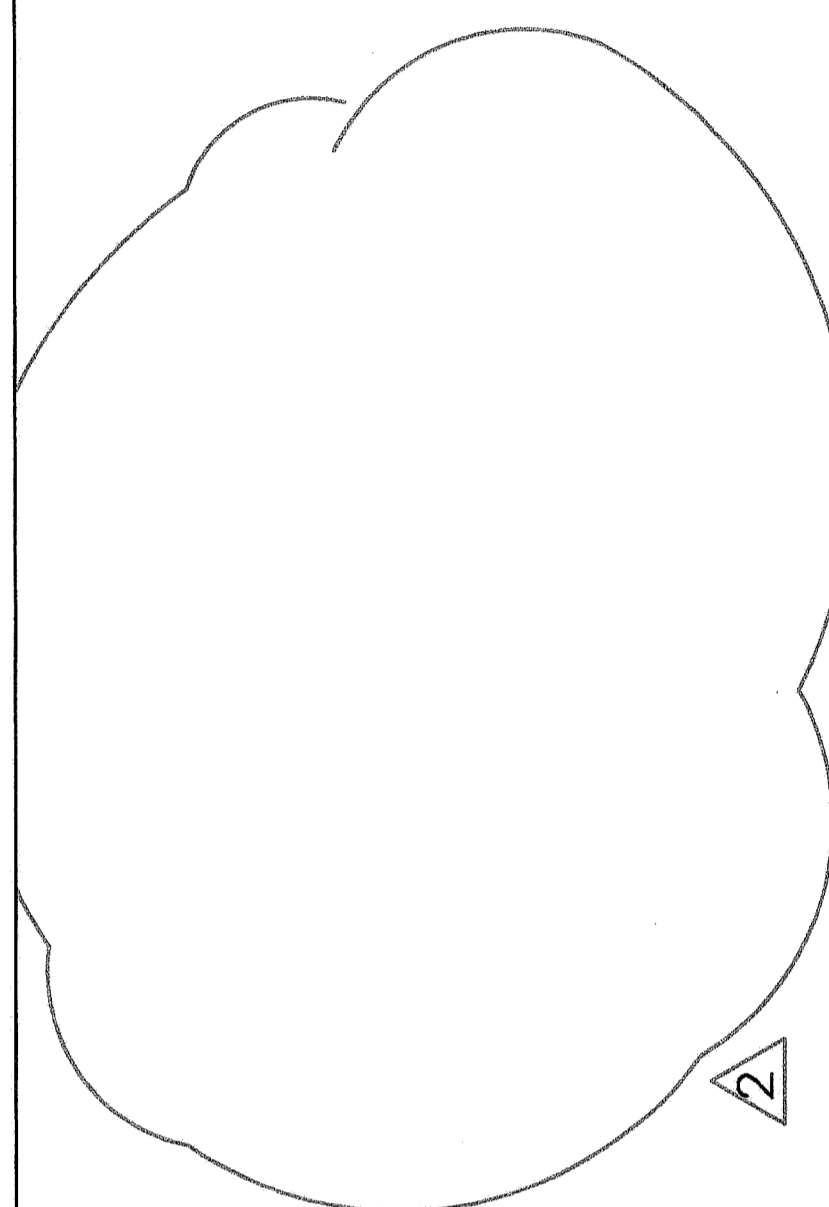

Revision	No.	Date
GENERAL REVISIONS	△	03/20/06
FINAL PRICING	△	10/05/06
HAD FIRST COMMITMENT	△	11/22/06

Project:

**THE INN
AT CEDARS**
PORTLAND, MAINE

Drawing Title
**ELECTRICAL
RISER DIAGRAMS
FIXTURE SCHEDULES
& SYMBOL LIST**

Tsomidis Associates Architects
and Planners
389 Elliot Street
Newton Upper Falls, MA 02464
P: 978-688-3774 Fax: 978-688-4783
E: info@tsomidis.com

DATE SHOWN	6/24/05 BID SET
SCALE	MIS
DRAWING NUMBER	

E-700



ZADE COMPANY INC.
CONSULTING ENGINEERS
140 BEACH STREET, BOSTON, MA 02111
TEL: (617) 338-4406
FAX: (617) 338-4407
E-MAIL: zade@zade.com