

SECTION V: VENTING & AIR INTAKE PIPING (continued)

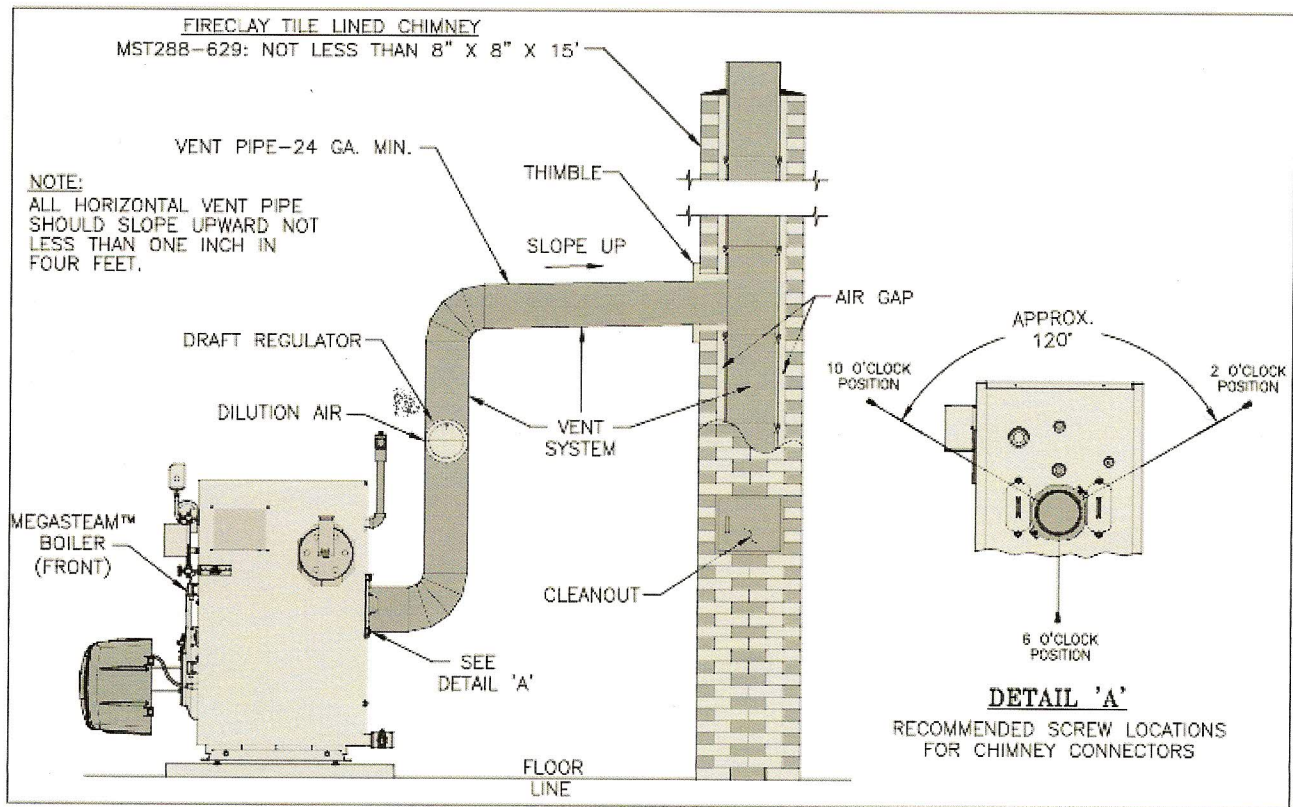


Figure 18: Recommended Vent Pipe Arrangement and Chimney Requirements

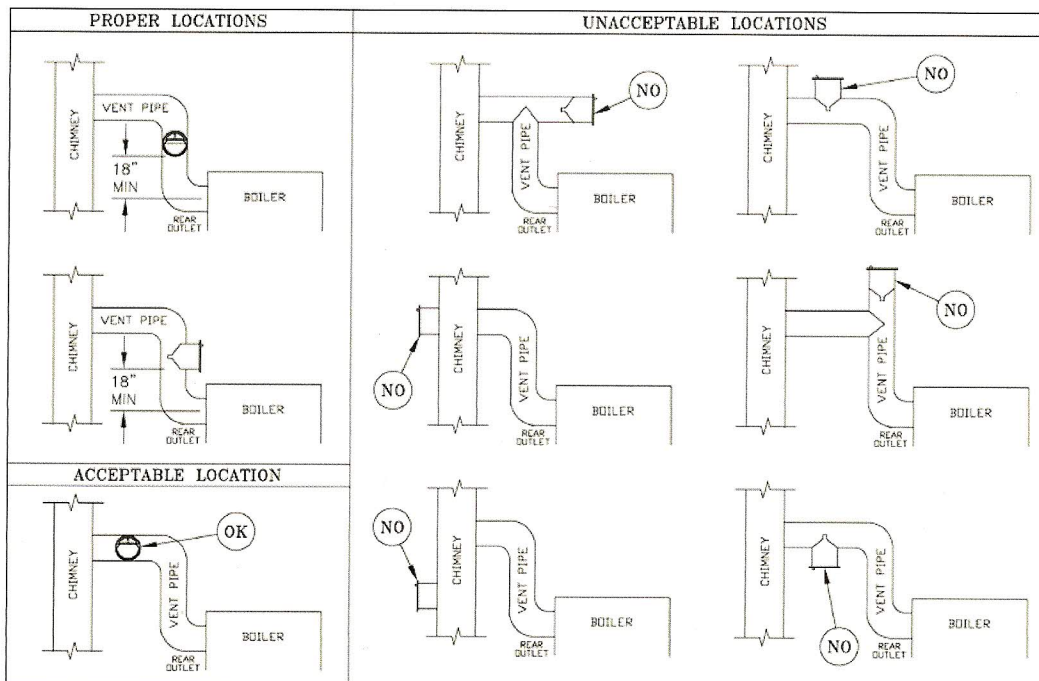


Figure 19: Proper and Improper Locations of Draft Regulator