

13-0012
GMS, Westminster Home
Portland, ME

GENERAL STRUCTURAL NOTES

DESIGN LIVE LOADS: 2009 IBC, MUEBC
 * Snow 60 psf (Pg)
 * Wind 90 mph, exp B, 3 second gust
 * Floor 40 psf

FOUNDATION:
 * Foundation design is in accordance with recommendations contained in soils investigation report number # 12180 prepared by Summit Geoengineering Services, Inc. dated 10/7/12.
 * The report is hereby referenced and except where otherwise specifically noted herein, all recommendations and precautions contained in that report shall be adhered to by the contractor.
 * Footings shall be placed on undisturbed natural soil or compacted fill tested and approved by soils engineer.
 * Allowable bearing pressure = 4,000 psf. Bear on soil approved by the Soils Engineer. -typ

FOUNDATION WALLS:
 * Design lateral soil pressure (equivalent fluid pressure):
 Walls: 50 pcf.
 * Backfill all retaining walls with free draining granular material except the top two feet.
 * Provide perimeter drain system with invert minimum of 6" below bottom of basement slab. Extend perimeter drain to daylight or to sump.
 * Slope perimeter grade away from building.
 * Place concrete continuously without horizontal cold joints.


CONCRETE AND REINFORCEMENT:
 * Concrete shall conform to applicable provisions of ACI-301 and 318. Minimum 28 day compressive strength (F'c) as follows:
 Footings: 4,000 psi w/ 4-6% air entrainment
 Foundation Walls: 4,000 psi w/ 4-6% air entrainment
 Interior Slabs: 3,500 psi w/ fibermesh
 Exterior Slabs: 4,000 psi w/ 4-6% air entrainment and fiber mesh
 * Cement Type: 1/II
 * Deformed reinforcement: ASTM A615 grade 60, except bars specified to be field-bent, stirrups, and ties which shall be grade 40.
 * Fibermesh: 100% virgin polypropylene, fibrillated fibers as manufactured by Fibremesh Co. per ASTM C-1116 type 111 4.1.3 and ASTM C-1116 performance level one, 1.5 lb. per cubic yard.
 * Welded Wire Fabric (WWF): ASTM A185. See also plan.
 * Typical minimum foundation reinforcing: 2 #4 top and bottom, (except as noted) continuous at corners and steps.
 * Reinforcement shall be fabricated and placed per ACI Manual of Standard Practice (ACI-315). At splices, lap bars 50 diameters unless noted otherwise.
 * Minimum 2 #4 around all four sides of all openings, extend min. 2'-0" beyond openings.
 * Concrete cover over reinforcing: 1 1/2" for concrete placed against forms; 3" for concrete placed against earth. See also drawings.
 * In continuous members, splice top bars at mid span and bottom bars over supports.
 * Keep reinforcement clean and free of dirt, oil, and scale. Oil forms prior to placing reinforcement.

STRUCTURAL STEEL:
 * Angles, misc.: ASTM A36
 * W shapes: ASTM A36
 * HSS: ASTM A500 GRADE B
 * Anchor Bolts: ASTM A36
 * Expansion Anchors shall be ICC-ES approved, installed in accordance with manufacturers specifications. In concrete: Wedge Type


WOOD FRAMING:
 * Dimension Lumber is designed and shall be supplied using BASE VALUES Design Criteria.
 * SPF #2 and better (Maximum Moisture Content 19%) U.O.N.
 Plates: Sill plates: Pressure Treated SPF or Southern Pine.
 "Pressure treated lumber" shall be framing material of the specified species which has been pressure treated with a decay and insect resistant solution, meeting all current standards for wood in contact with concrete or earth.
 Sill plates in contact with masonry or concrete foundations, footings or slabs may be treated Timber Strand LSL (zinc borate treatment). Sodium borate treatment may also be acceptable for sill plate applications when protected from weather.
 Acceptable treatment mediums for wood in contact with earth or in exterior applications include ACQ-C and ACQ-D (Alkaline Copper Quaternary) and copper azole (CBA-A and CBA-B).
 DO NOT USE WOODS WHICH HAVE BEEN TREATED WITH AMMONIA BASED CARRIERS.
 All connectors shall meet the recommendations of the pressure treated wood manufacturer, but shall be not less than Hot Dipped Galvanized meeting requirements of ASTM A653, such as Simpson ZMAX (G185). All screws, nails and bolts shall match hangers and other connectors, and shall meet ASTM A123 for individual connectors, and ASTM A153 for fasteners.
 For durability, it is our recommendation that connectors used in exposed conditions with treated lumber be stainless steel.
 Do not mix galvanized and stainless products.
 Do not allow aluminum to contact treated wood.
 Top and Bottom Plates: SPF No 2 and better
 Hem Fir Studs U.O.N.: 2 x 4 and 2 x 6 to 8'-0": stud grade
 2 x 4 over 8'-0": standard and better
 2 x 6 over 8'-0": No. 2 and better

* Laminated Veneer Lumber (LVL): Manufactured 1 3/4" wide Microlams (ML) by Ilevel/Trus Joist or equivalent. Fb=2,600 psi, E=1,900,000 psi, Fv=285 psi, depth noted on plans.
 * All plywood and oriented strand board (OSB) sheathing shall be engineered grades with APA grade stamp indicating appropriate maximum spacing of supports.
 Floor sheathing: nominal 3/4", APA Sturd-I-Floor "24" tongue & groove glued and nailed.
 Wall sheathing: 1/2" Gypsum nailed or screwed (interior). 7/16" OSB nail base insulated panel (exterior walls)
 Roof sheathing: 19/32" OSB base insulated panel, fastened w/ #10x4" wood screw @ 12" OR 16ds at 4" max
 * Nail wall sheathing with 10d commons at 6" o.c. at panel edges, and 12" o.c. intermediate framing U.N.O.
 BLOCK AND NAIL ALL EDGES BETWEEN STUDS. Sheathing shall be continuous from bottom plate to top plate. Cut in "L" and "T" shapes around openings. Lap sheathing over rim joists min. 4" at all floors to be upper and lower stud walls together. Minimum height of sheathing panels shall be 16" to assure that plates are tied to studs. Use minimum 3-8d per stud and nail plates with edge nail spacing.
 * Sole plate at all perimeter walls and at designated shear walls shall be nailed as for braced panels with 3-16d x 3 1/2" long box nails (coated or deformed shank) per 16". 12d nails are not acceptable.
SHEATH ALL EXTERIOR WALLS.
 * Minimum nailing shall comply with IBC Table 2304.9.1 except where more or larger nailing shown on drawings.
 * All roof rafters, joists, beams shall be anchored to supports with metal framing anchors.
 * Double joists under partitions where joists are parallel to partitions.
 * Provide continuous wall studs each side of wall openings equal to one half or greater of number of studs interrupted by openings.
 * All wall studs shall be continuous from floor to floor or from floor to roof.
 * Cross brdge all dimension lumber roof and floor joists at midspan and provide solid blocking or rim joists at all joint supports and joist ends.
 * Metal connectors: Simpson Strong Tie unless otherwise noted, installed with number and type of nails to achieve maximum rated capacity. Note that heavy duty and skewed hangers may require special order.
 * All beams shall be braced against rotation at points of bearing.
 * Drypack grout all beam pockets full after beams are set.
 * Unless otherwise indicated, install two lengths of solid blocking x joint depth x 12 inches long in floor framing under column loads. Columns must have a continuous load path to foundation.
 * Lead holes for lag bolts shall be 60% to 70% of lag shank diameter in compliance with AITC criteria.

STRUCTURAL ERECTION AND BRACING REQUIREMENTS
 * The structural drawings illustrate the completed structure with all elements in their final positions, properly supported and braced. The contractor, in the proper sequence, shall provide proper shoring and bracing as may be required to achieve the final completed structure.
 * These plans have been engineered for construction at one specific building site. Builder assumes ALL responsibility for use of these plans at Any Other building site. Plans shall not be used for construction at any other building site without specific review by the engineer.
 * Observations of foundation reinforcing or framing required by the owner, lender, insurer, building department or any other party will be accomplished by the engineer at the owner's expense. At least 24 hours advance notice is requested.
 * All slabs on grade shall be separated from adjacent structural and finish elements to allow free movement of the slab, unless specifically shown and noted otherwise.

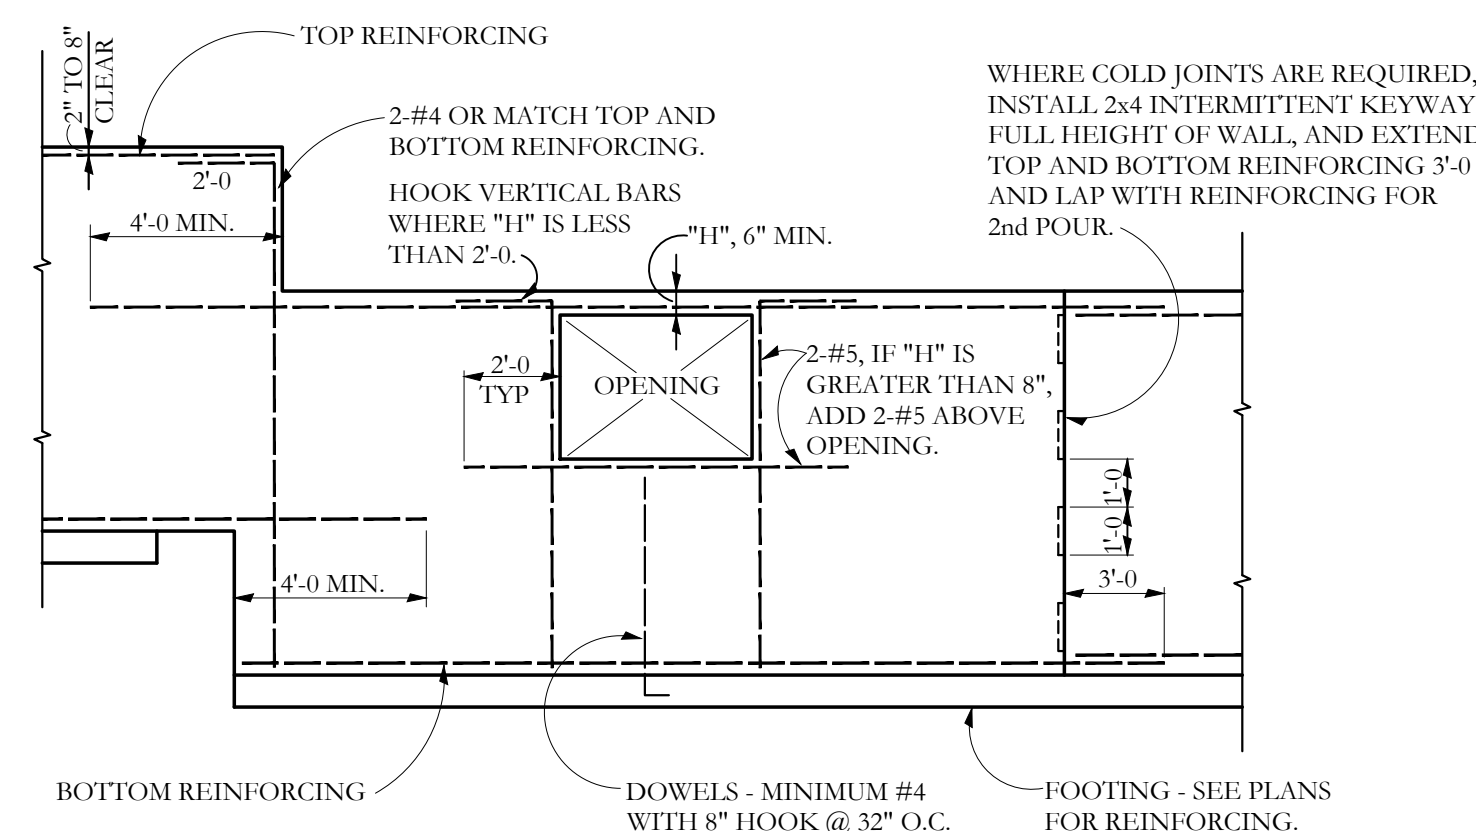

TYPICAL REINFORCING AT STEPS AND OPENINGS
NO SCALE

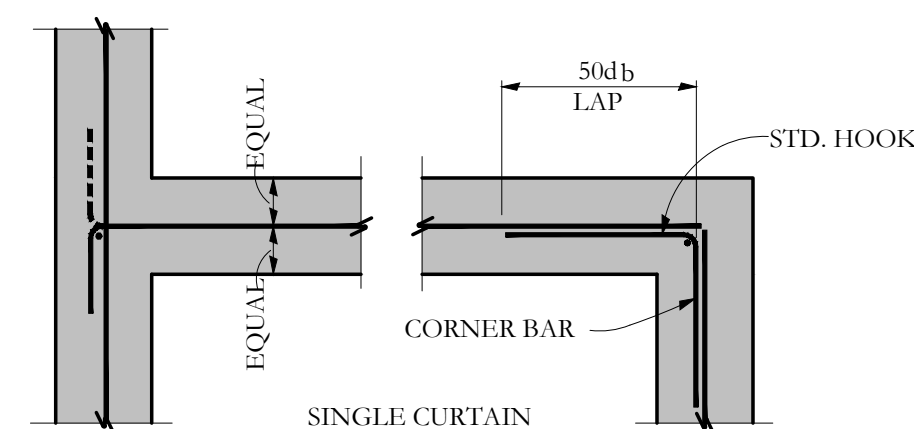


TYPICAL CONCRETE WALL INTERSECTIONS

ABBREVIATIONS KEY

AB	Anchor Rod (Bolt)	EF	Each Face	MACH	Machine	SC	Slip Critical
ADDL	Additional	EJ	Expansion Joint	MASY	Masonry	SCH	Schedule
ADJ	Adjustable	ELEV	Elevation	MATL	Material	SDST	Self Drilling Self Tapping
AFB	Above Finished Floor	ELEC	Electric (Electrical)	MAX	Maximum	SECT	Section
ALT	Alternate	ENGR	Engineer	MB	Machine bolt	SF	Square Feet
AMT	Amount	EQ	Equal	MECH	Mechanical	SHT	Sheet
ANCH	Anchor, Anchorage	EQUIP	Equipment	MEZZ	Mezzanine	SHTG	Sheathing
APPROX	Approximate	EQUIV	Equivalent	MFR	Manufacture, -er, -ed	SIM	Similar
ARCH	Architect, -ural	ES	Each Side	MIN	Minimum	SLH	Short Leg Horizontal
ATR	All Thread Rod	EST	Estimate	ML	Microlam (Trus-joist brand LVL)	SLV	Short Leg Vertical
AVG	Average	E-W	East to West	MO	Masonry Opening	SOG	Slab on Grade
BC	Bottom of Concrete	EXC	Excavate	MTL	Metal	SP	Spaces
BL	Brick Ledge	EXP	Expansion	NF	Near Face	SPEC	Specifications
BLK	Block	EXT	Exterior	NIC	Not In Contract	SQ	Square
BLKG	Blocking	FND	Foundation	NS	Near Side	ST	Snug Tight
BM	Beam	FF	Far Face, Finished Floor	NTS	North to South	STD	Standard
BOT	Bottom	F-F	Face to Face	OCJ	OSHA Column Joist	STIFF	Stiffener
BRG	Bearing	FIG	Figure	OD	Outside Diameter	STL	Steel
BW	Bottom of Wall	FL	Flush	OF	Outside Face	STRUCT	Structure, -al
CB	Counterbore	FLG	Flange	OH	Opposite Hand	SUPT	Support
CF	Cubic Foot	FLR	Floor	OPNG	Opening	SY	Square Yard
CG	Center of Gravity	FO	Face of	OPP	Opposite	SYM	Symmetrical
CIP	Cast in Place	FP	Full Penetration	OSB	Oriented Strand Board	T&B	Top and Bottom
CJ	Construction Joint (Control Joint)	FS	Far Side	PAF	Powder Actuated Fastener	T&G	Tongue and Groove
CLG	Ceiling	FTG	Footing	PC	Precast	TB	Top of Beam
CLR	Clear	GA	Gage (Gauge)	PCF	Pounds Per Cubic Foot	TC	Top of Concrete
CM	Construction Manager (Management)	GALV	Galvanized	PC	Precast	TD	Top of Deck
CMU	Concrete Masonry Unit	GC	General Contractor	PCF	Pounds Per Cubic Foot	THD	Thread
COL	Column	GEN	General	PERP	Perpendicular	THK	Thick, -ness
COM	Common	GL	Glue laminated (Glulam)	PI	Property Line	TJ	Top of Joist
COMB	Combination	GND	Ground	PL	Property Line	TL	Total Lead
CONC	Concrete	GR	Grade	PLF	Pounds per Linear Foot	TPG	Topping
CONN	Connection	GT	Girder/Truss	PSL	Panel	TRANS	Transverse
CONT	Continue (Continuous)	GYP/BD	Gypsum Board	PP	Panel Point	TW	Top of Wall
COORD	Coordinate, -tion	HAS	Headed Anchor Stud	PS	Prestressed	TYP	Typical
CS	Countersink	HORIZ	Horizontal	PSF	Pounds per Square Foot	ULT	Ultimate
CTR	Center	HT	Height	PSI	Pounds per Square Inch (generic term)	UNO	Unless Noted Otherwise
CY	Cubic Yard	ID	Inside Diameter	PSL	Parallel Strand Lumber (generic term)	VERT	Vertical
DAB	Deformed Anchor Bar	IF	Inside Face	PT (1)	Post Tensioned	VIF	Verify in Field
DET	Detail	INT	Interior (Intermediate)	PT (2)	Pressure Treated	WA	Wedge Anchor
DEV	Develop	JB	Joist Bearing	PTN	Partition	WP	Work Point
DIA	Diagonal	JST	Joist	PWD	Plywood	WT	Weight
DIM	Dimension	JT	Joint	QTY	Quantity	WWF	Welded Wire Fabric
DL	Dead Load	K	Kip (1,000 lbs.)	R	Radius	XS	Extra Strong
DN	Down	LD	Load	REF	Reference (refer to)	XSECT	Cross-section
DP	Drilled Pier	LL	Live Load	REFCT	Rectangle	XXS	Double Extra Strong
DT	Double Tee	LLH	Long Leg Horizontal	REINFC	Reinforce, -ed, -ing	(E)	Existing
DWG	Drawing	LLV	Long Leg Vertical	REQ	Required	(N)	New
DWL	Dowel	LOC	Location	REQMT	Requirement	(R)	Remove
EA	Each	LSL	Laminated Strand Lumber (generic term)	RET	Retaining		
ECC	Eccentric	LT	Light	RM	Room		
E-E	End to End	LVL	Laminated Veneer Lumber (generic term)	RMO	Rough Masonry Opening		
				RO	Rough Opening		

Structural Drawing Index

S1-0	General Notes, Etc.
S1-1	Foundation Plan
S1-2	Roof Framing Plan
S2-1	Sections

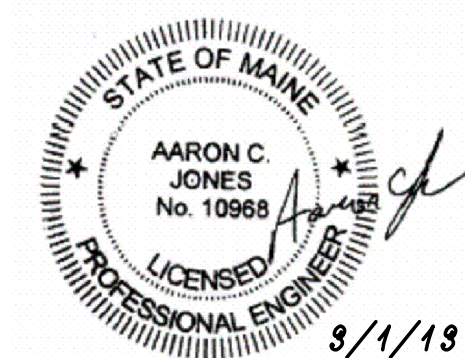

77 Oak Street
Portland, ME 04101
p. 207-774-4614
f. 866-793-7835
www.structuralintegrity.com

BUILD WITH CONFIDENCE
© 2013 Structural Integrity Consulting Engineers, Inc.



PROJECT NO.
12019
PROJECT NAME
**GMS, WESTMINSTER HOME
PORTLAND, ME**

CONSTRUCTION DOCUMENTS
GENERAL NOTES

DRAWN BY
MKL
SHEET TITLE
GENERAL NOTES

ISSUE DATE
03.01.13
SHEET SCALE
SCALE

S1-0