


Job 061912	Truss T03	Truss Type COMMON	Qty 4	Ply 1	LAVENDIER DORMER FOR 060876
---------------	--------------	----------------------	----------	----------	-----------------------------

Mainely Trusses, Inc., Fairfield, ME, JASON MARCHAND

8.100 s Jan 17 2017 MiTek Industries, Inc. Wed Dec 06 11:13:56 2017 Page 1

ID:ktRAUbx3WC_8nRHUFFzjo8yKHBz-RTqki3o1ca3e9lsgWcp5xC7wsggor8f_ITGE7dyBjGv



Scale = 1:18.2

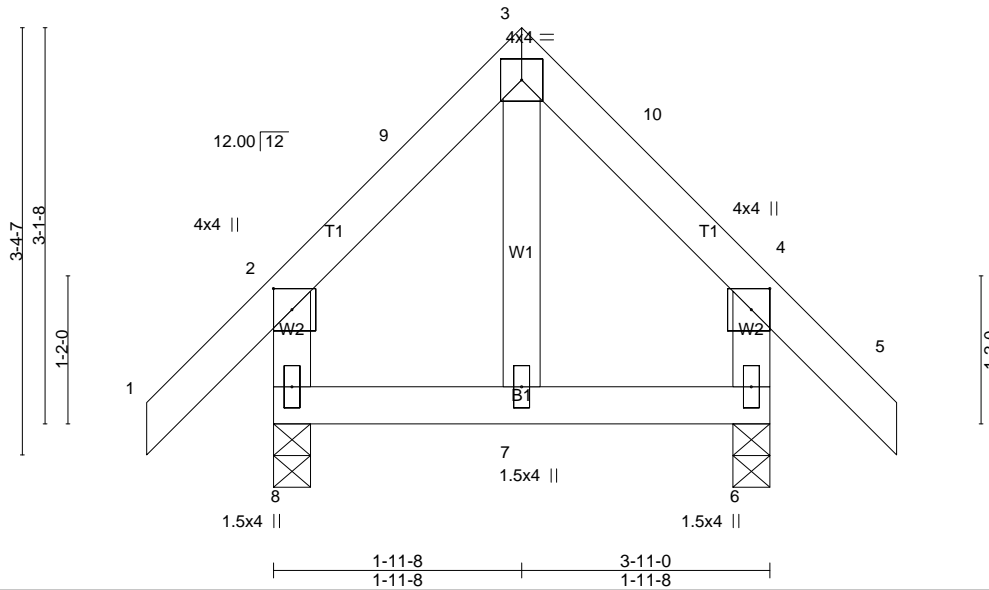


Plate Offsets (X,Y)-- [2:0-2-0,0-1-12], [4:0-2-0,0-1-12]

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 35.6 (Ground Snow=60.0) TCDL 7.0 BCLL 0.0 BCDL 10.0	2-0-0 Plate Grip DOL 1.15 Lumber DOL 1.15 Rep Stress Incr YES Code IRC2009/TPI2007	TC 0.12 BC 0.07 WB 0.01 Matrix-R	in (loc) l/defl L/d Vert(LL) -0.00 7 >999 240 Vert(TL) -0.00 7 >999 180 Horz(TL) 0.00 6 n/a n/a	MT20	197/144
				Weight: 19 lb	FT = 20%

LUMBER-
TOP CHORD 2x4 SPF No.2
BOT CHORD 2x4 SPF No.2
WEBS 2x4 SPF No.2

BRACING-
TOP CHORD Structural wood sheathing directly applied or 3-11-0 oc purlins, except end verticals.
BOT CHORD Rigid ceiling directly applied or 6-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 8=288/0-3-8 (min. 0-1-8), 6=288/0-3-8 (min. 0-1-8)
Max Horz 8=131(LC 6)
Max Uplift 8=110(LC 7), 6=110(LC 8)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-05; 100mph; TCDL=4.2psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone; cantilever left and right exposed; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) TCLL: ASCE 7-05; Pg=60.0 psf (ground snow); Ps=35.6 psf (roof snow); Category II; Exp C; Partially Exp.; Ct=1.1
 - 3) Roof design snow load has been reduced to account for slope.
 - 4) Unbalanced snow loads have been considered for this design.
 - 5) This truss has been designed for greater of min roof live load of 12.0 psf or 1.00 times flat roof load of 46.2 psf on overhangs non-concurrent with other live loads.
 - 6) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 7) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) except (jt=lb) 8=110, 6=110.
 - 8) This truss is designed in accordance with the 2009 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.


LOAD CASE(S) Standard

Job 061912	Truss V05	Truss Type VALLEY	Qty 1	Ply 1	LAVENDIER DORMER FOR 060876
---------------	--------------	----------------------	----------	----------	-----------------------------


Mainely Trusses, Inc., Fairfield, ME, JASON MARCHAND

8.100 s Jan 17 2017 MiTek Industries, Inc. Wed Dec 06 11:13:56 2017 Page 1

ID:ktRAUbx3WC_8nRHUFFzjo8yKHBz-RTqki3o1ca3e9lsgWcp5xC7wYsh8r8X_ITGE7dyBjGv



Scale = 1:18.9

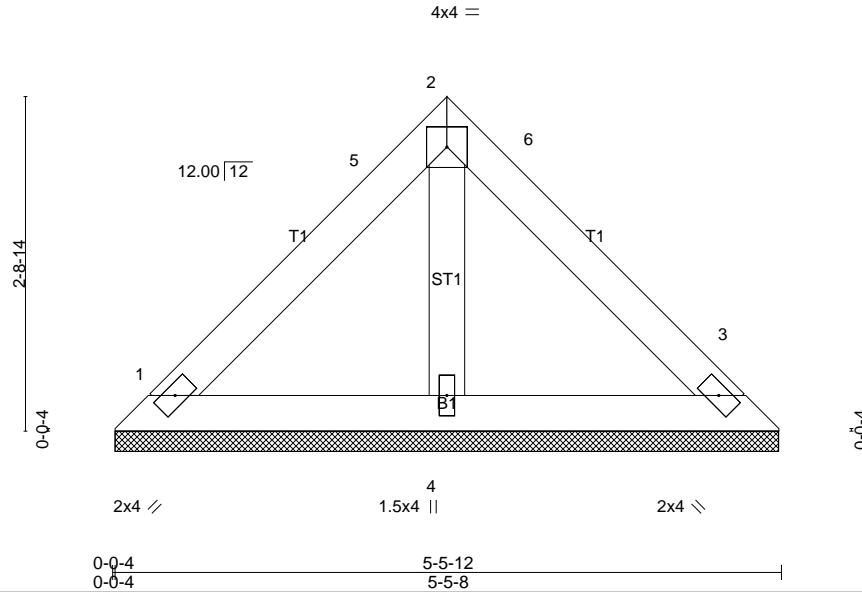

LOADING (psf)	SPACING-	CSI.	DEFL.	PLATES	GRIP
TCLL 35.6 (Ground Snow=60.0)	2-0-0	TC 0.12	in (loc) l/defl L/d	MT20	197/144
TCDL 7.0	Plate Grip DOL 1.15	BC 0.05	Vert(LL) n/a - n/a 999		
BCLL 0.0	Lumber DOL 1.15	WB 0.02	Vert(TL) n/a - n/a 999		
BCDL 10.0	Rep Stress Incr YES	Matrix-P	Horz(TL) 0.00 3 n/a n/a		
	Code IRC2009/TPI2007			Weight: 16 lb	FT = 20%

LUMBER-
 TOP CHORD 2x4 SPF No.2
 BOT CHORD 2x4 SPF No.2
 OTHERS 2x4 SPF No.2

BRACING-
 TOP CHORD
 BOT CHORD

Structural wood sheathing directly applied or 5-5-12 oc purlins.
 Rigid ceiling directly applied or 10-0-0 oc bracing.

MiTek recommends that Stabilizers and required cross bracing be installed during truss erection, in accordance with Stabilizer Installation guide.

REACTIONS. (lb/size) 1=154/5-5-4 (min. 0-1-8), 3=154/5-5-4 (min. 0-1-8), 4=193/5-5-4 (min. 0-1-8)
 Max Horz 1=-92(LC 5)
 Max Uplift 1=-58(LC 8), 3=-58(LC 8), 4=-8(LC 7)

FORCES. (lb) - Max. Comp./Max. Ten. - All forces 250 (lb) or less except when shown.

- NOTES-**
- 1) Wind: ASCE 7-05; 100mph; TCDL=4.2psf; BCDL=6.0psf; h=25ft; Cat. II; Exp C; enclosed; MWFRS (low-rise) gable end zone; cantilever left and right exposed ; end vertical left and right exposed; Lumber DOL=1.60 plate grip DOL=1.60
 - 2) TCLL: ASCE 7-05; Pg=60.0 psf (ground snow); Ps=35.6 psf (roof snow); Category II; Exp C; Partially Exp.; Ct=1.1
 - 3) Roof design snow load has been reduced to account for slope.
 - 4) Unbalanced snow loads have been considered for this design.
 - 5) This truss has been designed for a 10.0 psf bottom chord live load nonconcurrent with any other live loads.
 - 6) Provide mechanical connection (by others) of truss to bearing plate capable of withstanding 100 lb uplift at joint(s) 1, 3, 4.
 - 7) Non Standard bearing condition. Review required.
 - 8) This truss is designed in accordance with the 2009 International Residential Code sections R502.11.1 and R802.10.2 and referenced standard ANSI/TPI 1.

LOAD CASE(S) Standard