
ASPHALT ROOF SHINGLES TO MATCH EXISTING ON ROOFTOPGUARD 2 OR OTHER APPROVED ROOFING UNDERLAYMENT ON 5%" OSB ROOF SHEATHING ON 2X10 SPF RAFTERS 24" O.C. WITH MIN. R-49 CLOSED CELL SPRAY FOAM CAVITY INSULATION OR
R-36 CLOSED CELL SPRAY FOAM AGAINST UNDERSIDE OF ROOF SHEATHING WITH R-13 BATT INSULATION ON INTERIOR SIDE NO POLY VAPOR RETARDER NO ROOF VENTING
$ m \frac{1}{2}$ " DRYWALL WITH LATEX PAINT FOR CLASS 3 VAPOR RETARDER $-$
(1) SIMPSON H2.5 HURRICANE CLIP AT EVERY RAFTER TO PLATE CONNECTION —
R+R RED CEDAR SHINGLE SIDING ON BENJAMIN OBDYKE HOMESLICKER DRAIN SCREEN ON
TYPAR OR OTHER APPROVED HOUSEWRAP WITH
ALL SEAMS SHINGLE-LAPPED AND TAPED ON 7/16" OSB SHEATHING ON
2X6 STUDS 16" O.C. WITH
R-21 CAVITY INSULATION NO POLY AT INTERIOR
$\frac{1}{2}$ " DRYWALL WITH LATEX PAINT FOR CLASS 3 VAPOR RETARDER
1X6 T+G CEILING BOARDS ON
<sup>3</sup> / <sub>4</sub> " STRAPPING
2X8 JOISTS 16" O.C. WITH 3" CLOSED CELL SPRAY FOAM (R-18) AGAINST BOTTOM OF FLOOR SHEATHING WITH
R-13 FIBERGLASS BATTS BELOW
FOR TOTAL R-31 FLOOR CAVITY INSULATION WITH
3/4" ADVANTECH SUBFLOOR ABOVE AND 3/4" FINISH FLOOR ON 2ND FLOOR —

SIMPSON STB2-504346SS  $\frac{1}{2}$ " X 4  $\frac{3}{4}$ " STAINLESS STEEL ANCHORS STAGGERED 8" O.C. AT ALL SIDES OF ENTRY DECK

4"Ø FOUNDATION DRAIN PROTECTED WITH LANDSCAPE FABRIC OR SLEEVE WELL-DRAINING BACKFILL (SAND, 2" STONE OR EQUIVALENT) 4" CLAY SURFACE AT GRADE





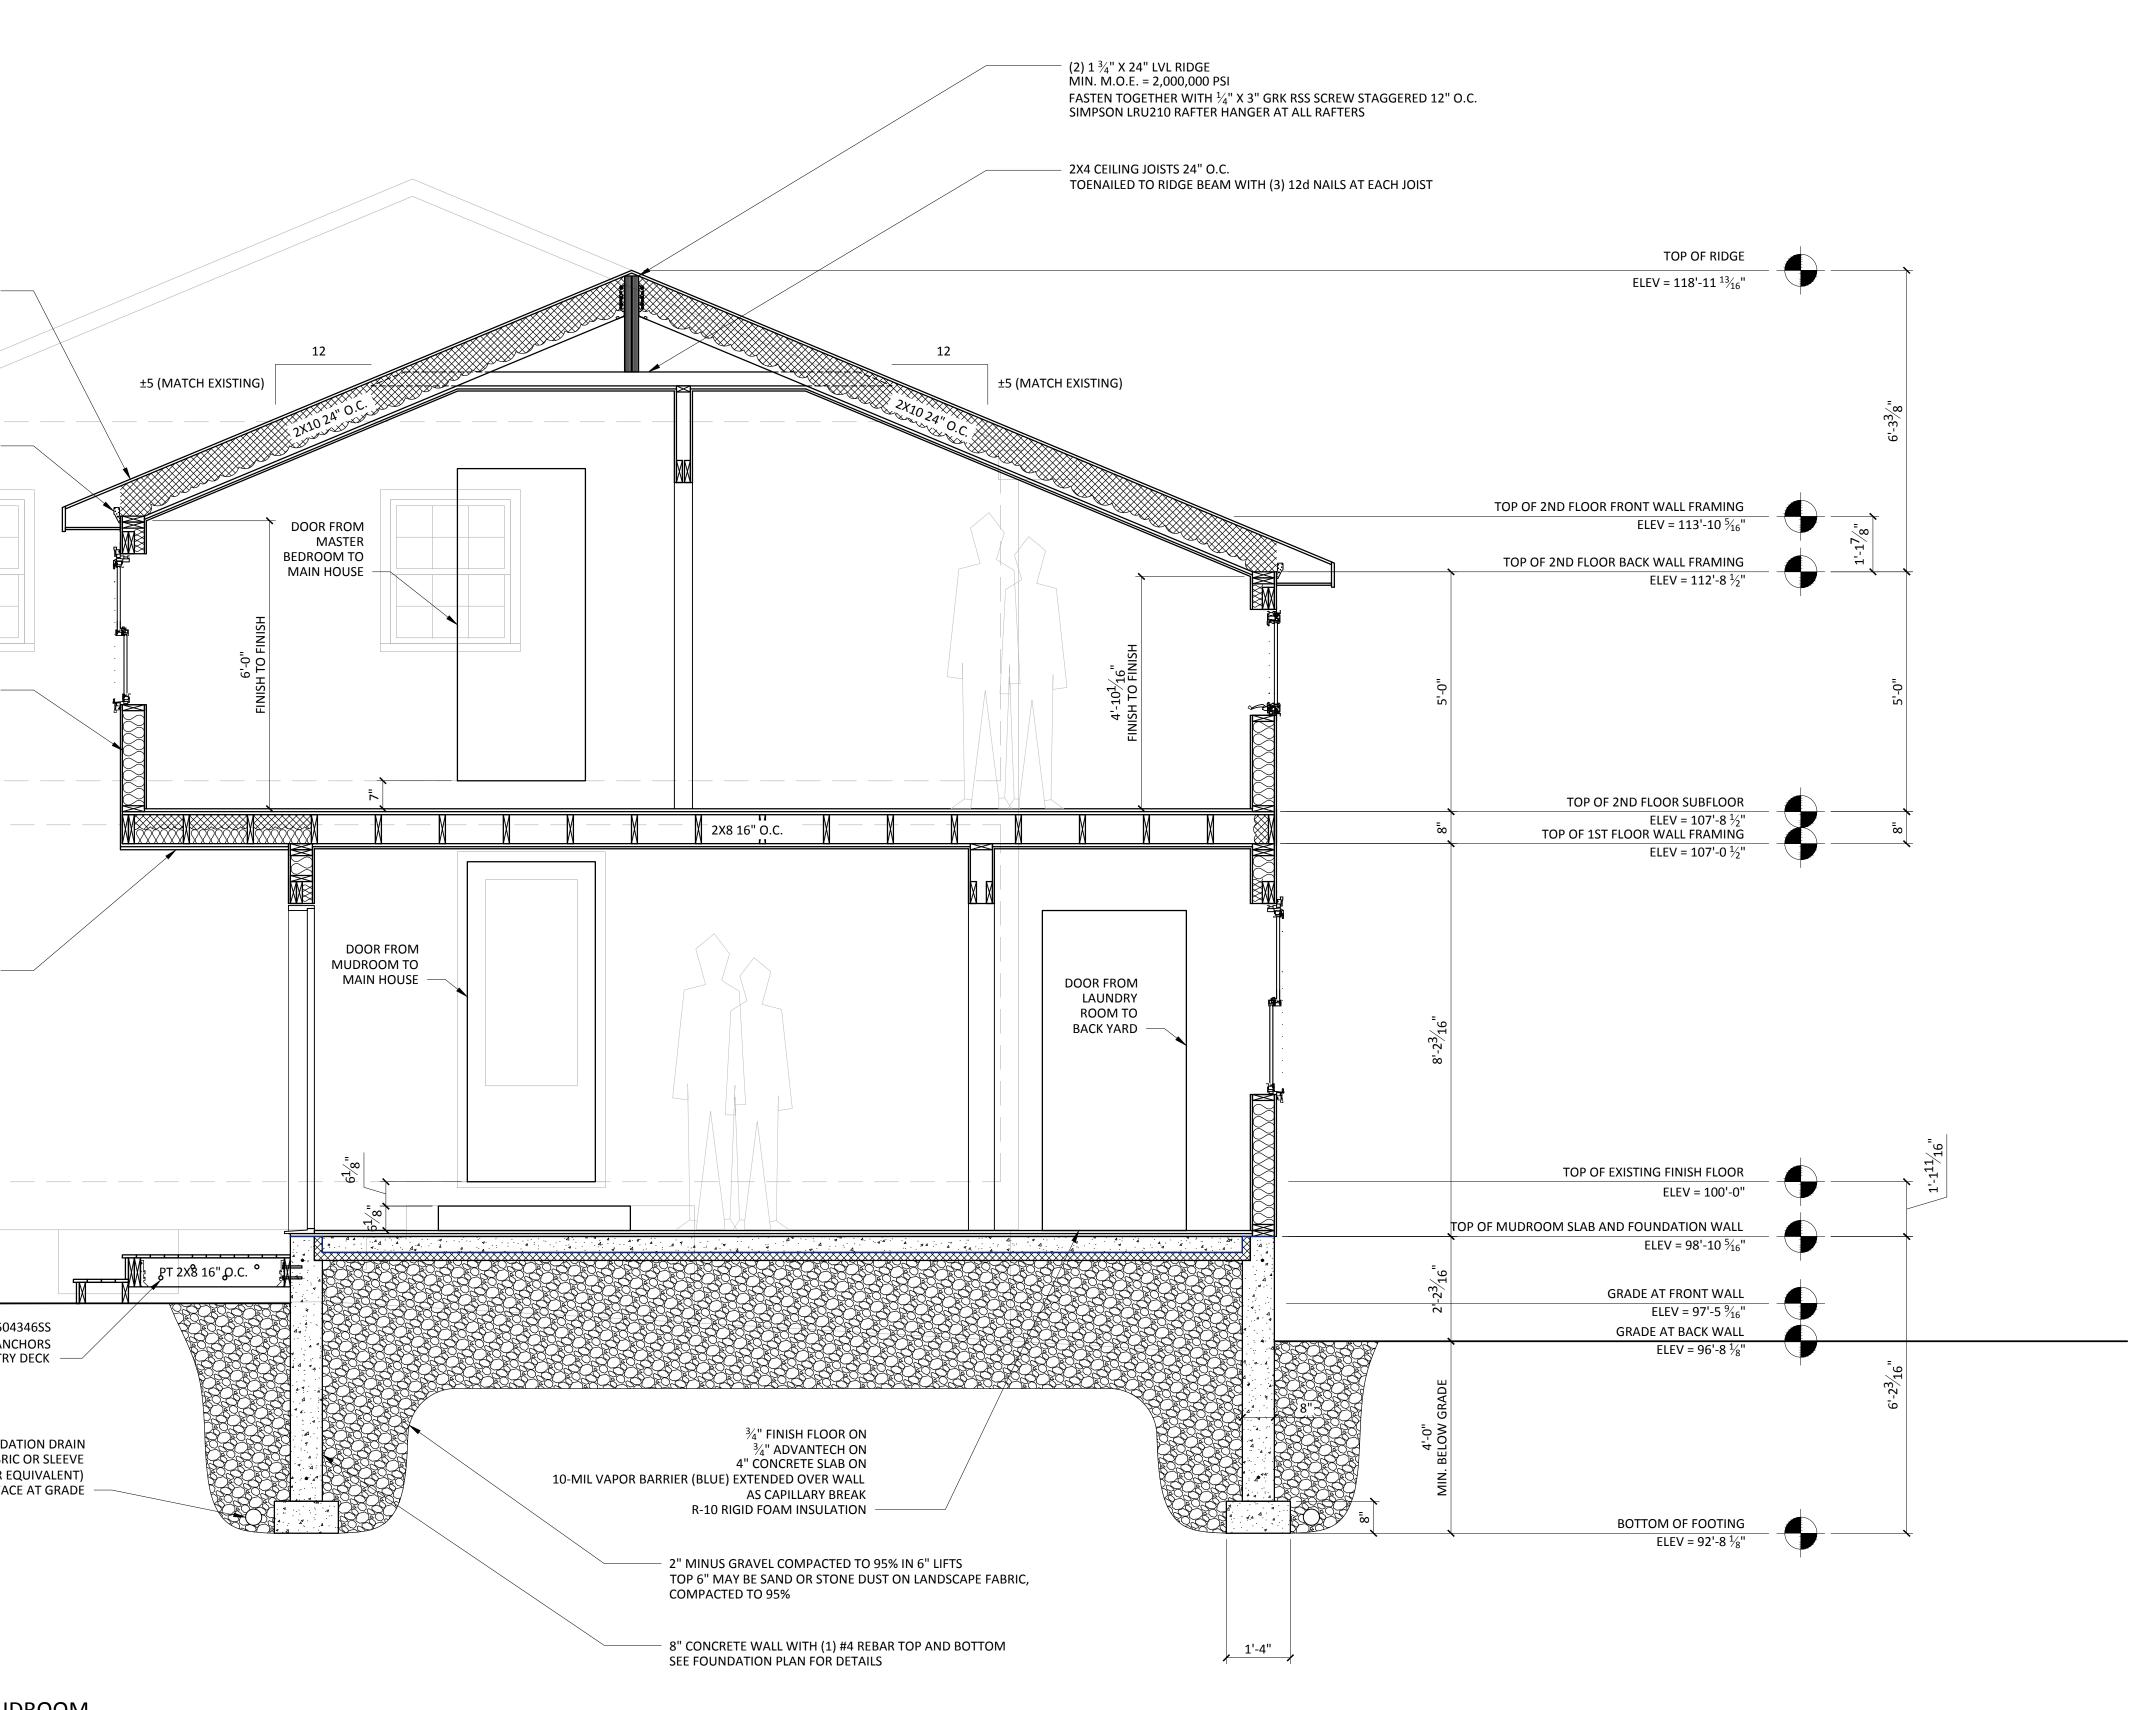

336 N PALERMO RD PALERMO, ME 04354 207-318-6224 mike@michaelmaines.com	ADDITION TO THE	ISSUED FOR CONSTRUCTION	DATE November 10, 2015	SHEET
	CAMPOS RESIDENCE		REV	A3-01
	72 GROVESIDE ROAD, PORTLAND, MAINE 04102		REV	

## 0 1' 2' 4'