

Air Source Heat Pump Locations



142 Presumpscot Street
Portland, ME 04103
(207) 221-6342

Project Information

Lois Winter
50 Alden Circle
Portland, ME 04102


System Type:

Air Source Heat Pump

Drawing Name:

Site Map

Page:	1 of 1
Drawn By:	L. Brostek
Date:	February 26, 2016
Rev. Number:	0

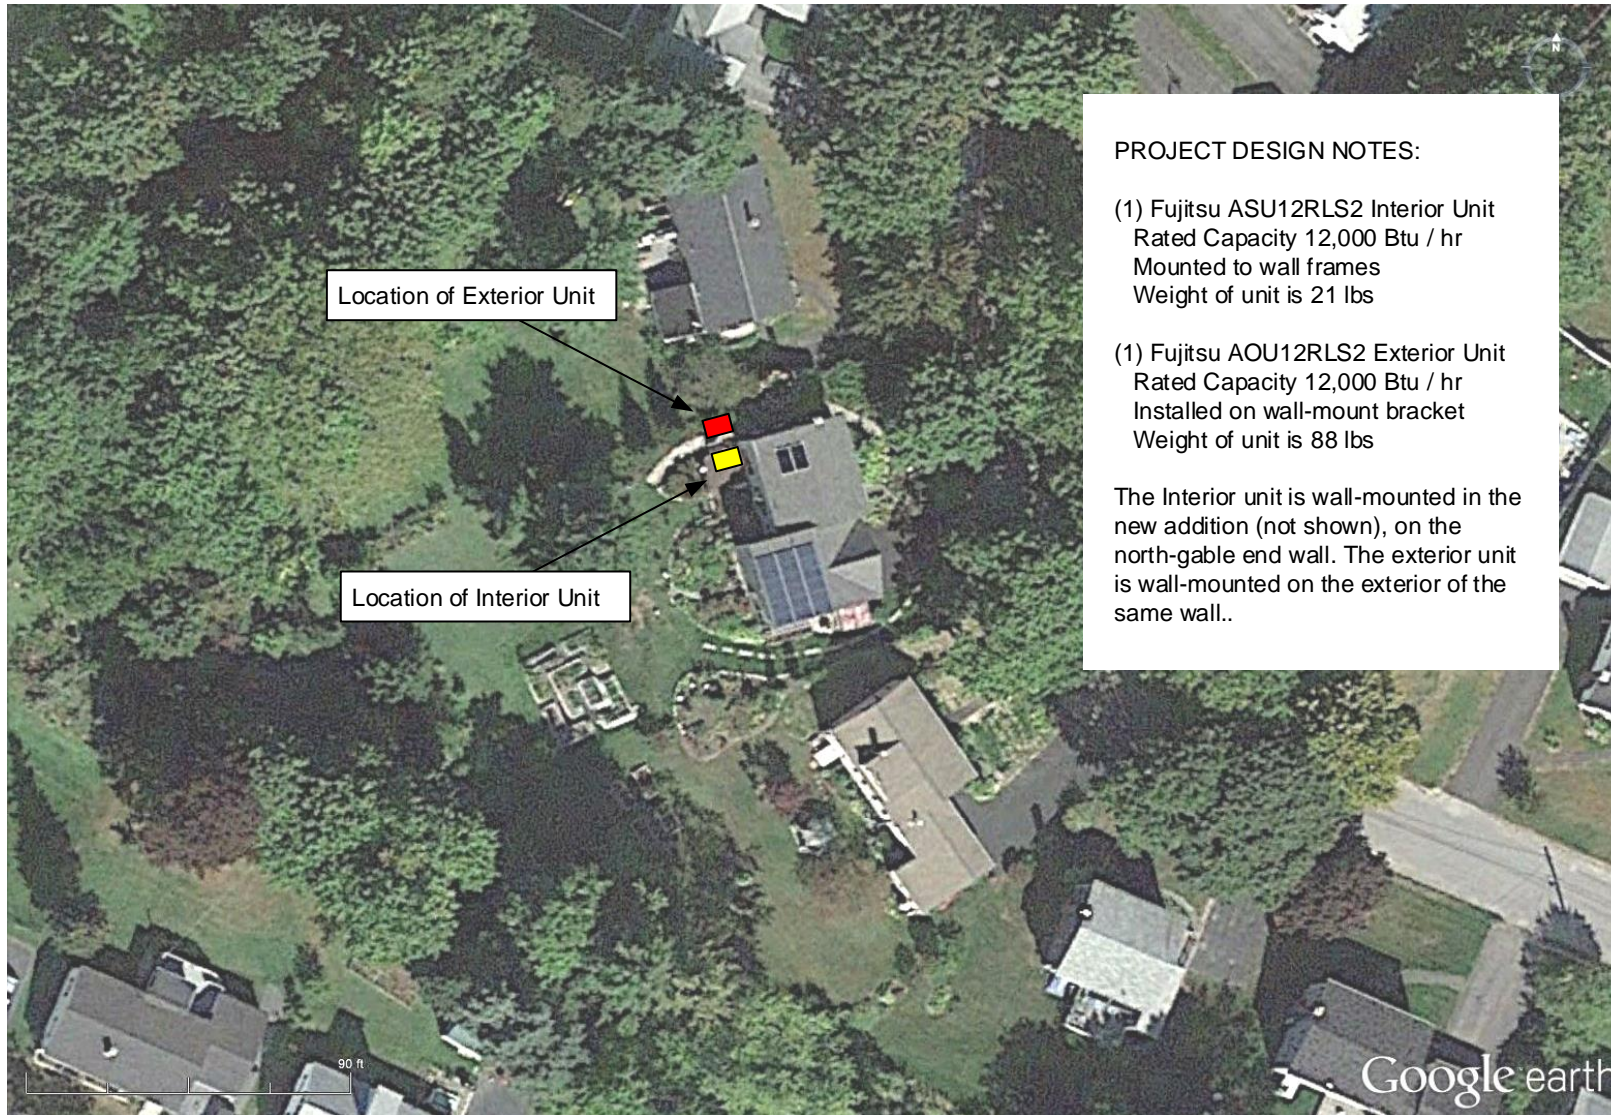

PROJECT DESIGN NOTES:

- (1) Fujitsu ASU12RLS2 Interior Unit
Rated Capacity 12,000 Btu / hr
Mounted to wall frames
Weight of unit is 21 lbs
- (1) Fujitsu AOU12RLS2 Exterior Unit
Rated Capacity 12,000 Btu / hr
Installed on wall-mount bracket
Weight of unit is 88 lbs

The Interior unit is wall-mounted in the new addition (not shown), on the north-gable end wall. The exterior unit is wall-mounted on the exterior of the same wall..

Note: Home is built of traditional wood framing and is sufficient to support the additional load of the equipment being installed.

© Copyright ReVision Energy

This diagram is provided as a service and is based on the understanding of the information supplied. It is subject to change based on actual conditions, applicable edition of the National Electric Code, and local governmental authorities.