




### 3. GENERAL BOILER INFORMATION SERVICE CLEARANCES

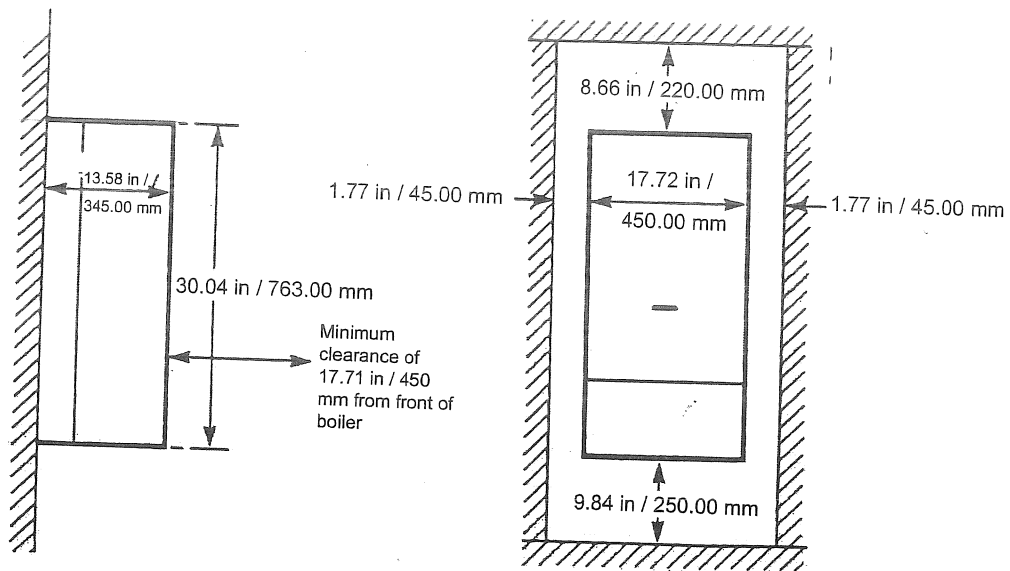

#### CLEARANCES REQUIRED FOR CLOSET INSTALLATION

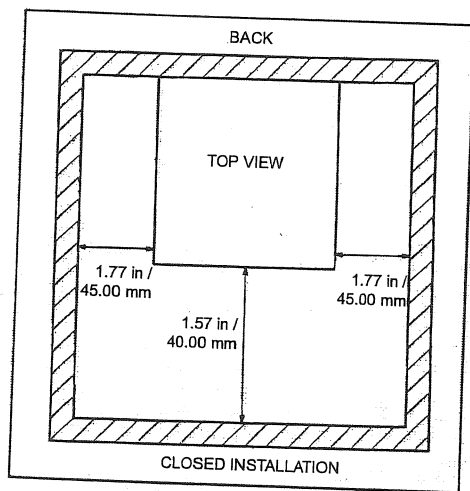

#### CLEARANCES FOR COMBUSTIBLES

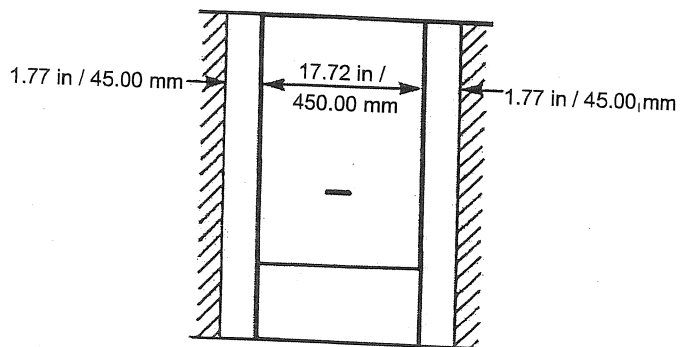

0 in / 0 mm between the Back of the Unit and the wall

**Note:**

It is recommended that service clearances are considered when locating a suitable area for the unit.

### WARNING

- The boiler must not be installed on carpeting.
- Keep boiler area clear and free from flammable vapors and liquid.

INSTALLER Section (en)