

REVISION	DESCRIPTION	DATE
0	ISSUED FOR REVIEW & APPROVAL	9/30/2013

CUNNINGHAM

Security Systems

10 Princes Point Road, Yarmouth, Maine 04096
Office: 207.846.3350 • Fax: 207.846.6080

SHALOM HOUSE

503 WOODFORD STREET

PORTLAND, MAINE 04103

SECOND FLOOR FIRE ALARM PLAN

DRAWN	JPB	UNICAD JOB #13531
CHECKED	WAYNE B. HAWES	
DATE	NCET IV 90496	

REVISION	SCALE	Date: 11/05/13


F

UNICAD inc.

5794 W. 40TH St.
Portland, ME 04106
Office: 207.585.5410
www.unicad.net

Fire Alarm Design & Drafting Services

RESERVED FOR CITY STAMP

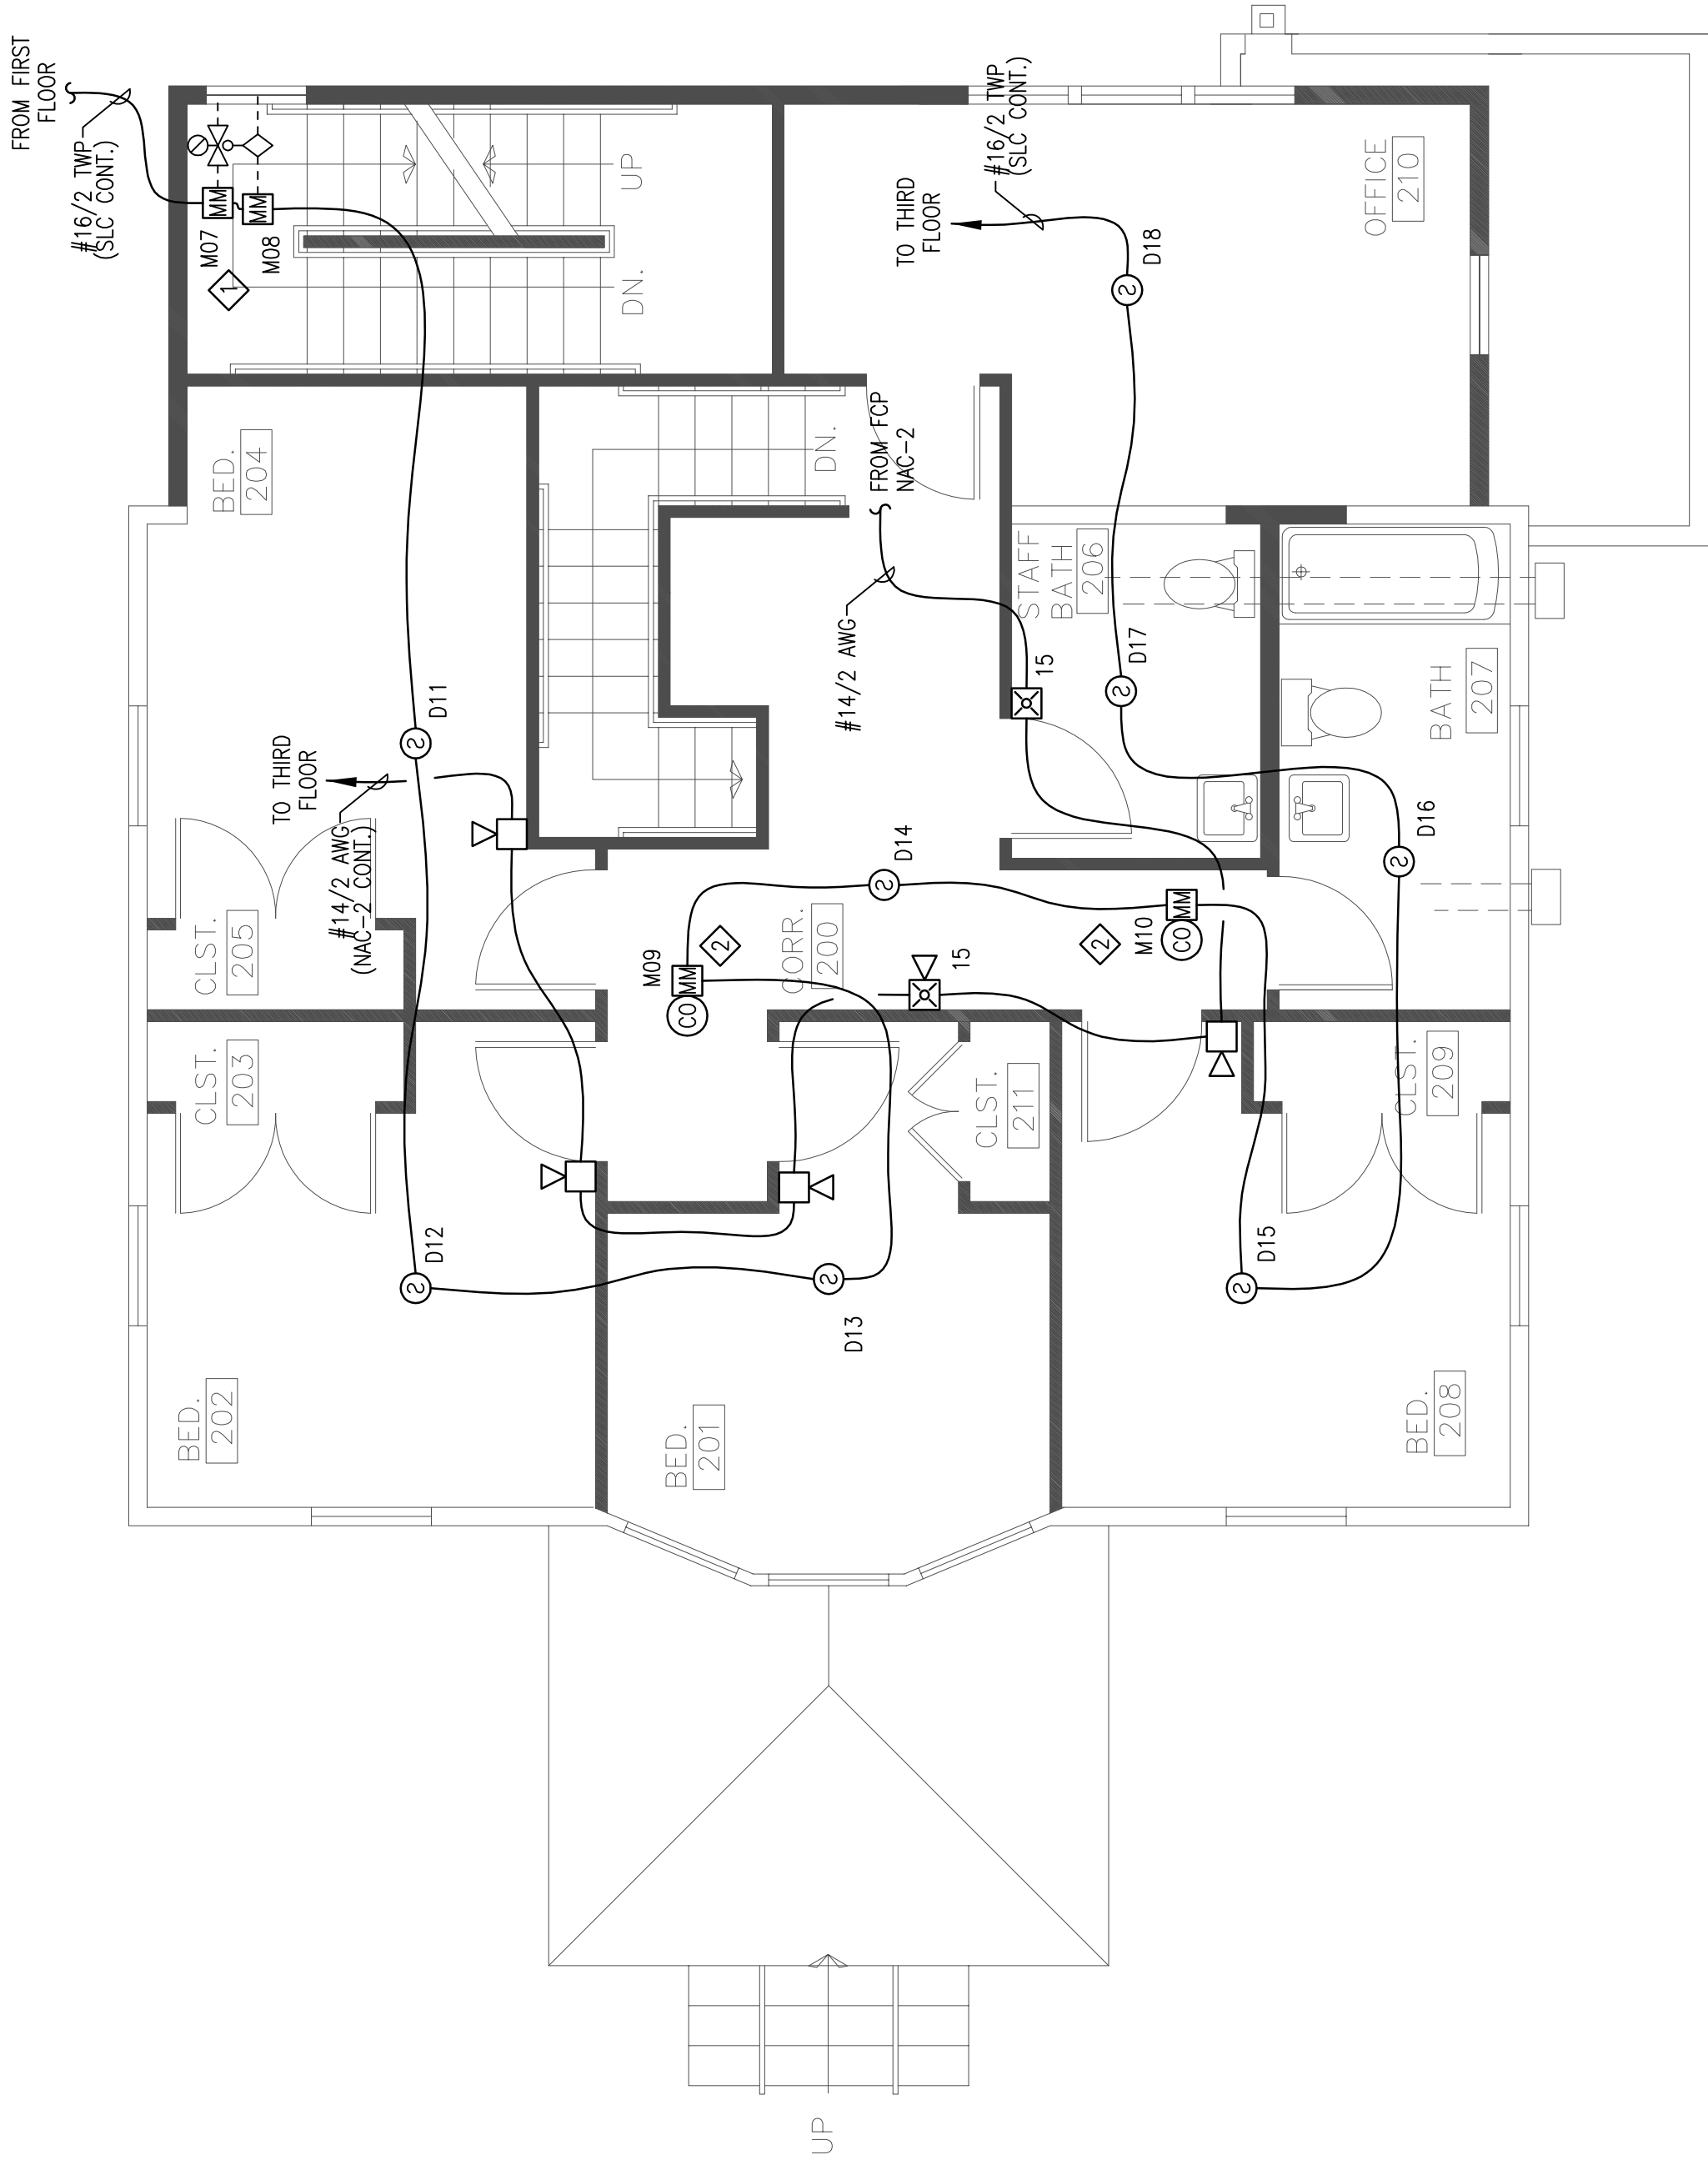

SECOND FLOOR FIRE ALARM PLAN

SCALE: 1/4"=1'-0"

SHEET NOTES:

- ADDRESSABLE MONITOR MODULE(S) PROVIDED TO MONITOR ALL WATER FLOW, PRESSURE SWITCHES, TAMPER SWITCHES AND POST INDICATING VALVES ASSOCIATED WITH THE FIRE SPRINKLER SYSTEM. INSTALLING CONTRACTOR SHALL FIELD VERIFY EXACT MOUNTING, CIRCUITING AND PROGRAMMING REQUIREMENTS. FIELD VERIFY EXACT QUANTITY AND LOCATION(S).
- ADDRESSABLE MONITOR MODULE(S) PROVIDED TO MONITOR CARBON MONOXIDE DETECTOR. INSTALLING CONTRACTOR SHALL FIELD VERIFY EXACT MOUNTING, CIRCUITING AND PROGRAMMING REQUIREMENTS. FIELD VERIFY EXACT QUANTITY AND LOCATION(S).