

REVISION	DESCRIPTION	DATE
0	ISSUED FOR REVIEW & APPROVAL	9/30/2013

CUNNINGHAM

Security Systems

10 Princes Point Road, Yarmouth, Maine 04096
Office: 207.846.3350 • Fax: 207.846.6080

SHALOM HOUSE
503 WOODFORD STREET
PORTLAND, MAINE 04103
THIRD FLOOR FIRE ALARM PLAN


DRAWN	JPB	UNICAD JOB #13531
CHECKED	WAYNE B. HAWES	
DATE	NICET IV 90496	
REVISION	9/30/2013	
SCALE		

Date: 11/05/13	
F	

UNICAD inc.

5794 NW 40th St.
Fort Lauderdale, FL 33309
Office: 954.585.0410
www.unicad.net

Fire Alarm Design & Drafting Services

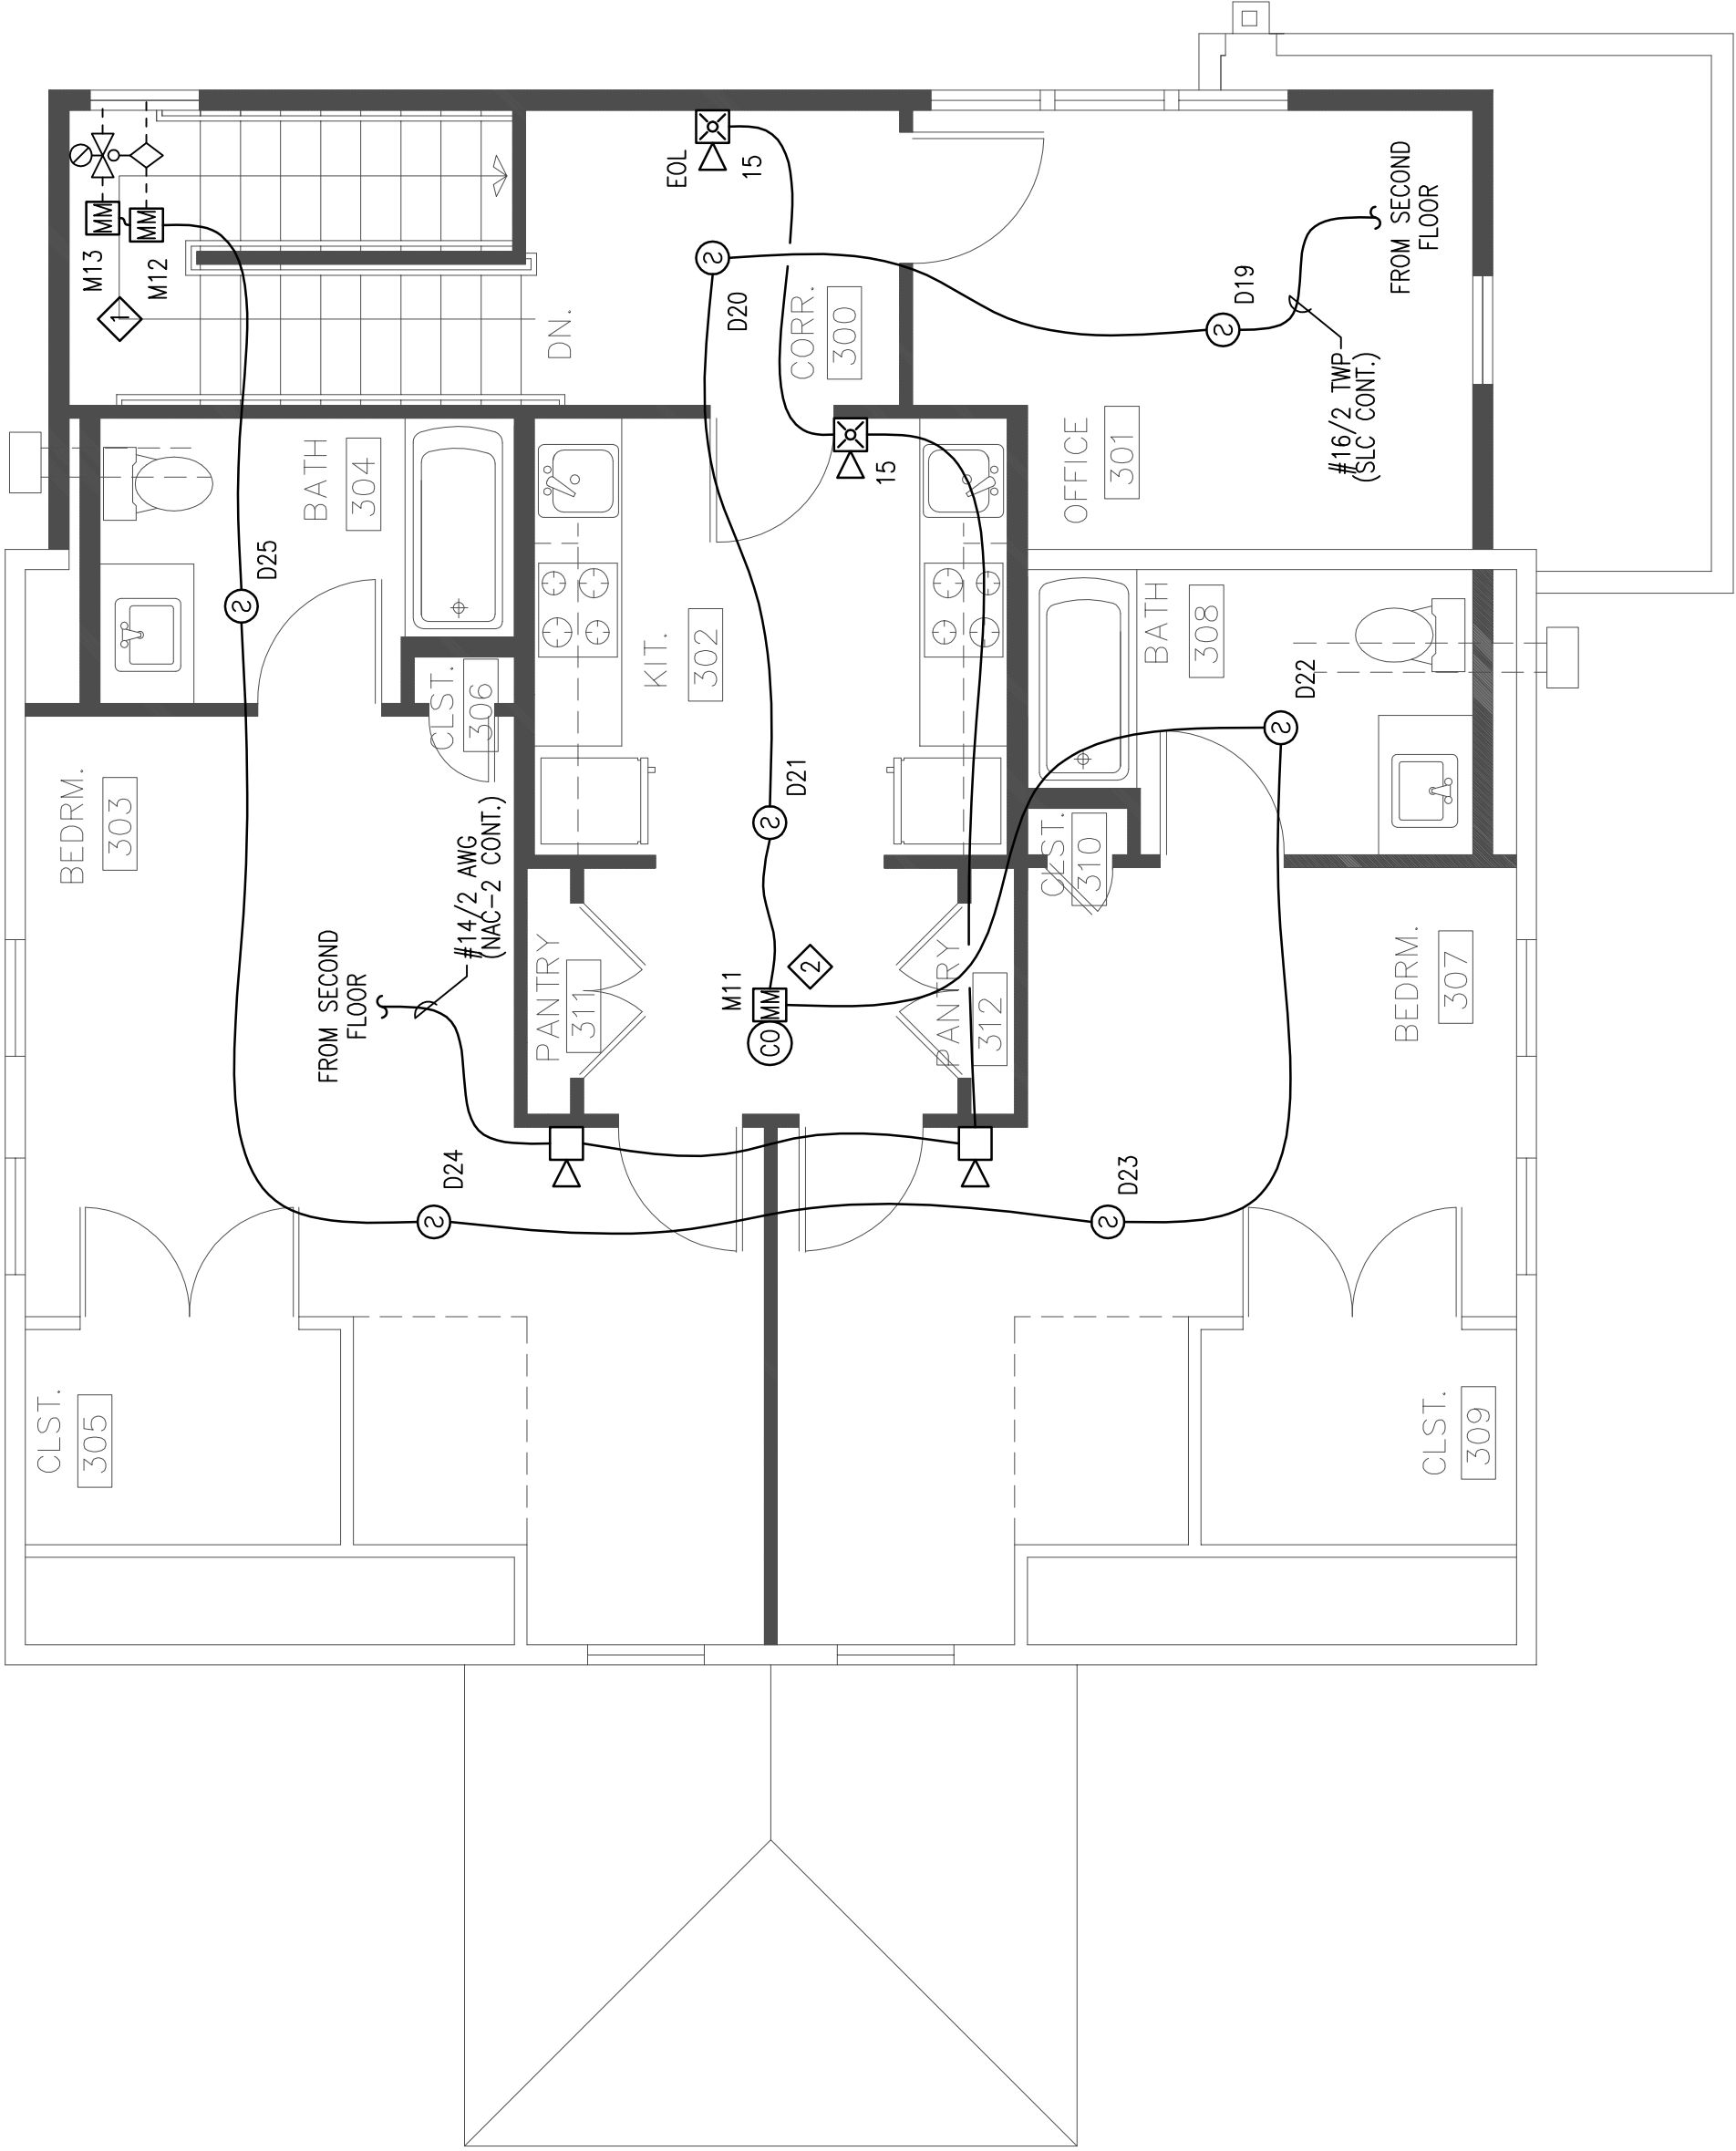

THIRD FLOOR FIRE ALARM PLAN
SCALE: 1/4"=1'-0"

SHEET NOTES:

- ◇ ADDRESSABLE MONITOR MODULE(S) PROVIDED TO MONITOR ALL WATER FLOW, PRESSURE SWITCHES, TAMPER SWITCHES AND POST INDICATING VALVES. ASSOCIATED WITH THE FIRE SINKLER SYSTEM. INSTALLING CONTRACTOR SHALL FIELD VERIFY EXACT MOUNTING, CIRCUITING AND PROGRAMMING REQUIREMENTS. FIELD VERIFY EXACT QUANTITY AND LOCATION(S).
- ◇ ADDRESSABLE MONITOR MODULE(S) PROVIDED TO MONITOR CARBON MONOXIDE DETECTOR. INSTALLING CONTRACTOR SHALL FIELD VERIFY EXACT MOUNTING, CIRCUITING AND PROGRAMMING REQUIREMENTS. FIELD VERIFY EXACT QUANTITY AND LOCATION(S).

RESERVED FOR CITY STAMP