


01 20,000 GAL TANK ELEVATION - 12,000 GAL REGULAR / 8,000 PREMIUM  
SCALE: 1/2" = 1'-0"

CONTRACTOR TO POINT CHAMFER AWAY FROM OTHER TANK EQUIPMENT

NOTE #1 - ALL GALVANIZED IRON PIPE RISERS IN CONTACT WITH BACKFILL SHALL BE COATED WITH 1/8" MIN. FIBERGLASS COATING OR 1/8" MIN. EPOXY RESIN COATING-TYP

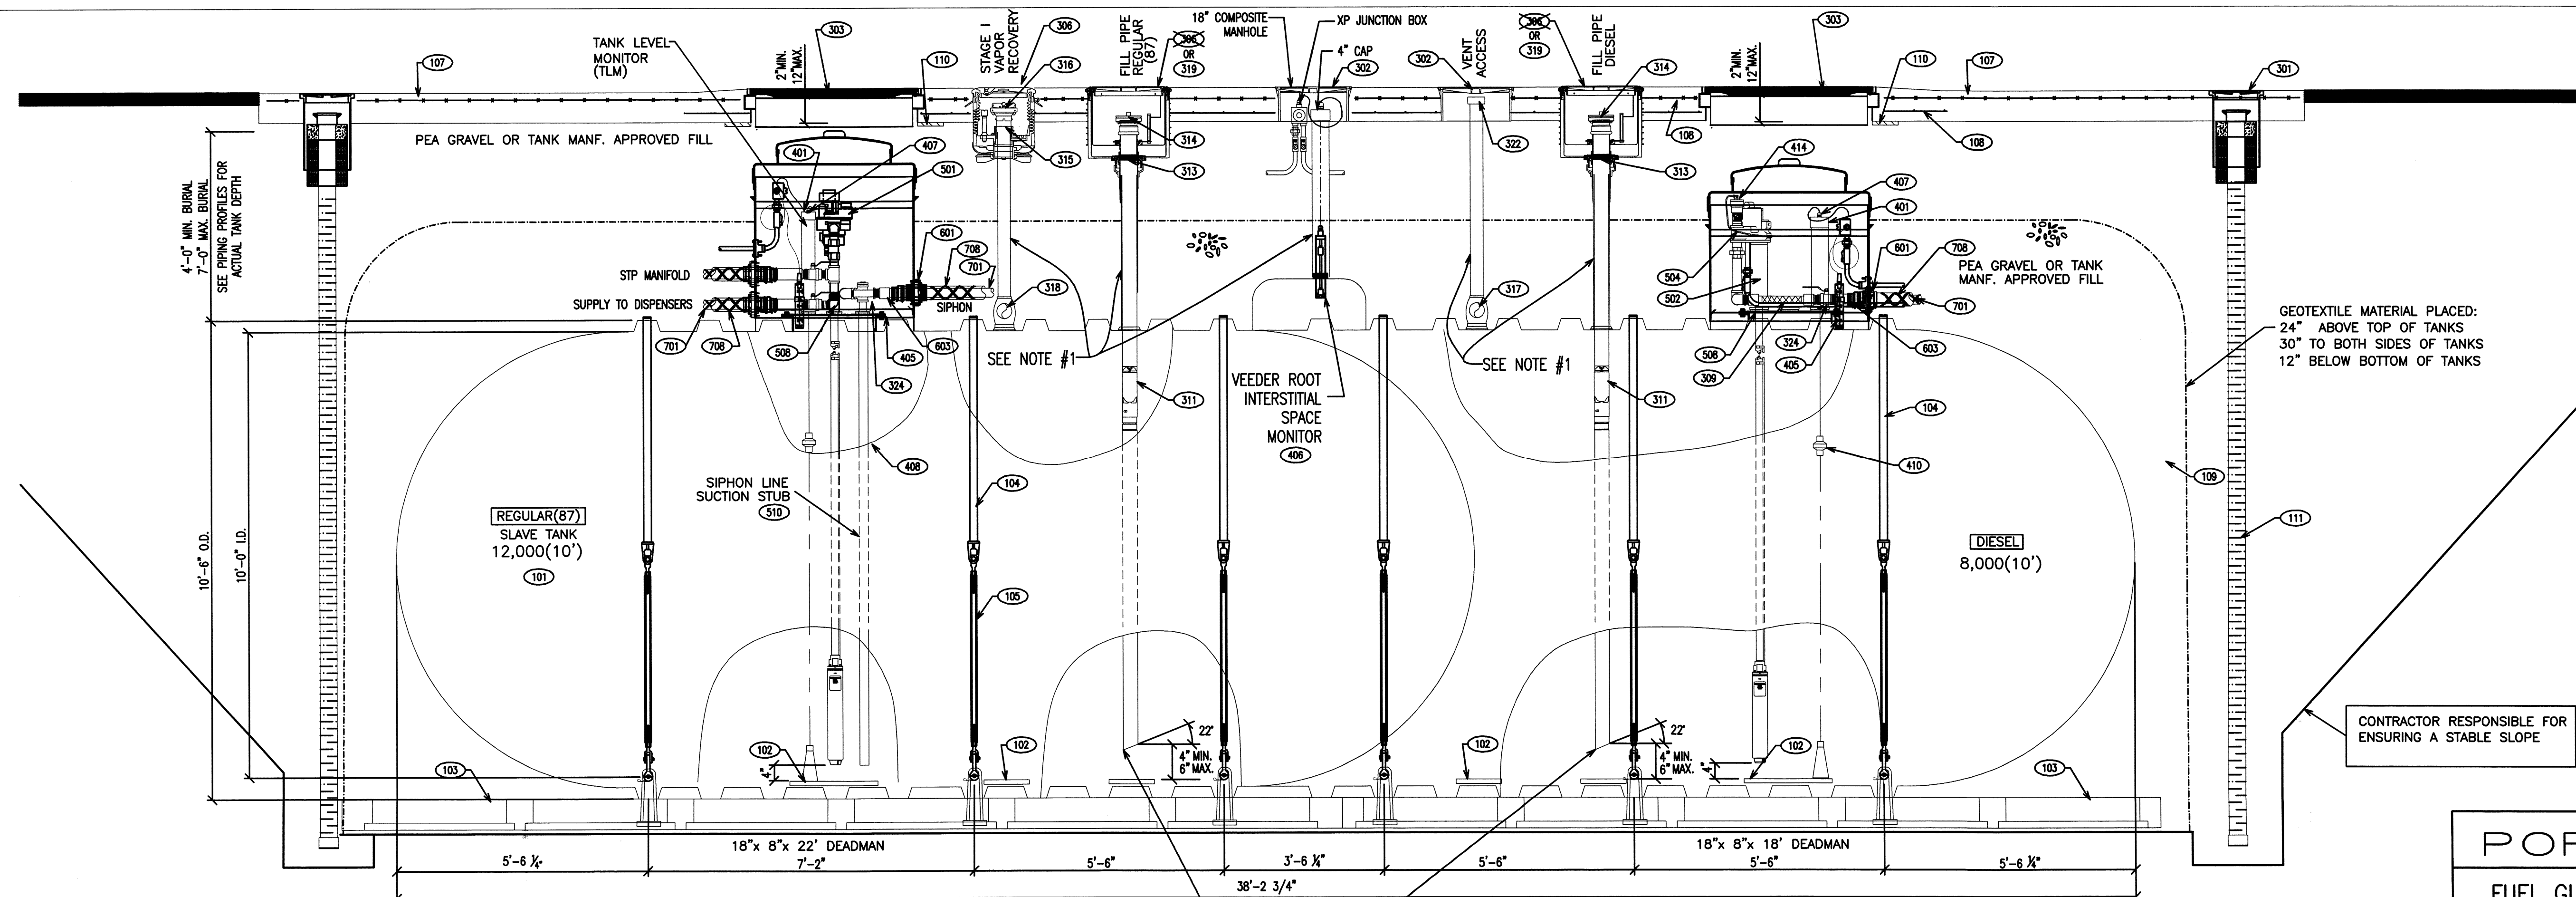

02 20,000 GAL TANK ELEVATION - 12,000 GAL REGULAR / 8,000 DIESEL  
SCALE: 1/2" = 1'-0"

CONTRACTOR TO POINT CHAMFER AWAY FROM OTHER TANK EQUIPMENT

CONTRACTOR RESPONSIBLE FOR ENSURING A STABLE SLOPE

512 WOODFORD STREET  
**PORTLAND, ME**  
FUEL GUIDELINE DRAWING SHEET NO. 3

DOUBLE WALL FIBERGLASS TANK INSTALLATION FOR:  
**TWO (2) 20,000 (12/8 SPLIT) GALLON TANKS**

21,521 SQUARE FEET  
.494 ACRES  
V #1614  
Store #5613  
Gas Station #1848

SCALE: 1" = 10'  
DATE: JAN. 21, 2014  
FILE: 3403 CFG14.3  
DRAWN BY: HS

**Cumberland Farms**  
CUMBERLAND FARMS, INC.  
100 Crossing Boulevard  
Framingham, MA 01702

**TANK INSTALLATION DETAILS** CFG14.3

**MHF Design Consultants, Inc.**  
44 Stiles Road, Suite One  
Salem, New Hampshire 03079  
(603) 893-0720  
ENGINEERS + PLANNERS + SURVEYORS  
www.mhfdesign.com

STATE OF MAINE  
FRANK C. MONTEIRO  
7201  
LICENSED PROFESSIONAL ENGINEER  
1/22/14

REVISIONS			
NO.	DATE	REV. BY.	DESCRIPTION

F:\Projects\CAD\3403\JUST PLANS\3403 CFG14.3.dwg T3.0 1/22/14 7:13pm nfm