


REV.	DESCRIPTION	DATE	DRWN:	IRW/D:
2	Address Correction	2/22/17	KMB	TRD
1	Revision based upon added detection dated 1/10/17	1/30/17	KMB	TRD
0	Original Issue	1/17	KMB	TRD

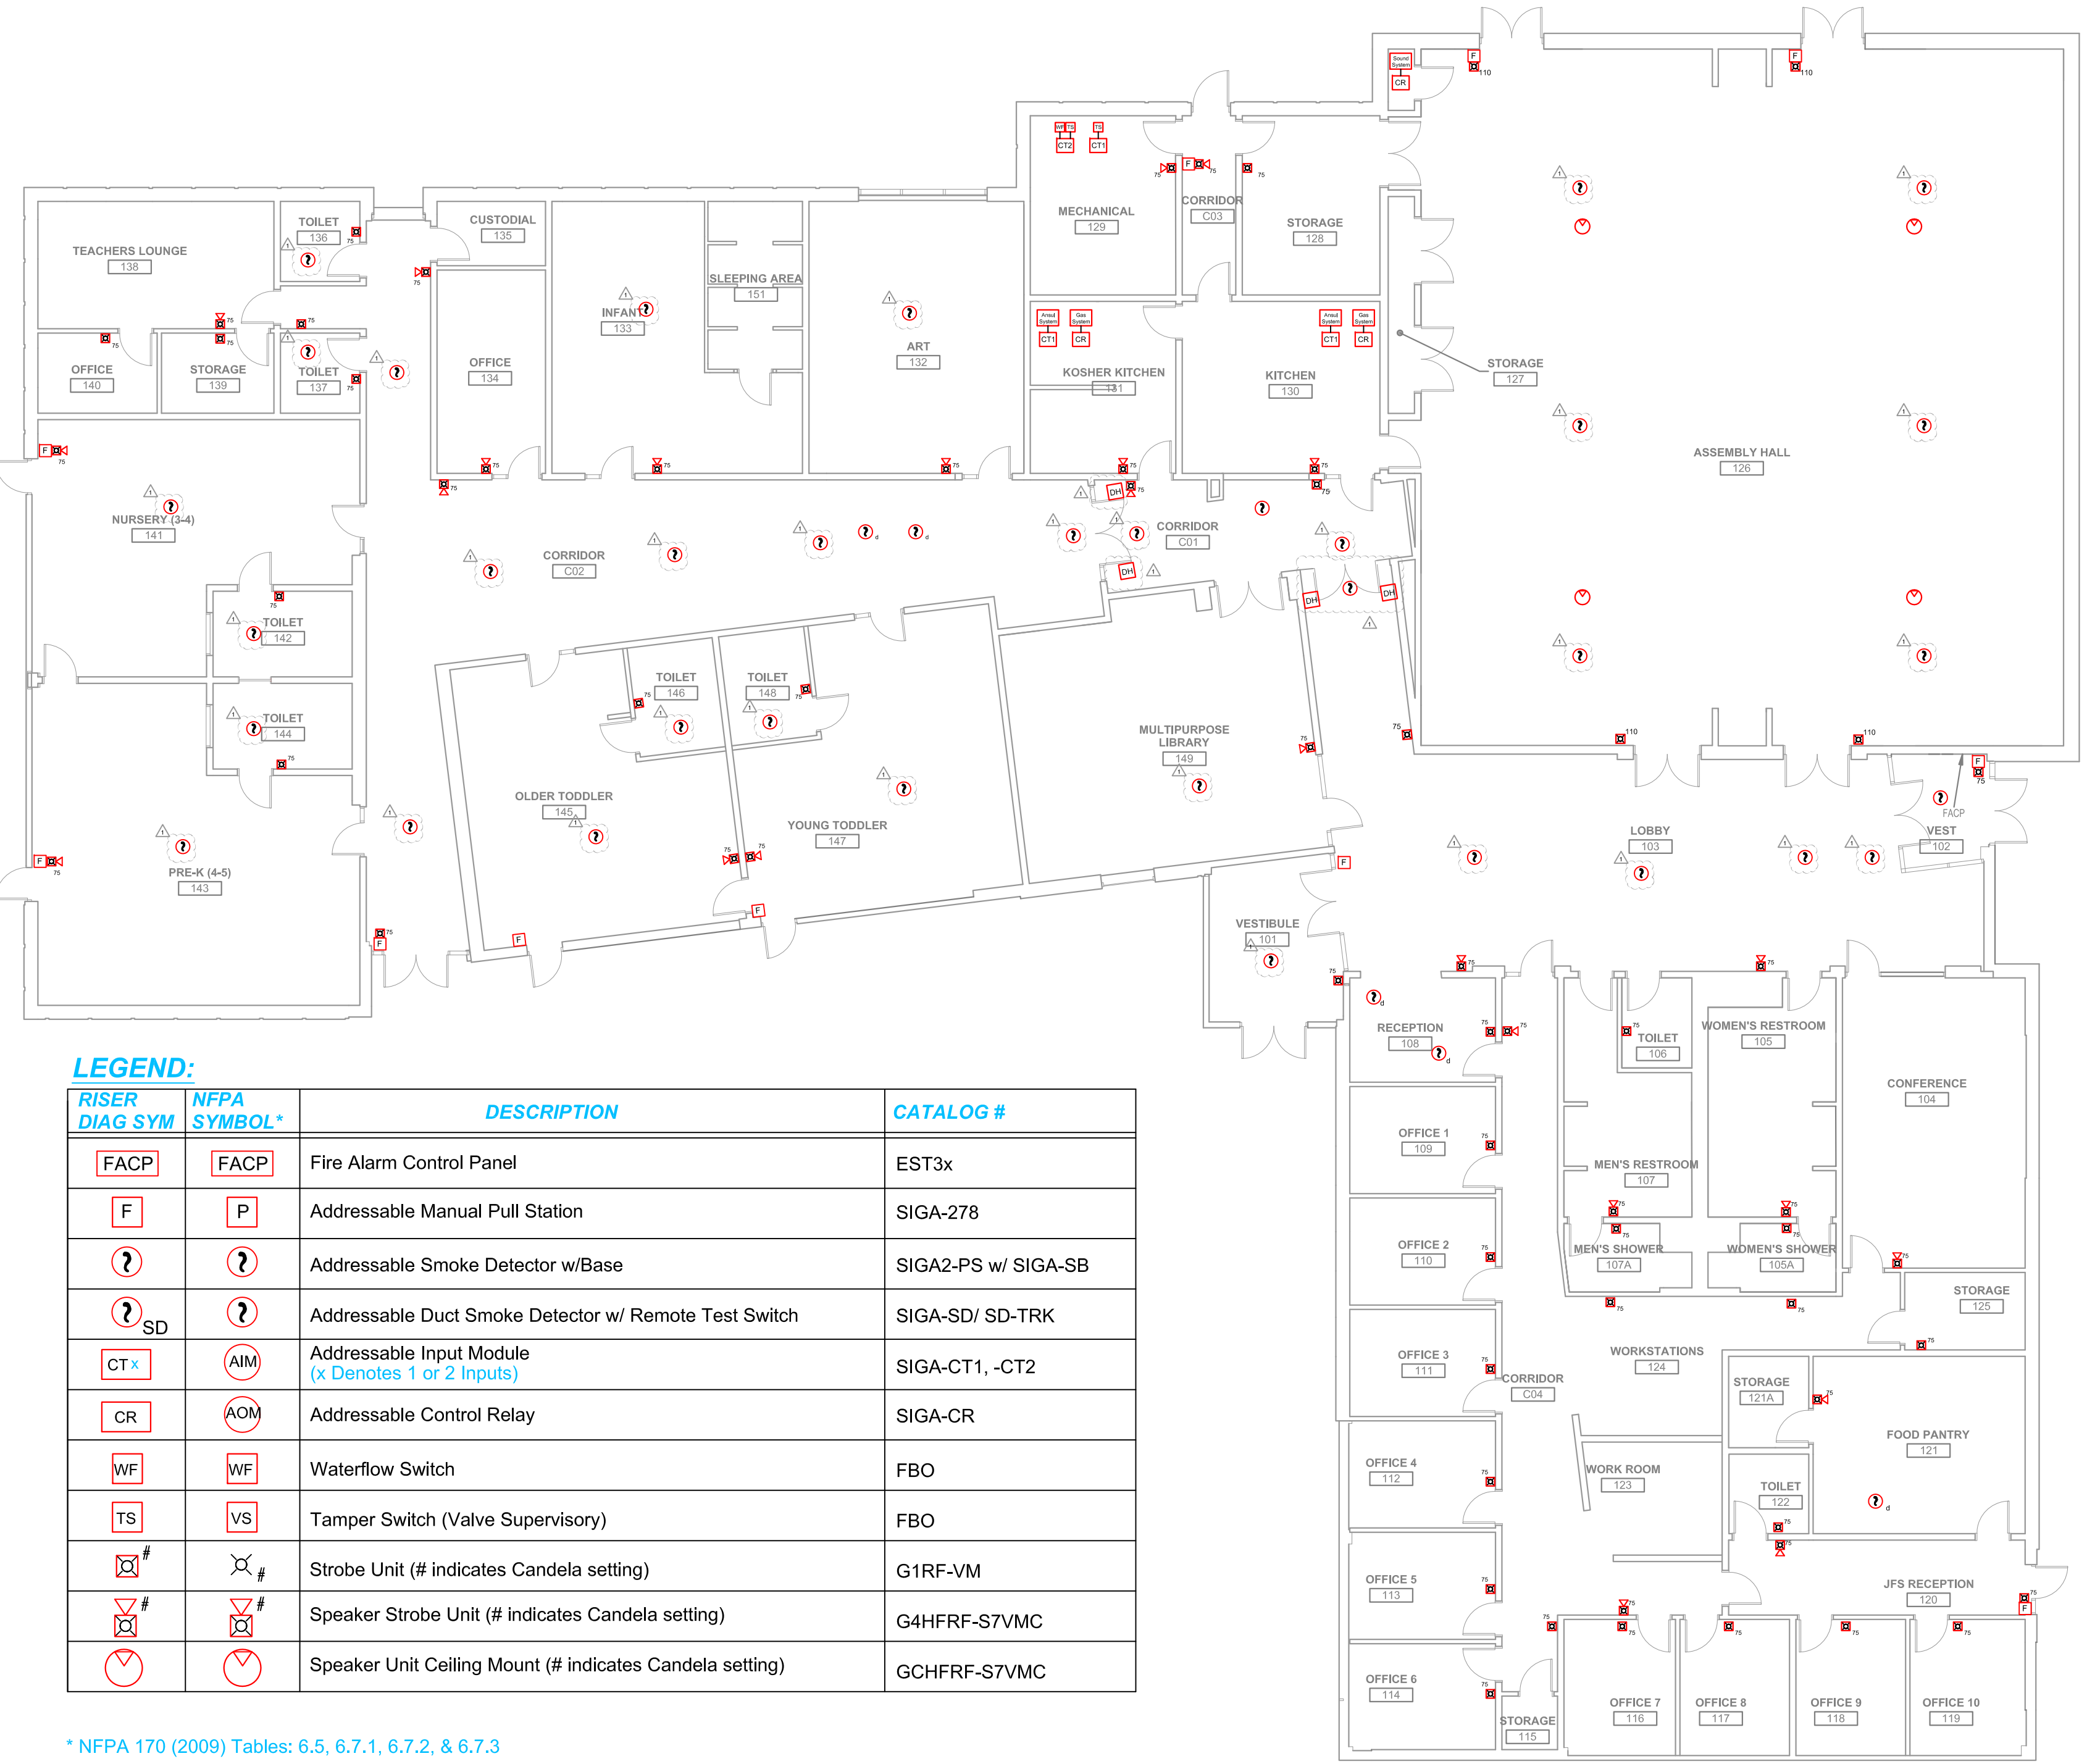

LEGEND:

RISER DIAG SYM	NFPA SYMBOL*	DESCRIPTION	CATALOG #
FACP	FACP	Fire Alarm Control Panel	EST3x
F	P	Addressable Manual Pull Station	SIGA-278
?	?	Addressable Smoke Detector w/Base	SIGA2-PS w/ SIGA-SB
?SD	?	Addressable Duct Smoke Detector w/ Remote Test Switch	SIGA-SD/ SD-TRK
CT x	AIM	Addressable Input Module (x Denotes 1 or 2 Inputs)	SIGA-CT1, -CT2
CR	AOM	Addressable Control Relay	SIGA-CR
WF	WF	Waterflow Switch	FBO
TS	VS	Tamper Switch (Valve Supervisory)	FBO
#	#	Strobe Unit (# indicates Candela setting)	G1RF-VM
#	#	Speaker Strobe Unit (# indicates Candela setting)	G4HFRF-S7VMC
∇	∇	Speaker Unit Ceiling Mount (# indicates Candela setting)	GCHFRF-S7VMC

* NFPA 170 (2009) Tables: 6.5, 6.7.1, 6.7.2, & 6.7.3