


NOTES:

1. FM-200 CLEAN AGENT SUPPRESSION SYSTEM CONTRACTOR SHALL PROVIDE WORKING PLANS IN ACCORDANCE WITH NFPA 2001 SECTION 5.1.2 FOR REVIEW AND APPROVAL BY THE STATE OF MAINE AND ENGINEER OF RECORD. THE CONTRACTOR TO PROVIDE PIPE FLOW CALCULATIONS, COMPLIANT HANGING BRACING AND SPACING REQUIREMENTS AND BATTERY CAPACITY AND BATTERY CALCULATIONS.

TYPICAL CONTROL PANEL RISER DIAGRAM

SCALE: N.T.S.

1

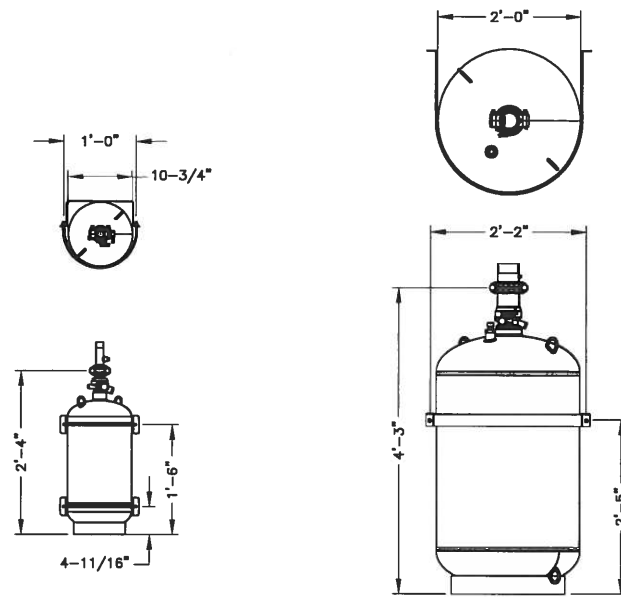

60 LB. AGENT STORAGE CONTAINER

600 LB. AGENT STORAGE CONTAINER


NOTES:

1. THE FM-200 CYLINDER SHALL BE BE LABELED WITH PERMANENT NAME TAGS THAT INDICATE THE AGENT, TARE AND GROSS WEIGHT IN ACCORDANCE WITH NFPA 2001 4.4.1.2.

MOUNTING DETAIL FOR CONTAINER

SCALE: N.T.S.

2

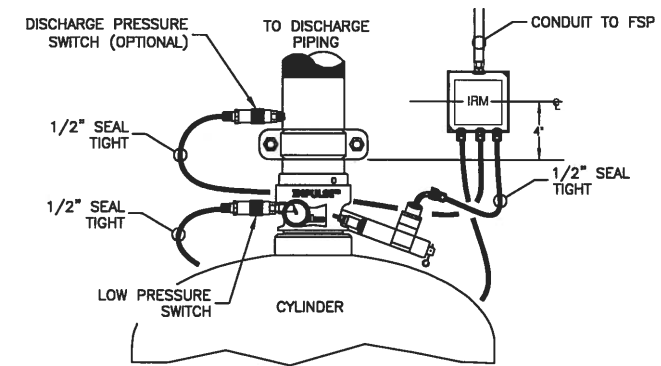


NOTES:

1. DISCHARGE PRESSURE SWITCHES ARE OPTIONAL AND MAY NOT BE PART OF SCOPE.
2. ACTUAL LAYOUT SHALL BE FIELD DETERMINED.

CYLINDER ASSEMBLY

SCALE: N.T.S.

3

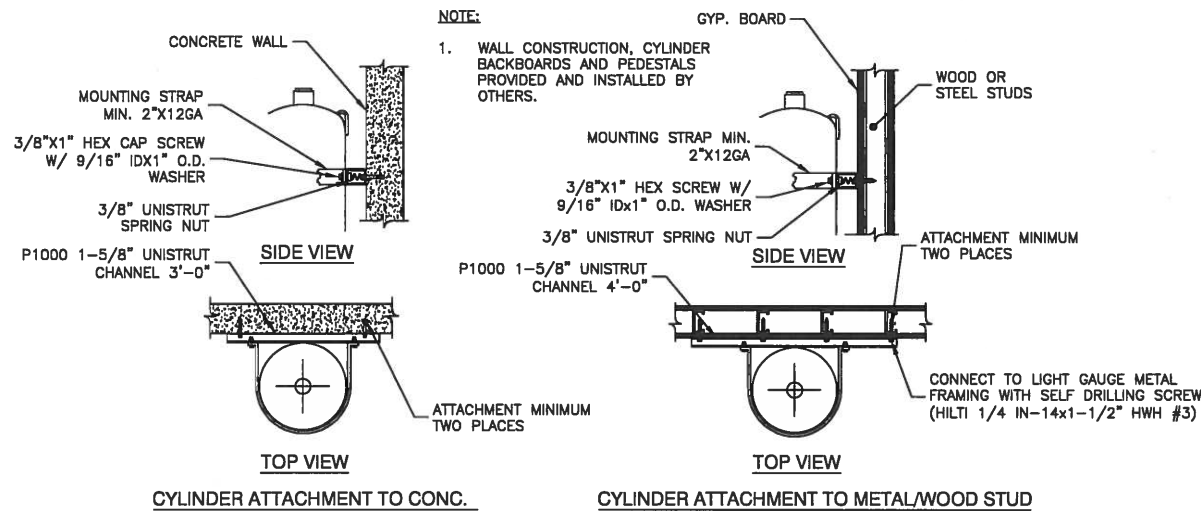


NOTE:

1. WALL CONSTRUCTION, CYLINDER BACKBOARDS AND PEDESTALS PROVIDED AND INSTALLED BY OTHERS.

TANK MOUNTING DETAILS

SCALE: N.T.S.

4

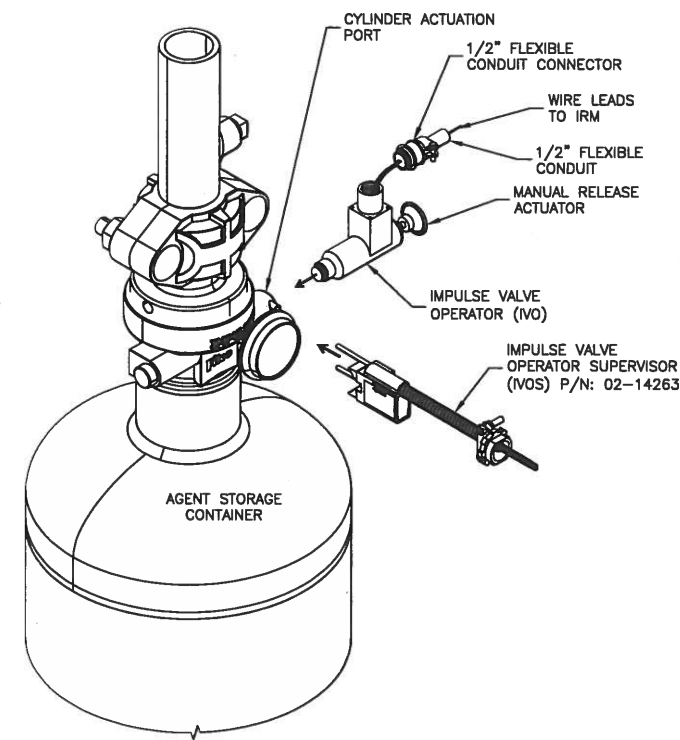

IMPULSE VALVE OP.

SCALE: N.T.S.

5



VERIZON WIRELESS
118 FLANDERS ROAD
WESTBOROUGH, MA 01581-3956


PORTLAND ME HEAD END

CONSTRUCTION DRAWINGS

O	11/27/17	FOR CONSTRUCTION
C	10/30/17	90% SUBMITTAL
B	10/04/17	80% SUBMITTAL
A	04/14/17	50% SUBMITTAL



Dewberry Engineers Inc.
280 SUMMER STREET
10TH FLOOR
BOSTON, MA 02210
PHONE: 617.695.3400
FAX: 617.695.3310

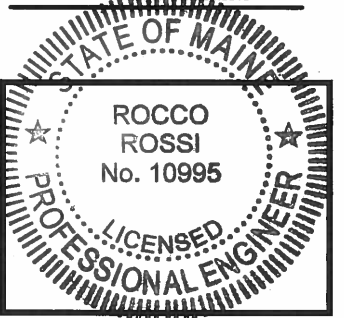

DRAWN BY: SK
REVIEWED BY: MFT
CHECKED BY: BBR
PROJECT NUMBER: 50002925
JOB NUMBER: 50080012
SITE ADDRESS:

1531 CONGRESS ST.
PORTLAND, ME 04102

SHEET TITLE

FIRE SUPPRESSION SYSTEM DETAILS

SHEET NUMBER

FS-2