


**NOTES:**

- THE HVAC COOLER UNITS EXHAUST & VENTILATION SHALL BE HOODED WITH A MODULAR SOUND ATTENUATOR SYSTEM AS MANUFACTURED BY AEROACOUSTIC ENGINEERING CONSULTANTS, LLC OR APPROVED EQUAL. SUCH SOUND ATTENUATOR SYSTEMS SHALL REDUCE THE DBA OF THE PROPOSED UNITS EXHAUST & OPERABLE NOISE LEVELS SUCH THAT THE SOUND LEVEL AS MEASURED 8 FEET AWAY SHALL BE LESS THAN 55 DBA.
- THE EMERGENCY GENERATOR SHALL BE A GENERAC SG050 NATURAL GAS POWERED BACKUP GENERATOR OR APPROVED EQUAL. SUCH GENERATOR SHALL DEMONSTRATE THAT WITH ADEQUATE SCREENING OF THE SHELTER COMPOUND & WITH LANDSCAPED ROWS THAT THE NOISE LEVELS WILL BE AT OR BELOW THE REQUIRED 55DBA AT ALL PROPERTY LINES. THE OWNER MAY BE REQUIRED TO PROVIDE FIELD MEASUREMENTS TO ASSURE SUCH LIMITS ARE MET. TESTING OF THE BACKUP GENERATOR SHALL BE CONDUCTED ONCE A MONTH ONLY.

**NOTE:**


\* SITE PREPARATION WORK SHALL BE IN ACCORDANCE WITH THE PLANS PREPARED BY SEBAGO TECHNICS INC. DATED: 12/23/2015 AS APPROVED BY THE CITY OF PORTLAND.

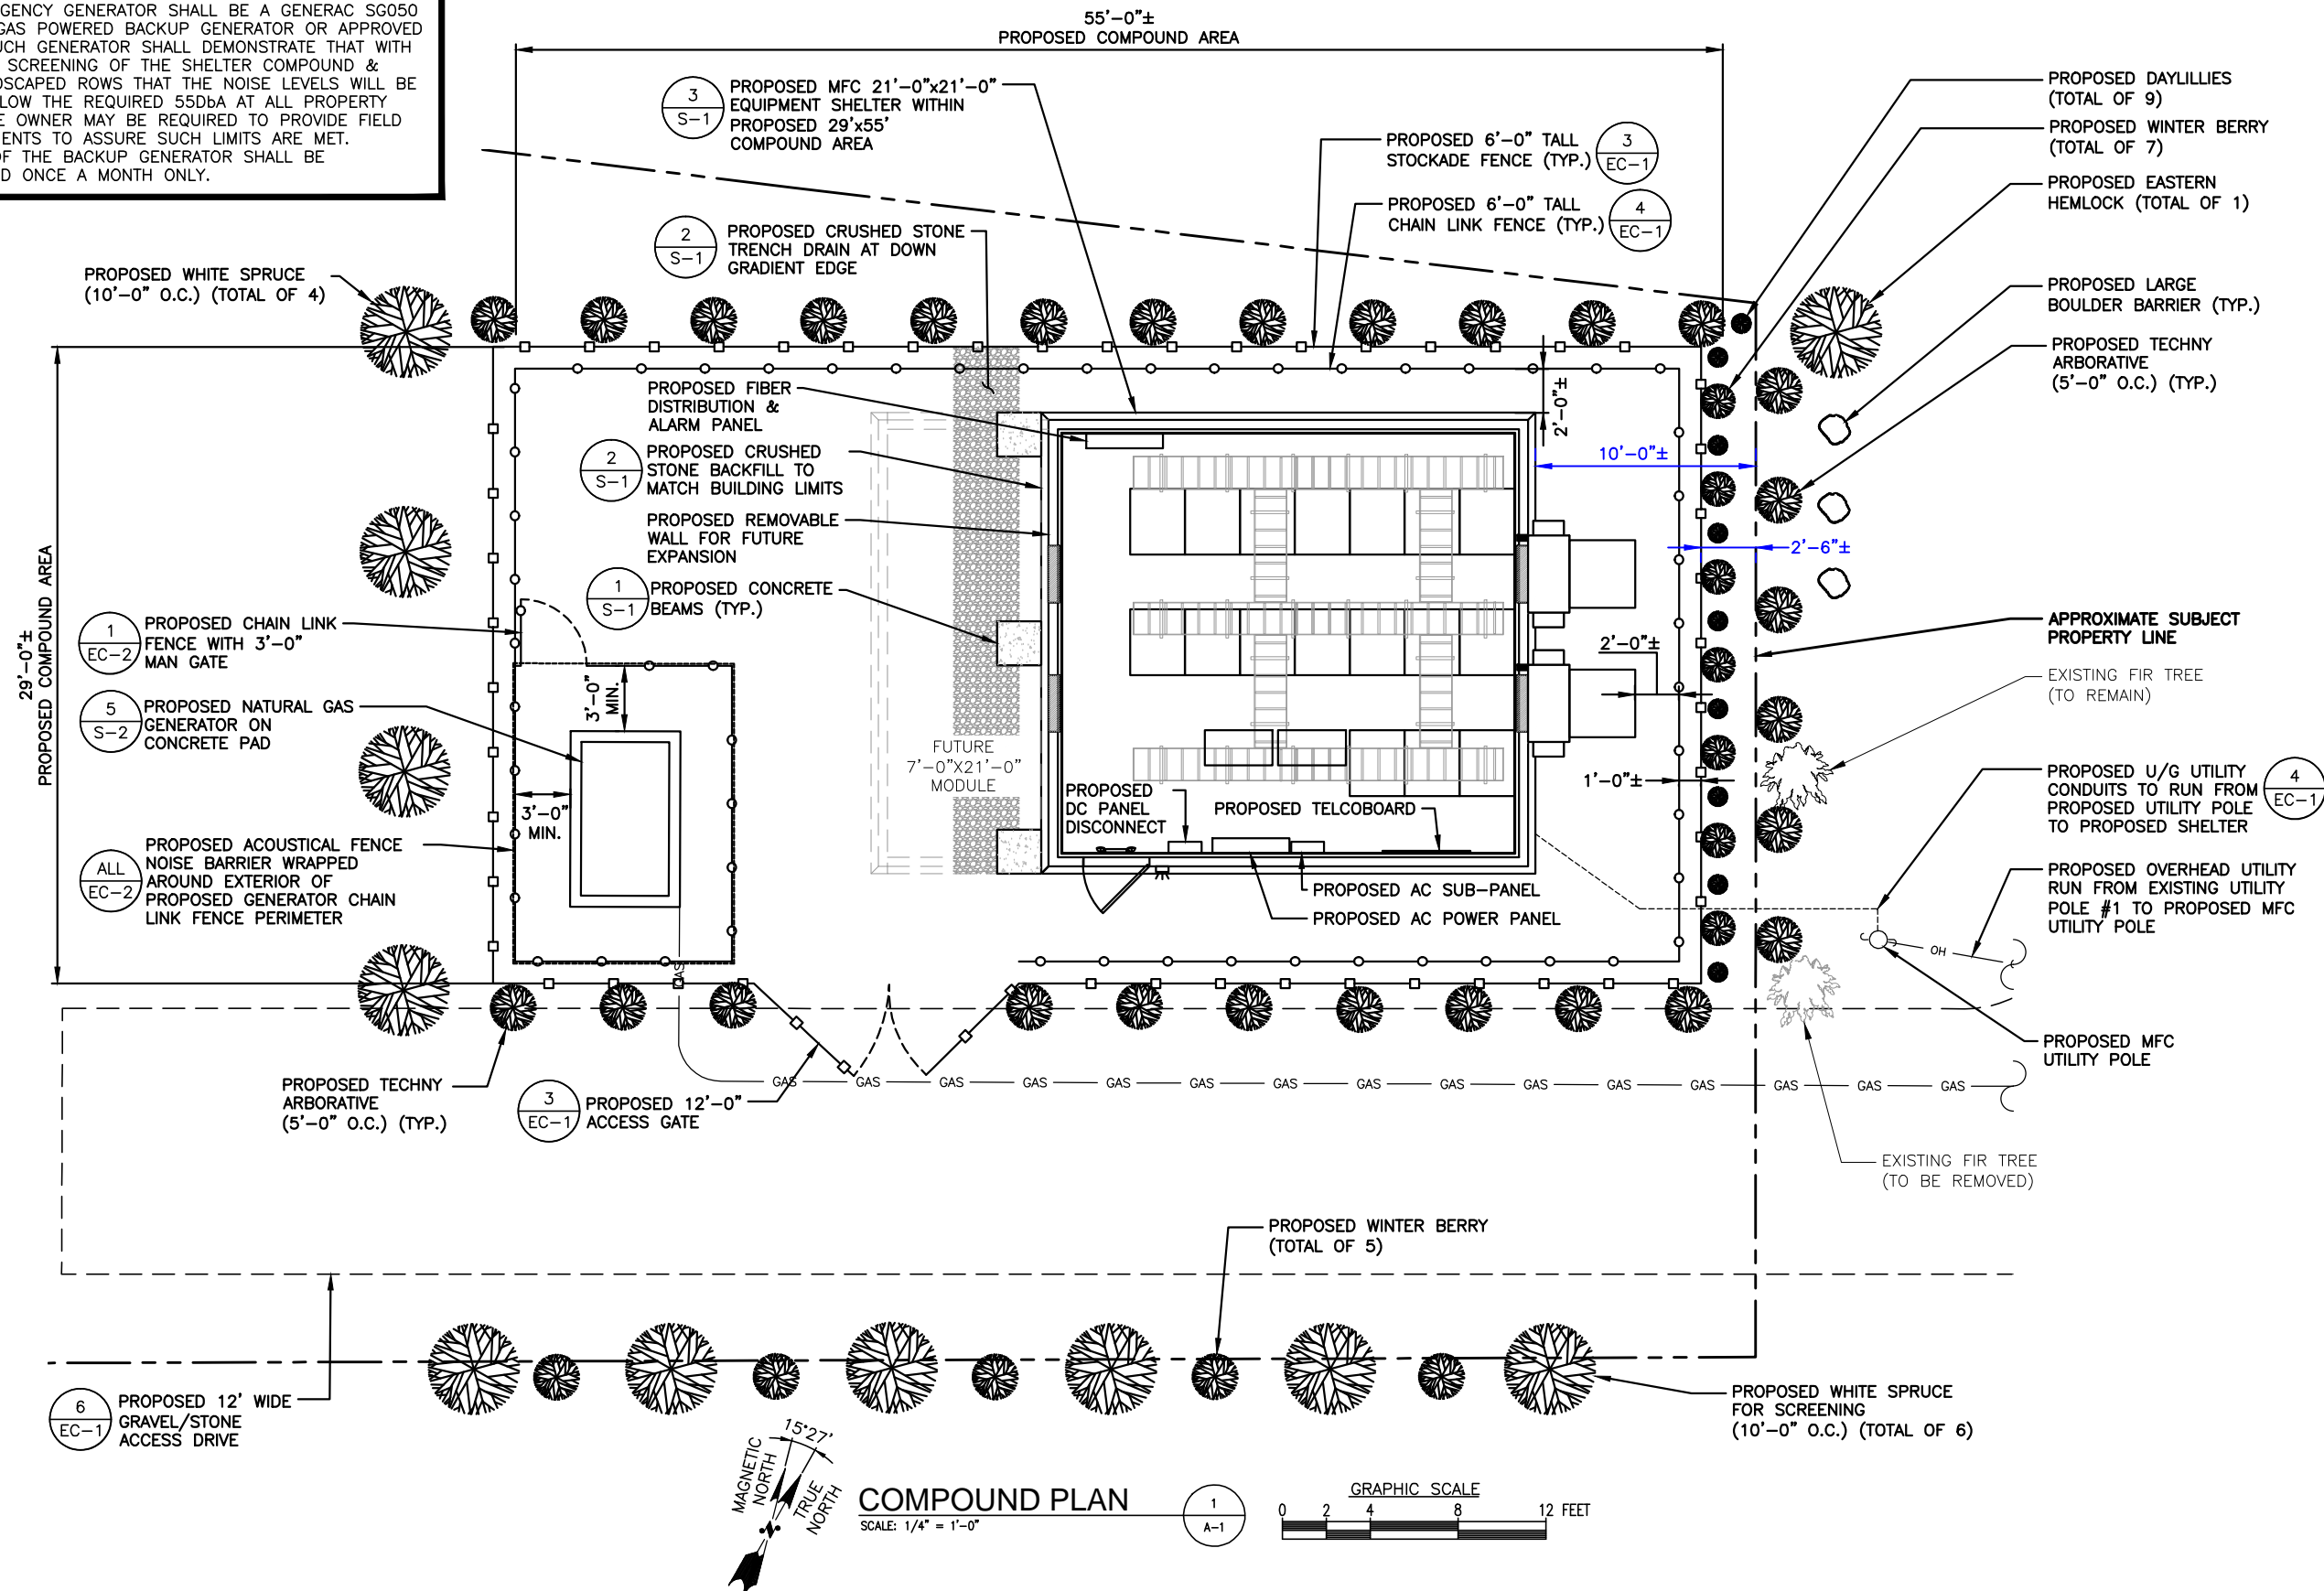

482 CONGRESS STREET, SUITE 100  
PORTLAND, ME 04101



1600 OSGOOD STREET  
BLD 20 N, SUITE 3090  
N. ANDOVER, MA 01845  
TEL: (978)-557-5553  
FAX: (978)-336-5586

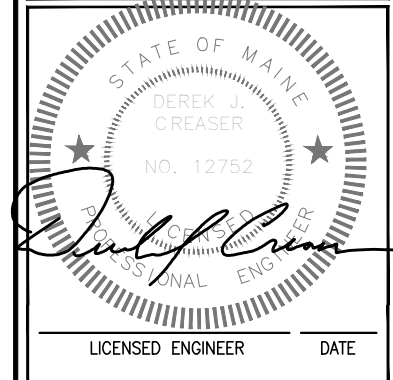

REVISIONS		
REV. #	DATE	DESCRIPTION
1	04/04/16	ISSUED FOR PERMITTING
0	03/02/16	ISSUED FOR REVIEW


PROJECT NO.	DESIGNED BY: RP	SCALE:
	DRAWN BY: VP	AS SHOWN
	CHECKED BY: DPH	

SITE NAME:  
**MFC PORTLAND**

SITE ADDRESS:  
9 WESTLAND AVENUE  
PORTLAND, ME 04101

SHEET TITLE:  
**COMPOUND PLAN**

SHEET NO:  
**A-1**



**COMPOUND PLAN**  
SCALE: 1/4" = 1'-0"

