

# SUBSURFACE WASTEWATER DISPOSAL SYSTEM APPLICATION

Maine Department of Human Services  
Division of Health Engineering, Station 10  
(207) 287-5672 Fax: (207) 287-3165


Town, City, Plantation  
**Portland**

Street, Road, Subdivision  
**123 Hobart Street**

Owner or Applicant Name  
**Rebecca Spear**

**SITE PLAN**      Scale 1" = 50 ft.

**SITE LOCATION PLAN**

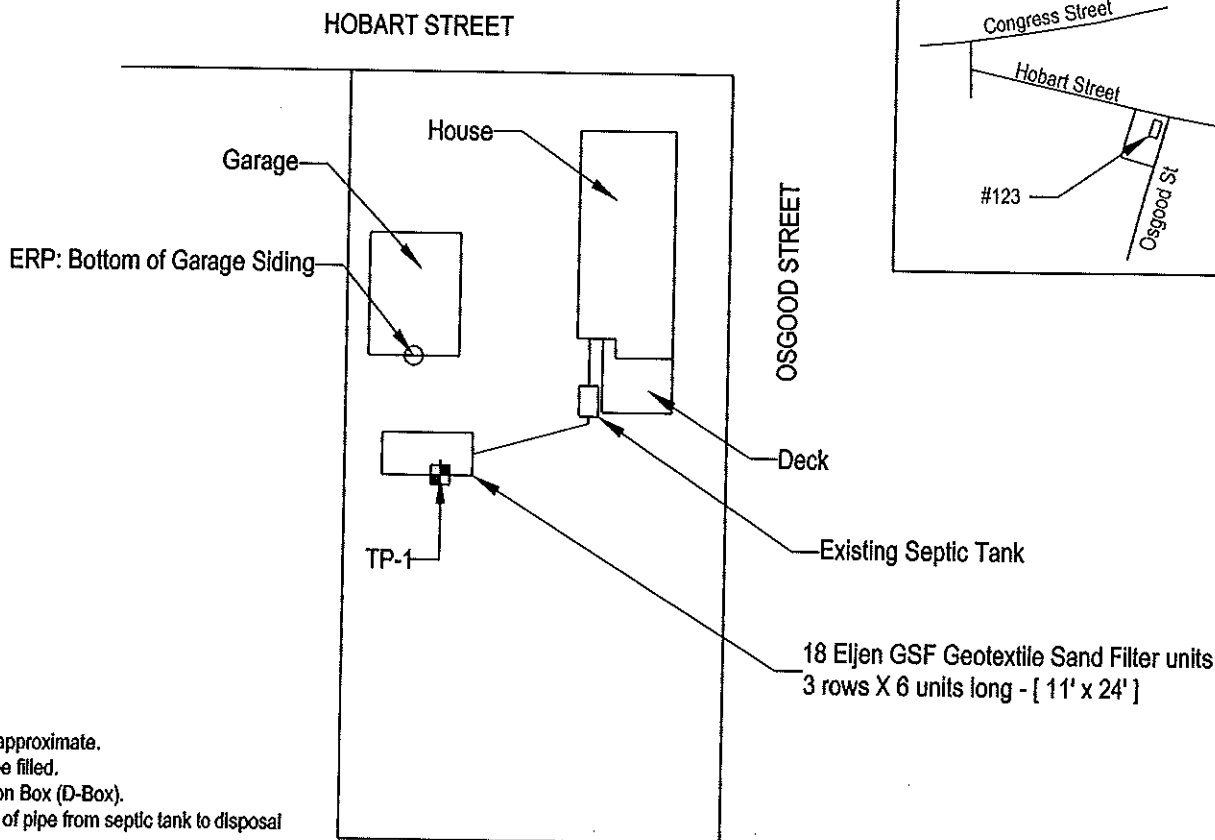

**NOTES:**

1. All property lines are approximate.
2. Scarify all ground to be filled.
3. Insulate the Distribution Box (D-Box).
4. Min. 1/8"/ft (1%) pitch of pipe from septic tank to disposal field.
5. Review the Eljen Geotextile Sand Filter (GSF) Design and Installation Manual before installing this system.

## SOIL PROFILE DESCRIPTION AND CLASSIFICATION (Location of Observation Holes Shown Above)

Observation Hole # TP-1      ■ Test Pit    □ Boring  
"      Depth of organic horizon above mineral soil

Observation Hole # \_\_\_\_\_      □ Test Pit    □ Boring  
"      Depth of organic horizon above mineral soil

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Mottling
0				
6	Fine Sandy Loam	Friable	Brown	
12				
18	Silt Loam	Friable	Reddish Brown	
24		Firm	Gray	Common & Faint
30				
36	Limit of Excavation at 24 inches			
42				
48				
8 Profile	C Classification	7 Slope Percent	20" Limiting Factor Depth	<input checked="" type="checkbox"/> Groundwater <input checked="" type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock

Depth below mineral soil surface (inches)	Texture	Consistency	Color	Mottling
0				
6				
12				
18				
24				
30				
36				
42				
48				
_____ Profile	_____ Classification	_____ Slope Percent	_____ Limiting Factor Depth	<input type="checkbox"/> Groundwater <input type="checkbox"/> Restrictive Layer <input type="checkbox"/> Bedrock

*Richard Omet*  
Site Evaluator Signature

034  
SE #

03/06/16  
Date