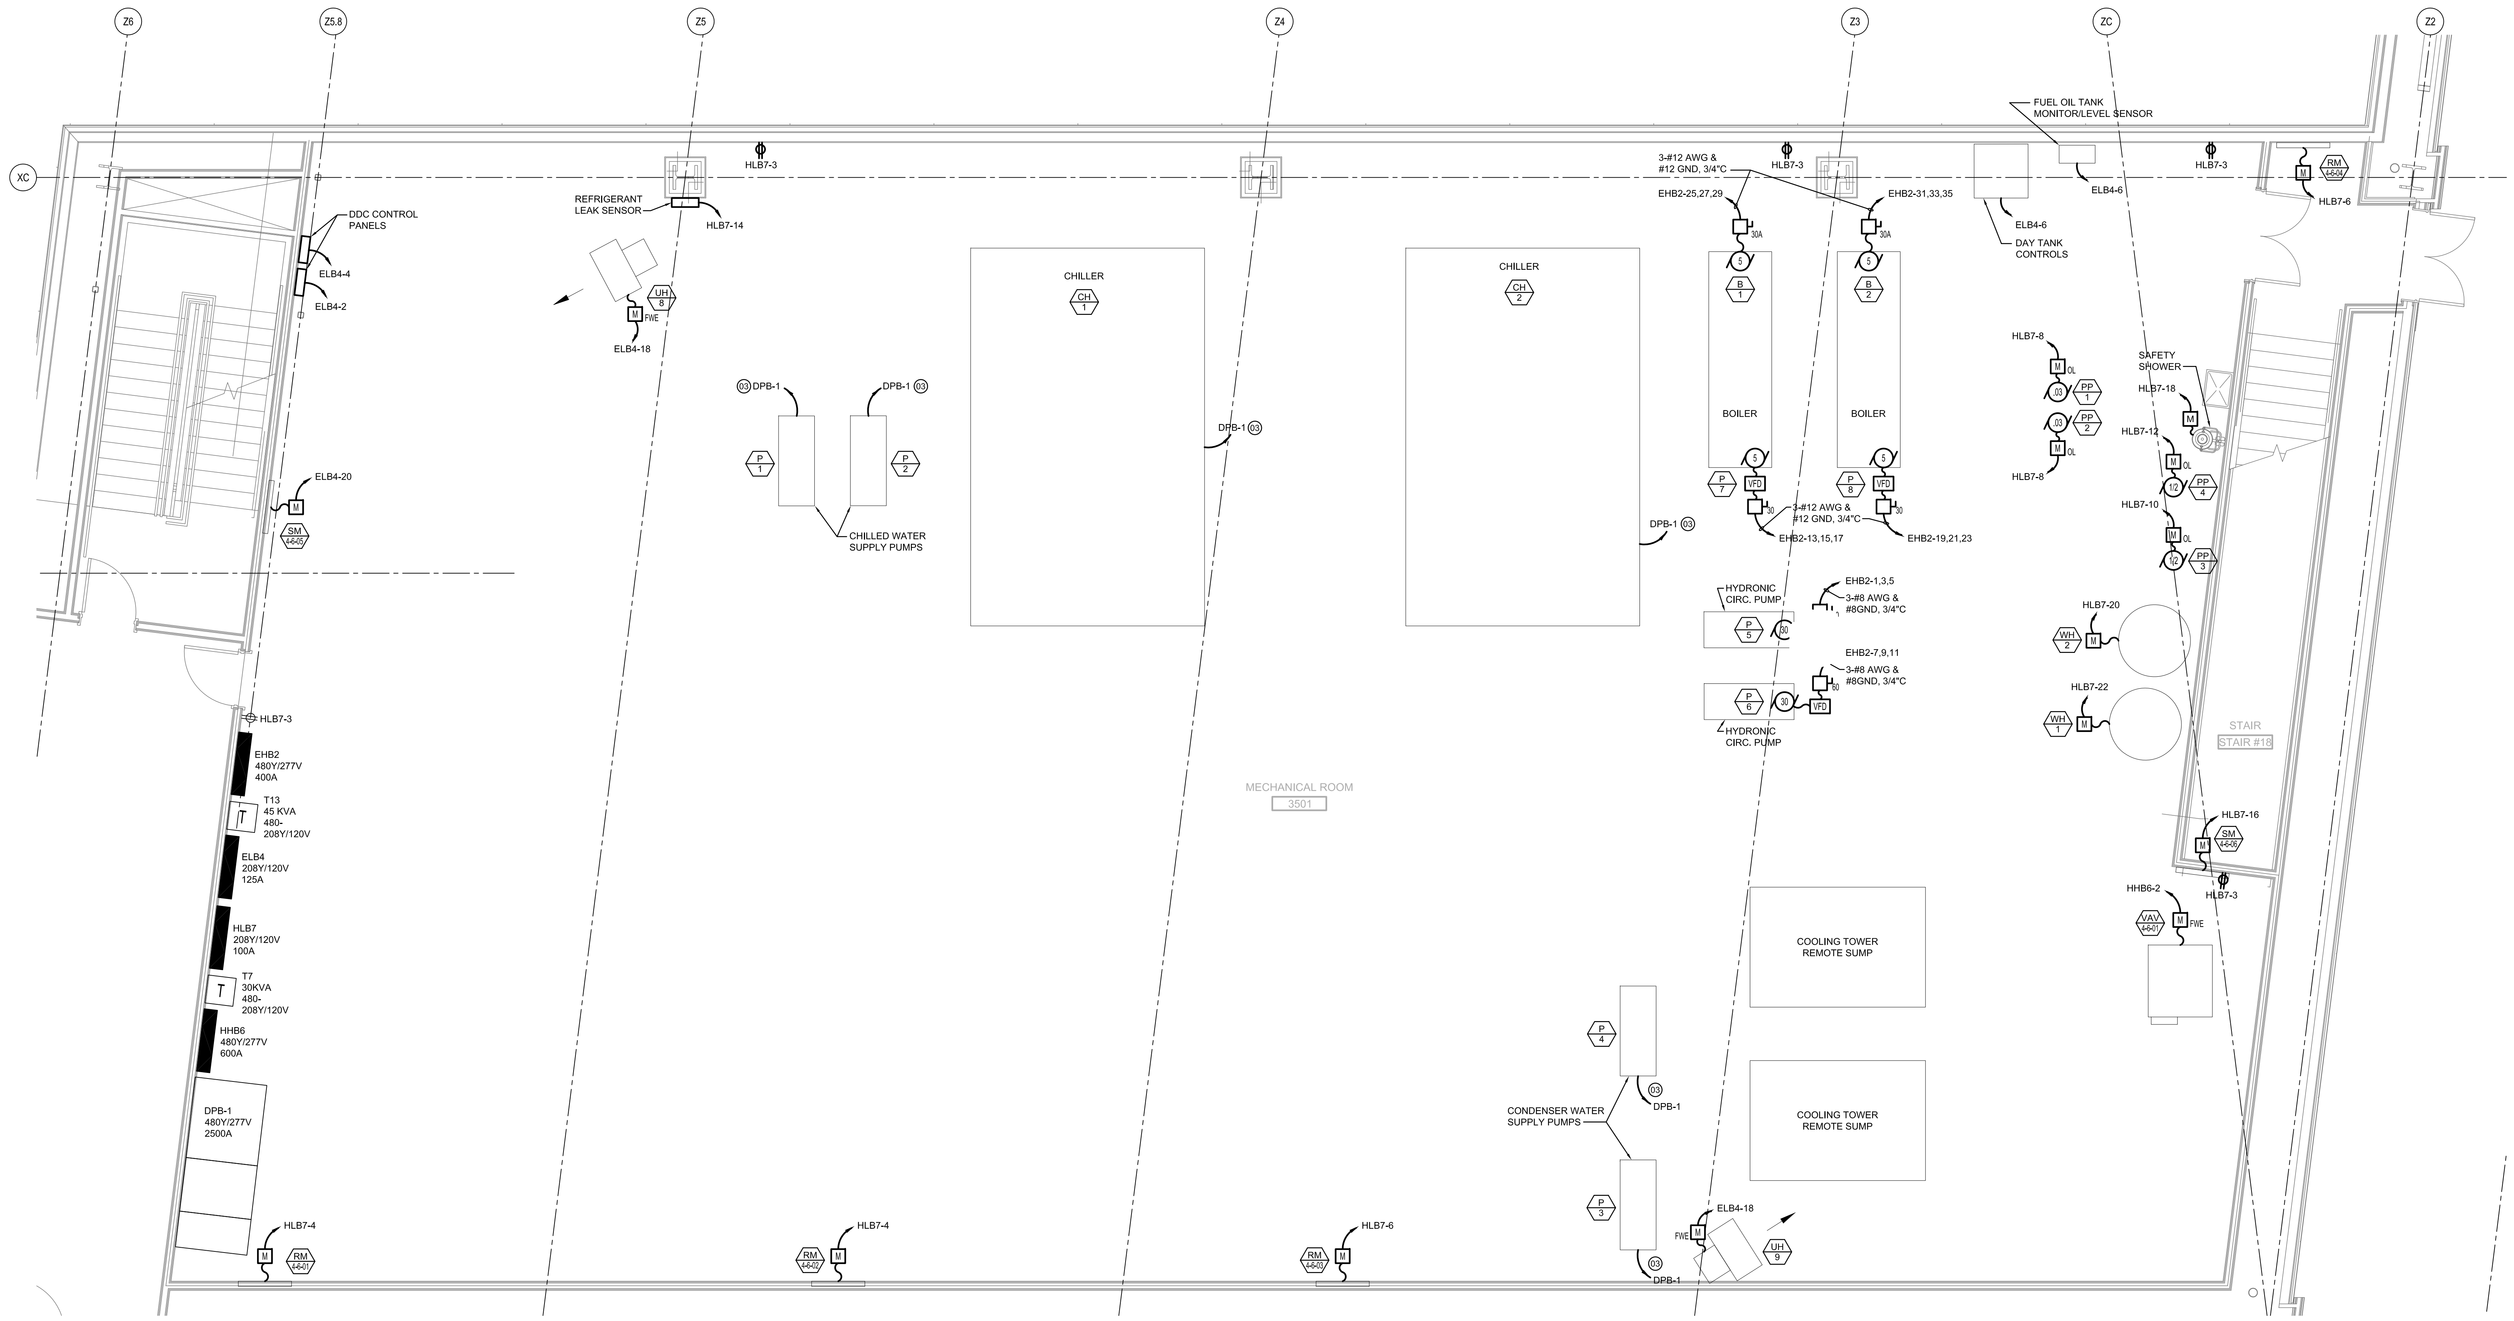

MECHANICAL ROOM 3501 ENLARGED PLAN

SCALE: 1/4" = 1'-0"

1

SHEET NOTES

01 ELEVATOR DISCONNECT. MOUNT NEXT TO ELEVATOR CONTROLLER.

02 ELEVATOR CAB LIGHTING DISCONNECT.

03 SEE ONE-LINE DIAGRAM, SHEET E12.01, FOR CONDUIT & CONDUCTOR SIZE AS WELL AS DISCONNECTS & CONTROLLERS ASSOCIATED WITH THIS EQUIPMENT.

GENERAL NOTES

A SEE SHEET E00.00 FOR LEGEND AND GENERAL NOTES.

B CONTRACTOR SHALL REFER TO SECURITY, IT, AND PUBLIC ADDRESS SYSTEMS DRAWINGS FOR CONDUITS & WIRING REQUIREMENTS.

Portland International Jetport

1001 Westbrook Street
Portland, Maine 04102

Gensler
2020 K Street, NW
Suite 200
Washington, DC 20006
Telephone 202.721.5200
Facsimile 202.872.8587

oest ASSOCIATES, INC.
343 Gorham Road, South Portland, ME 04106 P: (207) 761-1770 F: (207) 774-1244 www.oest.com
engineers · architects · surveyors · construction managers

Issue	Date & Issue Description	By	Check
01	09/22/08	LAM	BHG
	DESIGN DEVELOPMENT		
02	12/03/08	LAM	BHG
	75% CONSTRUCTION DOCUMENTS		
03	01/23/09	LAM	BHG
	95% CONSTRUCTION DOCUMENTS		
04	10/26/09	LAM	BHG
	ISSUED FOR PERMIT		

Seal/Signature

Project Name
PWM Terminal Enhancement

Project Number
09.6395.000

CAD File Name
T:\5330101\Sheets\E08.02.dwg

Description
ELECTRICAL ENLARGED PLAN

Scale
AS NOTED

E08.02

©2009 Gensler