

**SHEET NOTES**

- 01 INSTALL HEAT DETECTOR AT THE BOTTOM OF THE ELEVATOR PIT WITHIN TWO FEET OF THE SPRINKLER AS SHOWN IN THE PLAN. PROVIDE ADDITIONAL HEAT DETECTORS AND SMOKE DETECTORS IF REQUIRED AND FINAL QUANTITIES AND LOCATION SHALL BE COORDINATED WITH THE FIRE PROTECTION CONTRACTOR.
- 02 CONTRACTOR SHALL COORDINATE WITH OTHER TRADES AND BE RESPONSIBLE FOR FINAL LOCATION AND QUANTITIES OF MODULES MONITORING FLOW AND TAMPER SWITCHES.
- 03 NEW SMOKE DETECTORS TO BE MOUNTED ON BOTH SIDES OF THE FIRE DOOR AS PART OF THE BAGGAGE HANDLING SYSTEM. DETECTION SHALL BE WITHIN FIVE FEET OF THE DOORS AND SHALL BE MOUNTED IN ACCORDANCE WITH NFPA 72. INITIATION OF THE DETECTORS SHALL CAUSE THE CONTROL MODULE LOCATED AT THE MCP IN TERMINAL TO INITIATE THE SYSTEMS FIRE MODE AND SHUT THE BAGGAGE HANDLING DOOR AFTER A DELAY OF 60 SECONDS. COORDINATE WITH OTHER TRADES TO DETERMINE FINAL QUANTITIES AND LOCATION OF MODULES AND PROVIDE THE NECESSARY 24VDC CIRCUITING AND SLC CIRCUITING TO THE MODULE AND DETECTOR.
- 04 INSTALL ELEVATOR RECALL SMOKE DETECTOR AT THE CEILING WHEREVER APPLICABLE. OTHERWISE, INSTALL ON THE WALL ABOVE THE ELEVATOR DOOR OPENING AS PER NFPA72. BEFORE SUBMITTING SHOP DRAWINGS, COORDINATE FINAL LOCATION WITH THE ARCHITECT AND OTHER TRADES.

**Portland International Jetport**  
 1001 Westbrook Street  
 Portland, Maine 04102

**Gensler**

2020 K Street, Northwest  
 Suite 200  
 Washington DC 20006  
 Telephone 202.721.5200  
 Facsimile 202.872.8587


**ARORA**  
 Solutions for Secure Environments

**Arora Engineers, Inc.**  
 61 Wilmington - West Chester  
 Suite #100  
 Chadds Ford, PA 19317  
 T: (610) 459-7900  
 F: (610) 459-7950

**GENERAL NOTES**

- A MOUNTING FOR ALL DEVICES SHALL COMPLY WITH IBC 2003, NFPA 90A, NFPA 72, NEC, ADAAG AND ALL APPLICABLE LOCAL CODES.
- B VISUAL NOTIFICATION APPLIANCES SHALL BE SET TO THE CANDELA RATING ASSIGNED ON THE DRAWINGS. SPEAKERS SHALL BE TAPPED AT THE WATTAGE SELECTED BY THE SYSTEM MANUFACTURER ON THE APPROVED SHOP DRAWINGS.
- C IN CASES WHERE AN APPLIANCE CANNOT BE LOCATED WHERE SHOWN ON THE DRAWINGS, DUE TO PHYSICAL RESTRICTIONS, NOTIFICATION APPLIANCES MAY BE ABLE TO BE MOVED TO CEILING MOUNT DEVICES UPON APPROVAL BY THE ENGINEER. UPON APPROVAL, DEVICES SHALL BE UL LISTED FOR CEILING MOUNTED APPLICATIONS.
- D MORE THAN TWO VISIBLE NOTIFICATION APPLIANCES OR GROUPS OF VISIBLE NOTIFICATION APPLIANCES IN THE SAME ROOM OR ADJACENT SPACE WITHIN THE SAME FIELD OF VIEW SHALL FLASH IN SYNCHRONIZATION. THIS SHALL INCLUDE SYNCHRONIZATION OF STROBES OPERATED BY SEPARATE SYSTEMS.

Issue	Date & Issue Description	By	Check
	10/26/09		
	100% ISSUED FOR PERMIT		

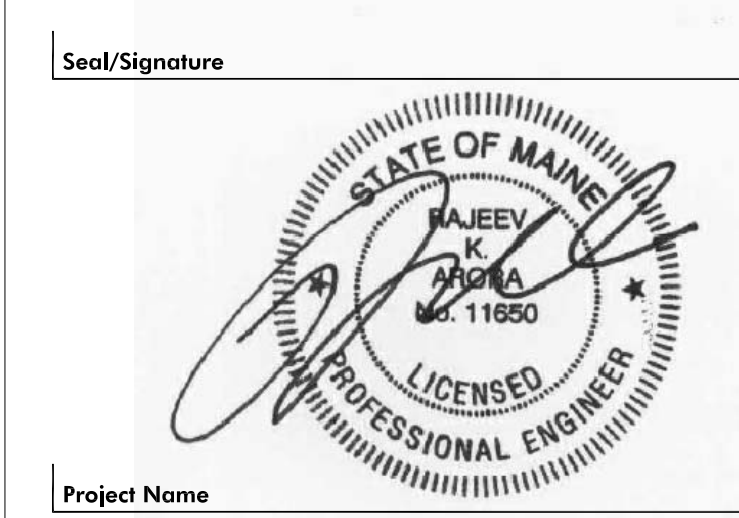

Project Name  
 P10M TERMINAL EXPANSION


Project Number  
 FA02.02.05

CAD File Name  
 FA02.02.05

Description  
 FIRE ALARM  
 CONSTRUCTION PLAN - LEVEL 2 - ZONE 5

Scale  
 As Indicated

**KEY PLAN**

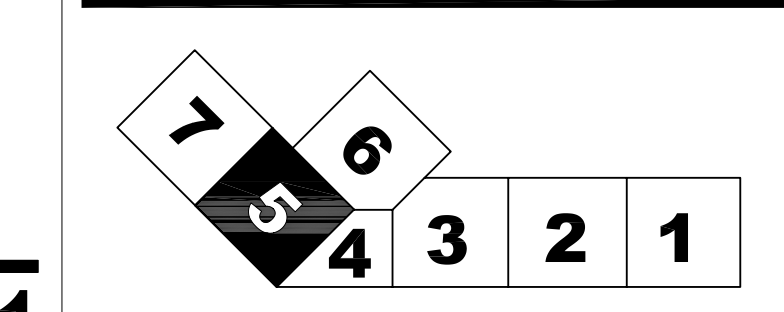

**LEVEL 2 - ZONE 5**

SCALE: 1/8"=1'-0"

**FA02.02.05**

© 2006 Gensler