

**SHEET NOTES**

- 01 RUN TIGHT TO UNDERSIDE OF LEVEL 4 DECK.
- 02 PROVIDE 1" VALVED HWS & HWR FOR FUTURE INSTALLATION OF VAV BOX.
- 03 RUN HWS/HWR CONCEALED IN FINNED RADIATION ENCLOSURE.
- 04 PIPE INSULATION THICKNESS IN UNDERBELLY AREA SHALL EQUAL ASHRAE ENERGY STANDARD PLUS 1".
- 05 FUEL OIL SUPPLY & RETURN PIPING IN UNDERBELLY SHALL BE WELDED
- 06 3/8" BYPASS VENT SET AT 5% OPEN

**Portland International Jetport**  
 1001 Westbrook Street  
 Portland, Maine 04102

**Gensler**

2020 K Street, NW  
 Suite 200  
 Washington, DC 20006  
 Telephone 202.721.5200  
 Facsimile 202.872.8587

**oest ASSOCIATES, INC.**  
 360 Gorton Road, South Portland, ME 04106 P: (207) 741-1170 F: (207) 741-2466 www.oest.com  
 engineers • architects • surveyors • construction managers

**GENERAL NOTES**

- A SEE SHEET M00.00 FOR LEGEND AND GENERAL NOTES.
- B MAINTAIN 18" MIN CLEARANCE FROM RADIANT TUBING TO FLOOR DRAINS, COLUMN WRAPS, PLUMBING FIXTURES, EQUIPMENT SUPPORTS, AND PIPING AT FLOORS.
- C RUN ALL PIPING HIGH AS POSSIBLE WITHIN BEAM POCKET TO AVOID CEILING MOUNTED EQUIPMENT & FIXTURES.

Issue	Date & Issue Description	By	Check
01	07/11/08	PWZ	RHB
02	09/22/08	PWZ	RHB
03	12/03/08	PWZ	RHB
04	01/23/09	PWZ	RHB
05	10/26/09	PWZ	RHB

Project Name: PWM Terminal Enhancement  
 Date: 10/26/09


Project Number: 09-8395-000  
 CAD File Name: T:\5330101\Sheets\M02.03.05.dwg  
 Description: MECHANICAL PIPING PLAN - LEVEL 3 - ZONE 5

Scale: 1/8" = 1'-0"

**M02.03.05**

©2009 Gensler

**KEY PLAN**

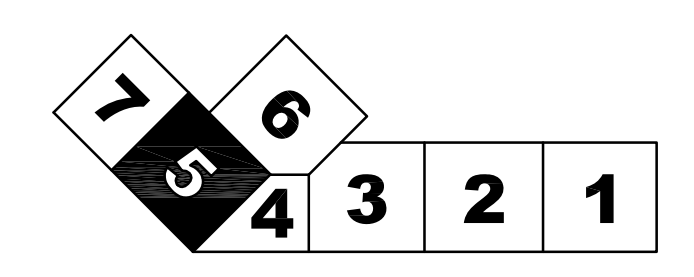

**MECHANICAL PIPING PLAN - LEVEL 3 - ZONE 5**  
 SCALE: 1/8" = 1'-0"