

**MECHANICAL PIPING PLAN - LEVEL 3 - ZONE 6**  
SCALE: 1/8" = 1'-0"


**SHEET NOTES**

01 PIPE INSULATION THICKNESS IN UNDERBELLY AREA SHALL EQUAL ASHRAE ENERGY STANDARD PLUS 1".

**GENERAL NOTES**

- A SEE SHEET M00.00 FOR LEGEND AND GENERAL NOTES.
- B MAINTAIN 18" MIN CLEARANCE FROM RADIANT TUBING TO FLOOR DRAINS, COLUMN WRAPS, PLUMBING FIXTURES, EQUIPMENT SUPPORTS, AND PIPING AT FLOORS.
- C RUN ALL PIPING HIGH AS POSSIBLE WITHIN BEAM POCKET TO AVOID CEILING MOUNTED EQUIPMENT & FIXTURES.

**KEY PLAN**

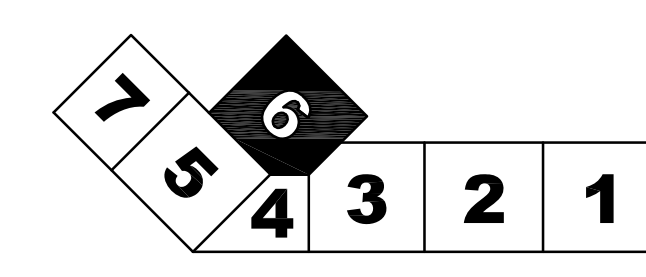

**Portland International Jetport**  
1001 Westbrook Street  
Portland, Maine 04102

**Gensler**  
2020 K Street, NW  
Suite 200  
Washington, DC 20006  
Telephone 202.721.5200  
Facsimile 202.872.8587

**oest ASSOCIATES, INC.**  
363 Galloway Road, South Portland, ME 04106 P (207) 741-1770 F (207) 774-2461 www.oest.com  
engineers • architects • surveyors • construction managers

Issue	Date & Issue Description	By	Check
01	07/11/08	PWZ	RHB
02	09/22/08	PWZ	RHB
03	12/03/08	PWZ	RHB
04	01/23/09	PWZ	RHB
05	10/26/09	PWZ	RHB

Project Name: PWM Terminal Enhancement  
Project Number: 09-6395-000  
CAD File Name: T:\6330\101\Sheets\M02.03.06.dwg  
Description: MECHANICAL PIPING PLAN - LEVEL 3 - ZONE 6  
Date: 10/26/09

Scale: 1/8" = 1'-0"  
©2009 Gensler  
**M02.03.06**