



SHEET NOTES

- EOD INDICATES EDGE OF DECK.
- D1 INDICATES DIRECTION OF SPAN OF BECKING. DECK TO BE 6" LIGHT WEIGHT CONCRETE SLAB ON 18 GAGE 2" THICK COMPOSITE METAL DECK REINFORCED WITH 6#-W2.1x2.1 W/ 1" DIAMETER WELD PATTERN AND SCREWS SIDE LAP CONNECTION PER SPAN. SEE GENERAL NOTES.
- D4 INDICATES DIRECTION OF SPAN OF DECKING. DECK TO BE 5" LIGHT WEIGHT CONCRETE SLAB ON 18 GAGE 2" THICK COMPOSITE METAL DECK WITH 6#-W2.1x2.1 W/ 1" DIAMETER WELD PATTERN AND SCREWS SIDE LAP CONNECTION PER SPAN. SEE GENERAL NOTES.
- INDICATES LOCATION OF MOMENT CONNECTION CAPABLE OF DEVELOPING THE FULL MOMENT CAPACITY OF THE FLEXURAL ELEMENT.
- XBRACE INDICATES LOCATION OF VERTICAL CROSS BRACING, SEE FRAMING ELEVATIONS.
- KB INDICATES LOCATION OF KNEE BRACING BELOW, SEE FRAMING ELEVATIONS.
- BRACE INDICATES LOCATION OF DIAGONAL BRACING BELOW, SEE FRAMING ELEVATIONS.
- 12K (EXAMPLE) INDICATES MEMBER END REACTION IN KIPS.
- (SL) INDICATES SLOPED BEAM.
- (E) INDICATES EXISTING.
- RD INDICATES ROOF DRAIN, SEE ARCHITECTURAL AND MECHANICAL DRAWINGS FOR INFORMATION.
- AESS INDICATES ARCHITECTURALLY EXPOSED STRUCTURAL STEEL.
- INDICATES 8" PIPE SLEEVE OPENING CENTERED IN WEB OF BEAM.

GENERAL NOTES


1. ALL EXISTING CONDITIONS SHALL BE VERIFIED IN THE FIELD PRIOR TO BEGINNING OF ANY WORK. IF EXISTING FIELD CONDITIONS DO NOT PERMIT THE INSTALLATION OF THE WORK IN ACCORDANCE WITH THE DETAILS AS SHOWN, THE CONTRACTOR SHALL NOTIFY THE ARCHITECT IMMEDIATELY AND PROVIDE A SKETCH OF THE CONDITION WITH PROPOSED MODIFICATION FOR REVIEW BY ARCHITECT.
2. CONTRACTOR TO CONFIRM ALL DIMENSIONS AND ELEVATIONS WITH ARCHITECTURAL DRAWINGS PRIOR TO START OF WORK.
3. FINISHED FLOOR ELEVATION = VARIES, RE ARCH TOP OF STEEL ELEVATION = (+) 85'-9" UNLESS NOTED OTHERWISE.
4. FRAMING NOT SPECIFICALLY DIMENSIONED SHALL BE ASSUMED EQUALLY SPACED.
5. SEE SHEET S00.00 FOR GENERAL STRUCTURAL NOTES AND DESIGN LOADS.
6. DIMENSIONS IN PARENTHESIS ARE FOR REFERENCE ONLY.
7. ALL FLOOR FRAMING MEMBERS SHALL BE PROPERLY BRACED BY THE CONTRACTOR UNTIL THE STRUCTURAL FLOOR CONCRETE HAS BEEN COMPLETELY CONSTRUCTED.
8. CONTRACTOR SHALL COORDINATE ALL OPENINGS WITH MECHANICAL DRAWINGS. ALL OPENINGS LARGER THAN 10" DIAMETER OR SQUARE SHALL BE SUPPORTED ON FRAME (SEE SHEET S12.04). ANY OPENING NOT SHOWN ON THIS DRAWING SHALL NOT BE CONSTRUCTED WITHOUT THE ARCHITECT'S APPROVAL.
9. METAL STUD GAGES SHALL BE SELECTED BASED ON THE STUD DEPTHS SHOWN ON THE ARCHITECTURAL PLANS. WIND LOAD = 35 PSF, AND MAXIMUM DEFLECTION OF H/360 OR 0.3" @ BRICK VENEER, H/360 FOR PANEL WALL. - VERTICAL DEFLECTION CLIPS FOR ALL STUDS ATTACHING TO BEAMS.
10. FLOOR SLABS AT THIS LEVEL SHALL BE INSTALLED WITH RADIANT HEAT. COORDINATE W/ ARCH & MECH DWGS.

KEY PLAN

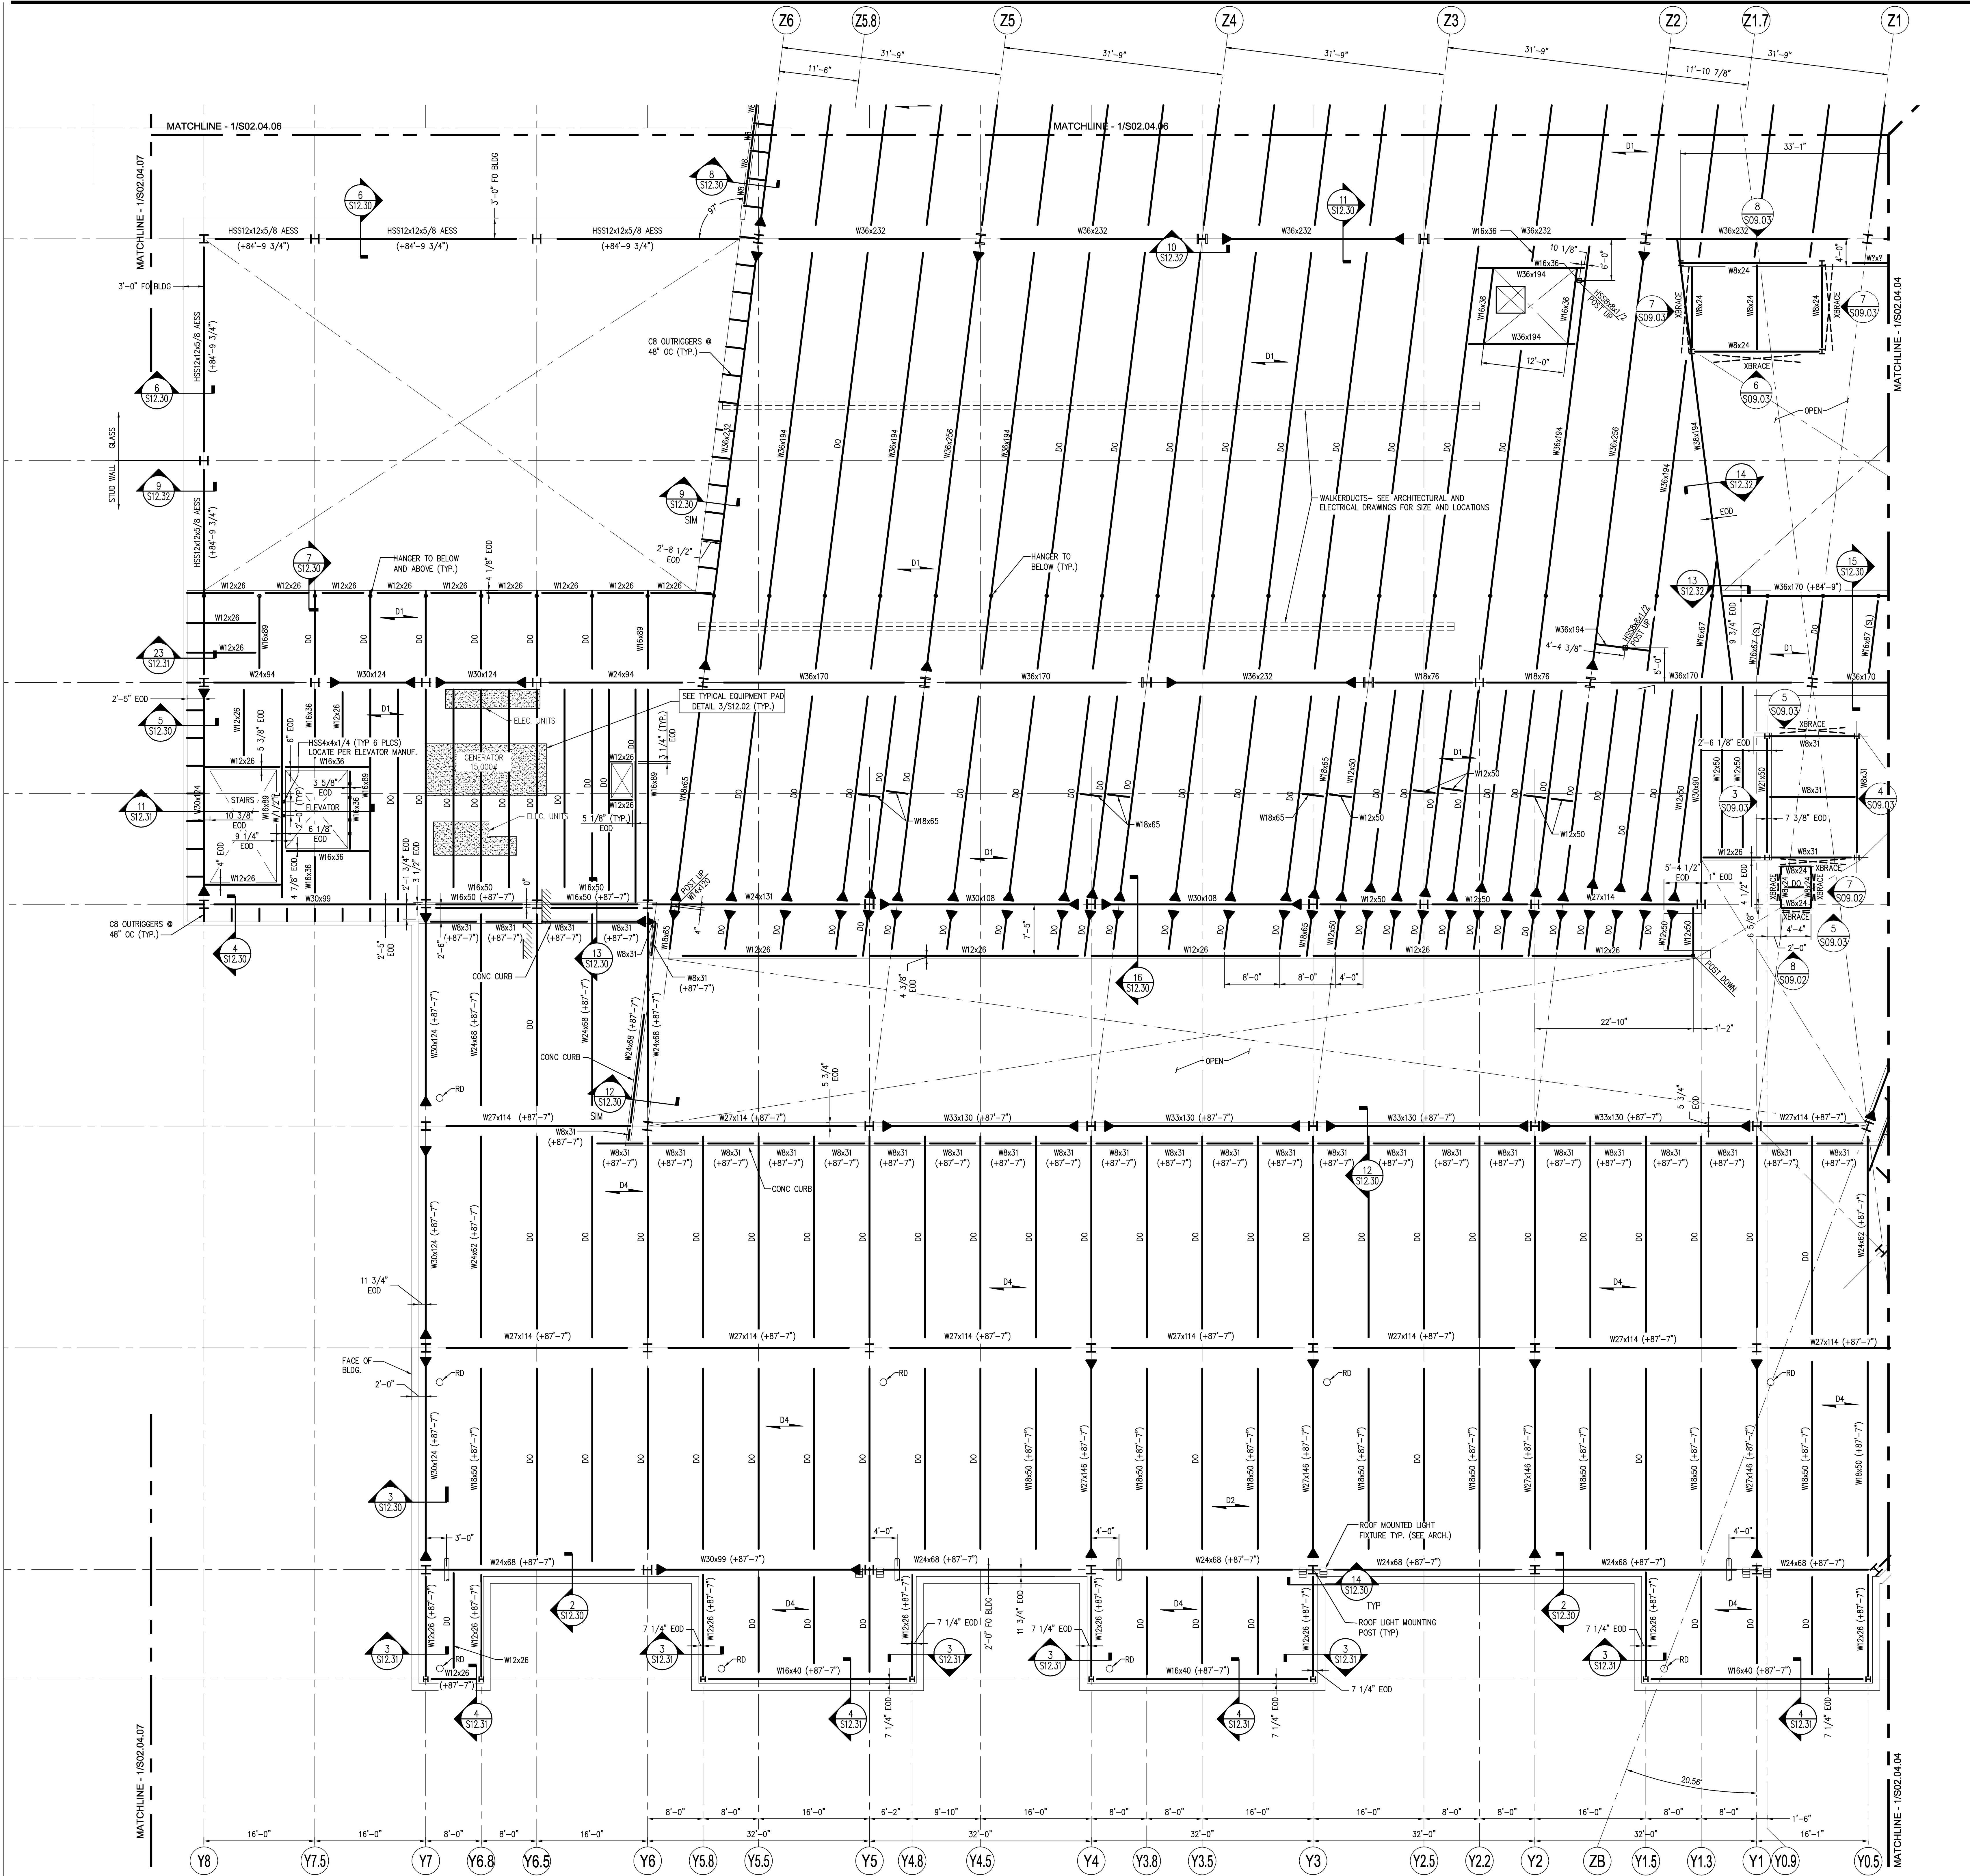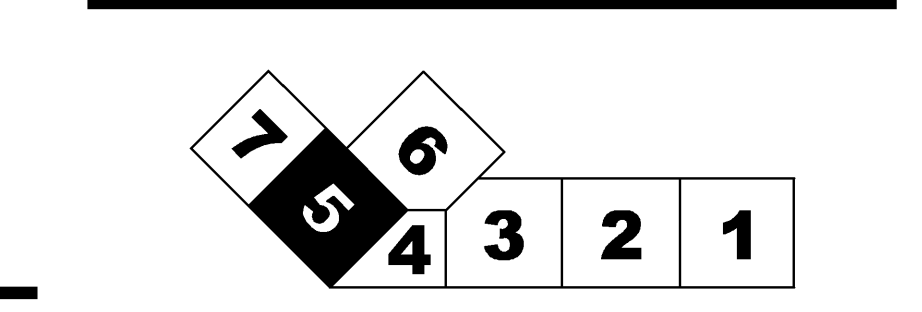

FRAMING PLAN - LEVEL 4 - ZONE 5
SCALE: 1/8" = 1'-0"

Issue	Date & Issue Description	By	Check
01	07/11/08	JDE	---
02	09/22/08	JDE	---
03	12/03/08	JDE	---
04	01/23/09	JDE	---
05	10/26/09	JDE	---

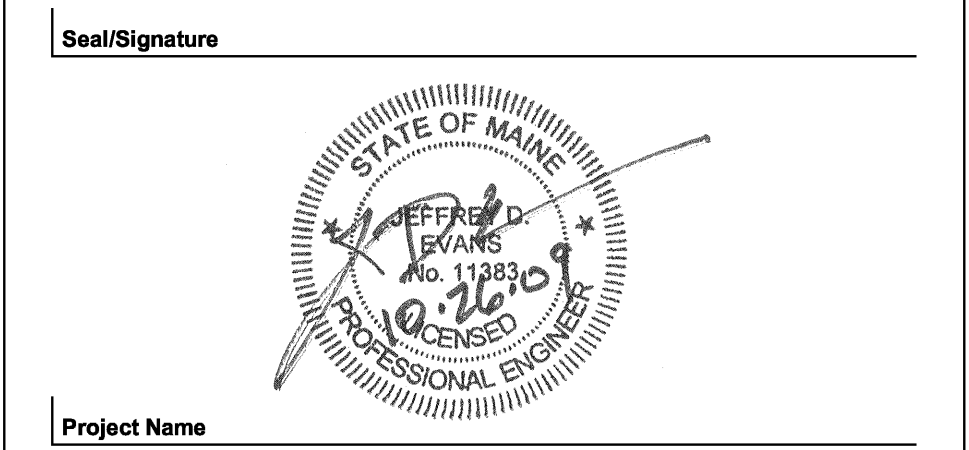

Project Name
PJM Terminal Enhancement

Project Number
09.8396.000

CAD File Name
T:\3330101\SHEETS\S02.04.05.DWG

Description
FRAMING PLAN - LEVEL 4 - ZONE 5

Scale
1/8" = 1'-0"

S02.04.05