

SHEET NOTES

- 01) INSTALL MONITOR MODULE TO MONITOR POST INDICATOR VALVE. CONTRACTOR SHALL MOUNT THE MODULE INSIDE A NEMA BOX AT THE VALVE AND CONDUIT AND CABLE SHALL BE OUTDOOR RATED. FIRE ALARM CONTRACTOR SHALL COORDINATE WITH FIRE PROTECTION AND CIVIL CONTRACTOR PRIOR TO INSTALLATION.

Portland International Jetport


1001 Westbrook Street
Portland, Maine 04102

Gensler

2020 K Street, Northwest
Suite 200
Washington DC 20006
Telephone 202.721.5200
Facsimile 202.872.8587

ARORA
Solutions for Secure Environments

Arora Engineers, Inc.
61 Wilmington - West Chester
Pike
Suite # 100
Chadds Ford, PA 19317
Tel (610) 459-7900
Fax (610) 459-7950

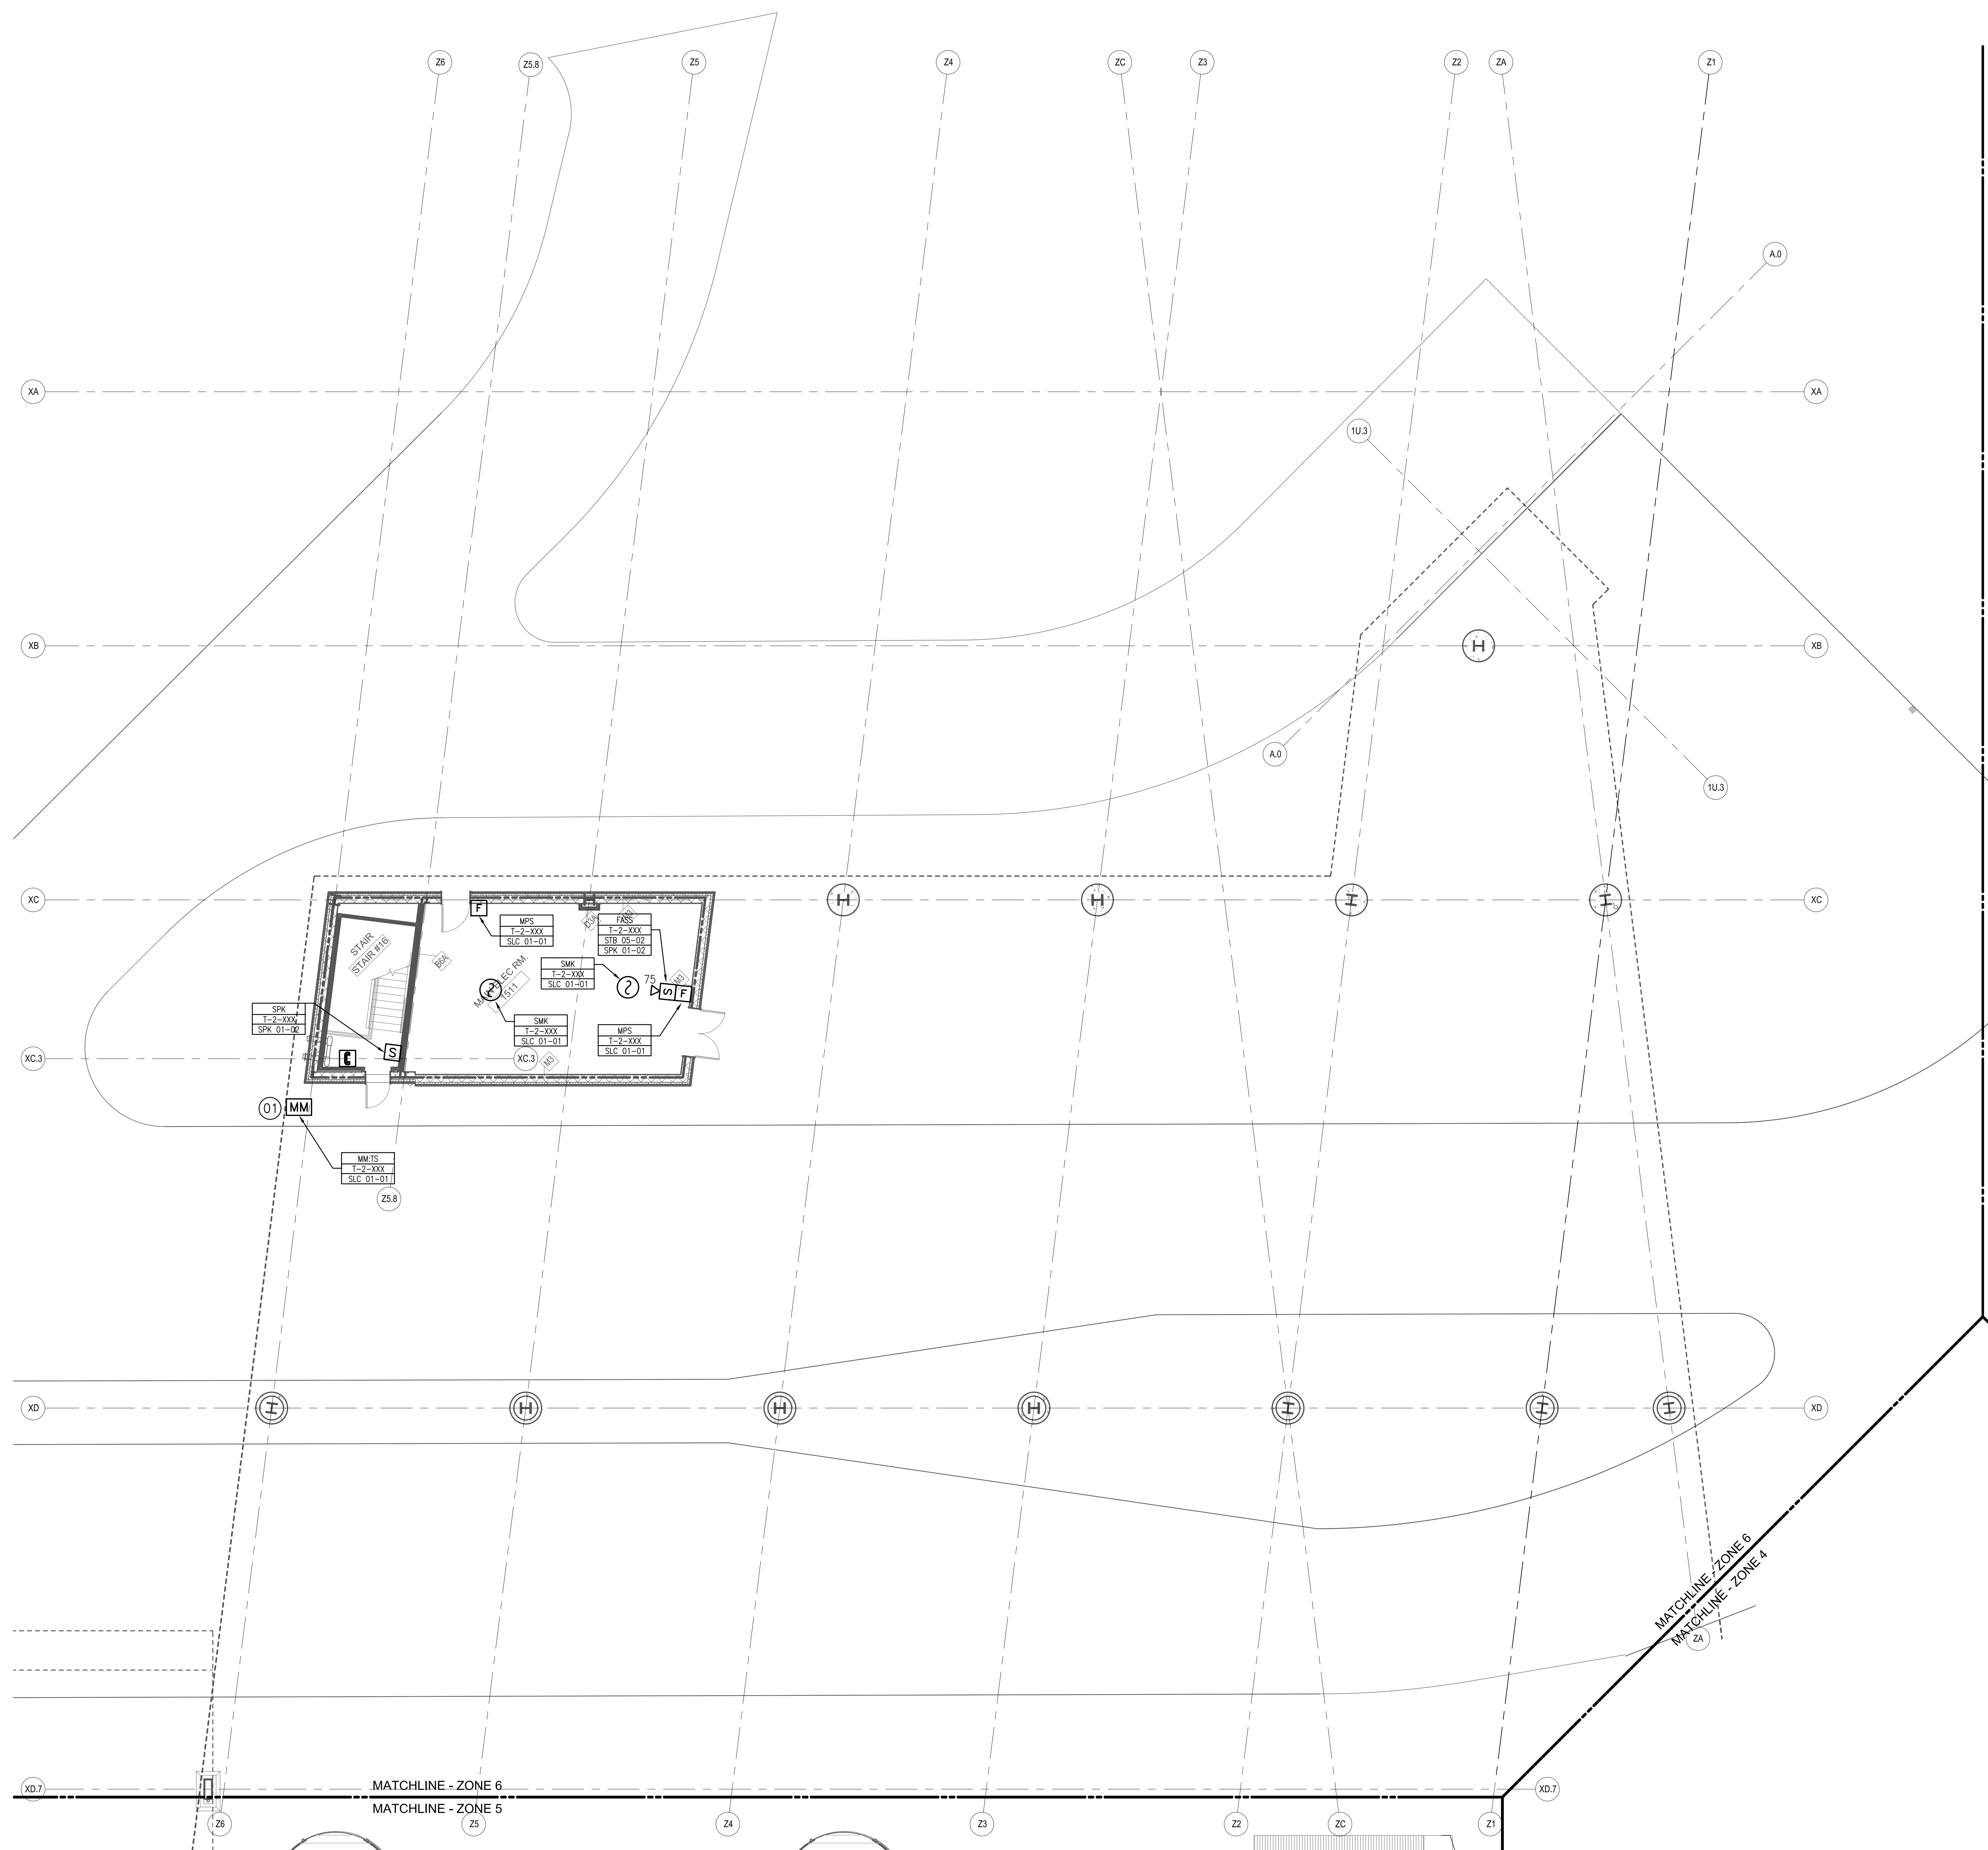


GENERAL NOTES

- A MOUNTING FOR ALL DEVICES SHALL COMPLY WITH IBC 2003, NFPA 90A, NFPA 72, NEC, ADAAG AND ALL APPLICABLE LOCAL CODES.
- B VISUAL NOTIFICATION APPLIANCES SHALL BE SET TO THE CANDELA RATING ASSIGNED ON THE DRAWINGS. SPEAKERS SHALL BE TAPPED AT THE WATTAGE SELECTED BY THE SYSTEM MANUFACTURER ON THE APPROVED SHOP DRAWINGS.
- C IN CASES WHERE AN APPLIANCE CANNOT BE LOCATED WHERE SHOWN ON THE DRAWINGS, DUE TO PHYSICAL RESTRICTIONS, NOTIFICATION APPLIANCES MAY BE ABLE TO BE MOVED TO CEILING MOUNT DEVICES UPON APPROVAL BY THE ENGINEER. UPON APPROVAL, DEVICES SHALL BE UL LISTED FOR CEILING MOUNTED APPLICATIONS.
- D MORE THAN TWO VISIBLE NOTIFICATION APPLIANCES OR GROUPS OF VISIBLE NOTIFICATION APPLIANCES IN THE SAME ROOM OR ADJACENT SPACE WITHIN THE SAME FIELD OF VIEW SHALL FLASH IN SYNCHRONIZATION. THIS SHALL INCLUDE SYNCHRONIZATION OF STROBES OPERATED BY SEPARATE SYSTEMS.
- E ALL WIRE AND CABLE SHALL BE INSTALLED IN ELECTRICAL METALLIC TUBING (EMT) AT ALL LOCATIONS INDOORS AND RIGID METAL CONDUIT OUTDOORS. THE MINIMUM CONDUIT SIZE SHALL BE 3/4"

Issue	Date & Issue Description	By	Check
	10/26/09		
	100% ISSUED FOR PERMIT		

Seal/Signature

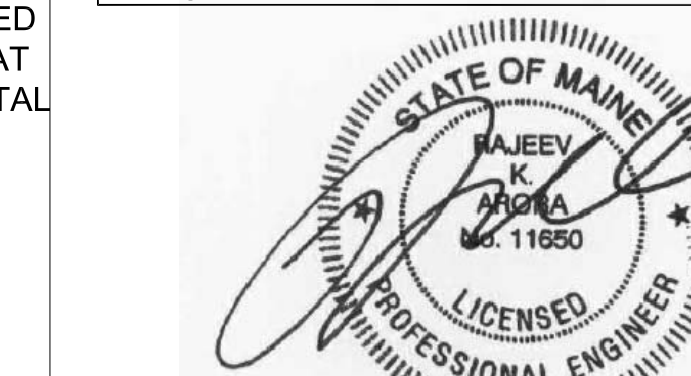

Project Name

PWM TERMINAL EXPANSION

Project Number

CAD File Name

FA02.02.06


Description

FIRE ALARM CONSTRUCTION PLAN - LEVEL 2 - ZONE 6

Scale

As Indicated

KEY PLAN

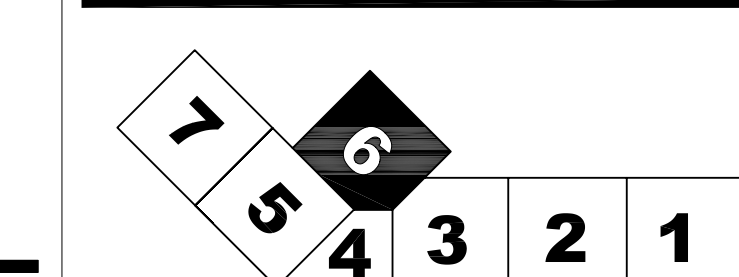

FA02.02.06

© 2006 Gensler

LEVEL 2 - ZONE 6

SCALE: 1/8"=1'-0"