

SHEET NOTES

- 01 HEAT DETECTORS SHALL BE INSTALLED WITHIN 2' OF EACH SPRINKLER HEAD THAT SERVES THE ELEVATOR MACHINE ROOM TO ACTIVATE THE ELEVATOR SHUNT TRIP. FINAL QUANTITIES AND LOCATIONS OF HEAT DETECTORS SHALL BE DETERMINED BY THE CONTRACTOR.
- 02 CONTRACTOR SHALL BE RESPONSIBLE FOR THE INSTALLATION OF TRANSPONDER CABINET. LOCATION OF THE CABINET SHALL BE COORDINATED WITH OTHER TRADES. SEE FA12.00 FOR POWER SUPPLY DETAIL.
- 03 MODULES SHALL BE INSTALLED ADJACENT TO DIP PANEL AND TIED INTO THE SECURITY SYSTEM. COORDINATE WITH THE SECURITY CONTRACTOR FOR FINAL LOCATION OF THE MODULE. SEE FA12.01 FOR FURTHER DETAIL.
- 04 CONTRACTOR SHALL COORDINATE WITH OTHER TRADES AND BE RESPONSIBLE FOR FINAL LOCATIONS AND QUANTITIES OF MODULES MONITORING FLOW AND TAMPER SWITCHES.
- 05 SMOKE DETECTOR LOCATED AT EACH ELEVATOR LOBBY SHALL BE CAPABLE OF INITIATING ELEVATOR RECALL. LOBBY SMOKE DETECTOR SHALL BE INSTALLED PER NFPA72 AND THE LOCATION OF THE DETECTOR SHALL BE APPROVED BY THE ARCHITECT PRIOR TO INSTALLATION.
- 06 PROVIDE TWO (2) JUNCTION BOXES FOR EVERY CONCESSION SPACE. EACH JUNCTION BOX SHALL BE RUNNING AN SLC CIRCUIT AND A NAC CIRCUIT FOR SPEAKER IN SEPARATE BOXES. CONTRACTOR SHALL PROVIDE ENOUGH SLACK IN CABLE IN THE EVENT OF CIRCUIT EXTENSIONS IN THE FUTURE. MOUNT THE BOXES WITHIN THE SOFFIT AREA AND COORDINATE FINAL LOCATION WITH THE ARCHITECT PRIOR TO INSTALLATION.

Portland International Jetport
 1001 Westbrook Street
 Portland, Maine 04102

Gensler

2020 K Street, Northwest
 Suite 200
 Washington DC 20006
 Telephone 202.721.5200
 Facsimile 202.872.8587


ARORA
 Solutions for Secure Environments

Arora Engineers, Inc.
 61 Wilmington - West Chester Pike
 Suite #100
 Chadds Ford, PA 19317
 T: (610) 459-7900
 F: (610) 459-7950

GENERAL NOTES

- A MOUNTING FOR ALL DEVICES SHALL COMPLY WITH IBC 2003, NFPA 90A, NFPA 72, NEC, ADASG AND ALL APPLICABLE LOCAL CODES.
- B VISUAL NOTIFICATION APPLIANCES SHALL BE SET TO THE CANDELA RATING ASSIGNED ON THE DRAWINGS. SPEAKERS SHALL BE TAPPED AT THE WATTAGE SELECTED BY THE SYSTEM MANUFACTURER ON THE APPROVED SHOP DRAWINGS.
- C IN CASES WHERE AN APPLIANCE CANNOT BE LOCATED WHERE SHOWN ON THE DRAWINGS, DUE TO PHYSICAL RESTRICTIONS, NOTIFICATION APPLIANCES MAY BE ABLE TO BE MOVED TO CEILING MOUNT DEVICES UPON APPROVAL BY THE ENGINEER. UPON APPROVAL, DEVICES SHALL BE UL LISTED FOR CEILING MOUNTED APPLICATIONS.
- D MORE THAN TWO VISIBLE NOTIFICATION APPLIANCES OR GROUPS OF VISIBLE NOTIFICATION APPLIANCES IN THE SAME ROOM OR ADJACENT SPACE WITHIN THE SAME FIELD OF VIEW SHALL FLASH IN SYNCHRONIZATION. THIS SHALL INCLUDE SYNCHRONIZATION OF STROBES OPERATED BY SEPARATE SYSTEMS.

Issue	Date & Issue Description	By	Check
	10/26/09		
	100% ISSUED FOR PERMIT		

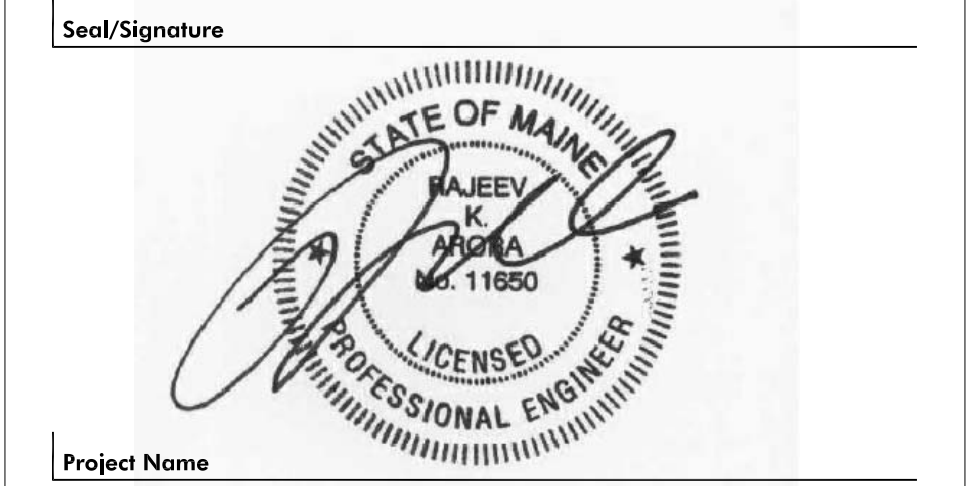

Project Name
PJM TERMINAL EXPANSION

Project Number

CAD File Name
FA02.03.05


Description
FIRE ALARM CONSTRUCTION PLAN - LEVEL 3 - ZONE 5

Scale
As Indicated

FA02.03.05

© 2006 Gensler

KEY PLAN

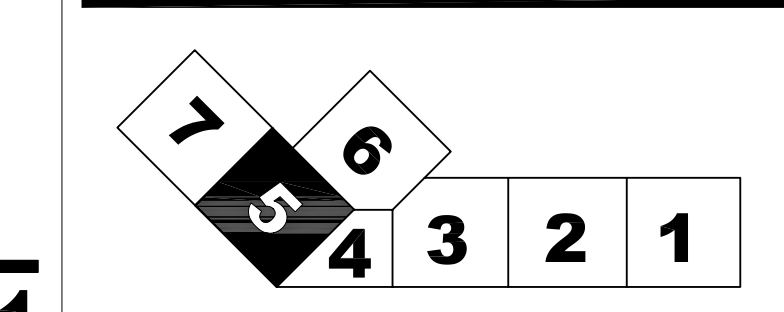

LEVEL 3 - ZONE 5

SCALE: 1/8"=1'-0"