

- ### SHEET NOTES
- COORDINATE SPRINKLER LOCATION & PIPING WITH MECHANICAL DUCTWORK IN SAME CEILING BAY. FOLLOW OBSTRUCTION RULES OF NFPA 13.
 - UPRIGHT SPRINKLERS ABOVE 8' AFF ACT CEILING WITH BAGGAGE HANDLING CONVEYORS AT SLAB LEVEL. SPRINKLER PIPING TO ALSO DROP TO CONCEALED PENDANT SPRINKLERS AT ACT CEILING LEVEL.
 - UNIT HEATER - COORDINATE SPRINKLER TEMPERATURE RATINGS WITH THIS & ALL HEAT SOURCES PER NFPA 13(TYPICAL).

Portland International Jetport
 1001 Westbrook Street
 Portland, Maine 04102

Gensler
 2020 K Street, NW
 Suite 200
 Washington, DC 20006
 Telephone 202.721.5200
 Facsimile 202.872.8587

oest ASSOCIATES, INC.
 340 Capron Road South Portland, ME 04106 P (207) 761-1770 F (207) 774-1242 www.oest.com
 engineers • architects • surveyors • construction managers





GENERAL NOTES

A SEE SHEET FP00.01 FOR LEGEND, SCHEDULES & GENERAL NOTES.

Issue	Date & Issue Description	By	Check
01	07/11/08	PWZ	RHB
02	09/22/08	SKD	WMC
03	12/03/08	SKD	WMC
04	01/23/09	MHY	JLD
05	10/26/09	JLD	SKD

KEY PLAN

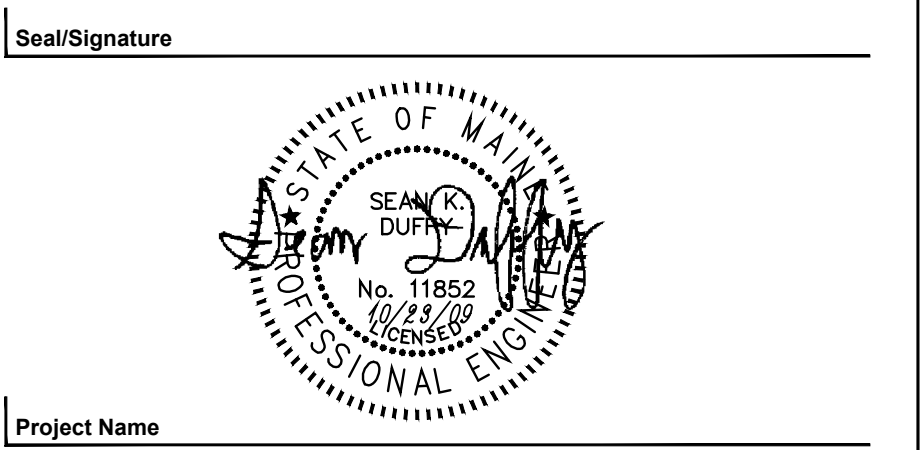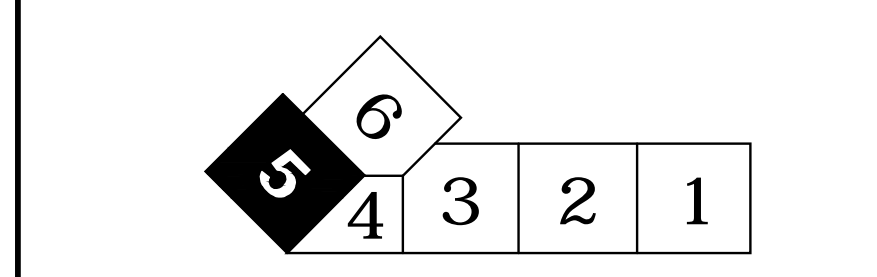

Project Name
PJM Terminal Expansion

Project Number
08.0395.000
CAD File Name
FP04.02.05
Description
FIRE PROTECTION PLAN - LEVEL 2 - ZONE 5

Scale
1/8" = 1'-0"

FP04.02.05