

SHEET NOTES

- 01 UNIT HEATER - COORDINATE SPRINKLER TEMPERATURE RATINGS PER NFPA 13.
- 02 SPRINKLERS AND PIPING MUST BE INSTALLED A MINIMUM OF 8'-1" ABOVE FINISHED FLOOR IN ANY LOCATIONS WHERE BAGGAGE CARTS CAN BE DRIVEN. THIS NOTE IS APPLICABLE TO ALL BAGGAGE HANDLING AREAS.

Portland International Jetport
 1001 Westbrook Street
 Portland, Maine 04102

Gensler
 2020 K Street, NW
 Suite 200
 Washington, DC 20006
 Telephone 202.721.5200
 Facsimile 202.872.8587


oest ASSOCIATES, INC.
 345 Gophers Road South Portland, ME 04106 P: (207) 761-1770 F: (207) 774-1244 www.oest.com
 engineers • architects • surveyors • construction managers

FIRE RISK MANAGEMENT, INC.
 1 Front Street
 South Portland, ME 04106 P: (207) 442-7200
 www.fire-risk.com

GENERAL NOTES

A SEE SHEET FP00.01 FOR LEGEND, SCHEDULES & GENERAL NOTES.

Issue	Date & Issue Description	By	Check
01	12/17/08		
02	TSA 70% SUBMISSION		
02	01/23/09	DMY	MHY JLD
	95% CONSTRUCTION DOCUMENTS		
03	10/26/09	JLD	SKD
	ISSUED FOR PERMIT		

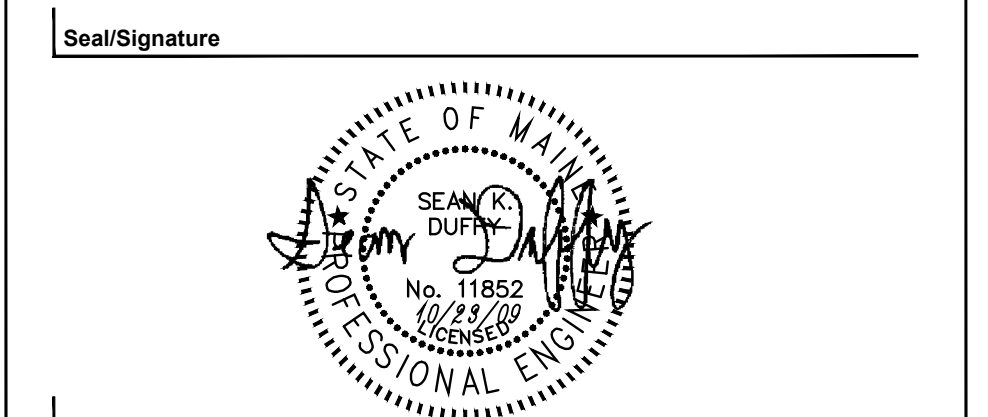

Project Name
 P1W Terminal Expansion

Project Number
 08.0395.000

CAD File Name
 FP04.02.04.dwg

Description
 FIRE PROTECTION PLAN - LEVEL 2 - ZONE 4

Scale
 1/8" = 1'-0"

Ref. North

FP04.02.04

©2009 Gensler

FIRE PROTECTION PLAN - LEVEL 2 - ZONE 4

SCALE: 1/8"=1'-0"