

**POWER & COMMUNICATION - LEVEL 4 - ZONE 6**

SCALE: 1/8" = 1'-0"

A01.DS4


**SHEET NOTES**

- 01 REFER TO ENGINEERING DRAWINGS, E02 SERIES FOR ADDITIONAL INFORMATION
- 02 ALL OUTLET LOCATIONS TO BE LAID OUT PER APPROVED TSA LANE CONFIGURATIONS. CONFIRM OUTLET TYPES PER APPROVED TSA EQUIPMENT. TYPICAL AT ALL TSA AREAS.
- 03 COORDINATE POWER REQUIREMENTS AND LOCATIONS WITH SECURITY, IT AND FIRE ALARM EQUIPMENT. RE: ENGINEERING DRAWINGS, SS, TC AND FA SERIES FOR ADDITIONAL INFORMATION
- 04 COORDINATE POWER REQUIREMENTS AND LOCATION FOR ILLUMINATED ADVERTISEMENT WITH VENDOR AND CONFIRM MOUNTING WITH ARCHITECT.
- 05 REFER TO ENGINEERING DRAWINGS FOR POWER AND LIGHTNING PROTECTION REQUIREMENT ON ALL ROOF LEVELS.
- 06 WALKER DUCT. RE: ELECTRICAL DRAWINGS FOR ADDITIONAL INFORMATION.
- 07 SURFACE MOUNTED
- 08 COORDINATE EXACT LOCATION AND POWER REQUIREMENTS. PLACE STUB UP WITHIN PYLONMILLWORK. REFER TO DETAIL SHEET XX.XX
- 09 RECEPTACLES TO BE TERMINATED ABOVE FINISHED CEILING AND NOT VISIBLE TO THE PUBLIC. COORDINATE MOUNTING OF CPU. REFER TO TC.02 SERIES FOR ADDITIONAL INFORMATION
- 10 COORDINATE OVERHEAD AND IN-WALL ROUTING FROM IDF ROOM 3508 TO WALKER DUCT. ROUTING SHOWN FOR DIAGRAMMATICAL PURPOSES ONLY.
- 11 COORDINATE IN-WALL AND UNDERSLAB ROUTING FROM ELEC. CLOSET 3516 TO WALKER DUCT. ROUTING SHOWN FOR DIAGRAMMATICAL PURPOSES ONLY. DO NOT RUN CONDUIT IN SLAB, RADIANT FLOORING INSTALLATION IN THIS AREA.

**GENERAL NOTES**

- A COORDINATE ALL WALL MOUNTED DEVICES WITH ASSOCIATED PARTITION TYPES AND FIRE RATING REQUIREMENTS. SEE ALIGNMENT LOCATIONS OF DEVICES ON SHEET A00.13
- B COORDINATE ALL CEILING MOUNTED DEVICES WITH ASSOCIATED CEILING TYPES, LIGHT FIXTURE AND EQUIPMENT DEPTHS AND ALL REQUIRED SYSTEMS CLEARANCES.
- C REFER TO EQUIPMENT SCHEDULE IN PROJECT MANUAL SECTION APPENDIX 'A'.
- D REFER TO ELECTRICAL DRAWINGS FOR OUTLET TYPES.
- E REFER TO ELECTRICAL, FIRE ALARM, IT AND SECURITY DRAWINGS, PROJECT MANUAL FOR ADDITIONAL INFORMATION.
- F REFER TO MANUFACTURER AND LOCAL CODE REQUIREMENTS FOR ELEVATOR AND ESCALATOR INSTALLATIONS.
- G REFER TO ELECTRICAL DRAWINGS FOR GFI OUTLET LOCATIONS.
- H PROVIDE ELECTRICAL ROUTING AND IT STUB-UP AT TICKET COUNTERS. 1 SET OF STUB UP FOR EVERY 4 COUNTERS. REFER TO ELECTRICAL AND IT DRAWINGS FOR CABLE AND CIRCUIT INFORMATION. SIZE STUB UP ACCORDINGLY.
- I PROVIDE WEATHER PROOF DEVICES AT LOCATIONS WHERE REQUIRED.
- J COORDINATE POWER/DATA ROUTING REQUIREMENTS WITH DOOR HARDWARE. RELAY TIE IN WITH FIRE ALARM SYSTEM AS INDICATED OR REQUIRED BY CODE. ALSO REFER TO SECURITY DRAWINGS.
- K REFER TO PARTITION TYPES FOR ADDITIONAL INFORMATION ON FIRE RATED ASSEMBLIES. FIRESTOPPING SHALL BE PROVIDED AS REQUIRED BY CODE.
- L COORDINATE ALL FLOOR BOXES, CORE DRILLS AND STUB-UPS, ETC. WITH RADIANT FLOORING LAYOUT AND INSTALLATION. DO NOT RUN CONDUITS WITHIN SLAB.

**KEY PLAN**

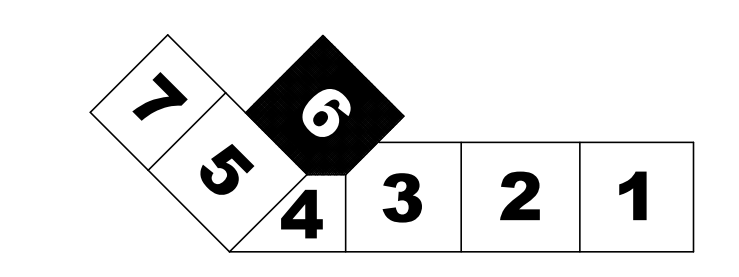

**Portland International Jetport**  
1001 Westbrook Street  
Portland, Maine 04102

**Gensler**  
2020 K Street, Northwest  
Suite 200  
Washington DC 20006  
Telephone 202.721.5200  
Facsimile 202.872.8587

Issue	Date & Issue Description	By	Check
01	08/22/09		
02	DESIGN DEVELOPMENT		
03	75% CONSTRUCTION DOCUMENTS		
04	95% CONSTRUCTION DOCUMENTS		
04	10/28/09		
	ISSUED FOR PERMIT		

Seal/Signature  
  
 Project Name  
 PWM Terminal Enhancement

Project Number  
 09-6395-000  
 Description  
 POWER & COMMUNICATION PLAN - LEVEL 4 - ZONE 6

Scale  
 As indicated

**A03.04.06**

© 2009 Gensler