


TYPE	STUD SIZE	STUD GA	STUD SPACING	GYP BD THK/TYP	WALL THK	ATTENUATION THICKNESS	FIRE RATING	UL NUMBER	STC RATING
Q3A	3 5/8"	20	16"	5/8"	RE. PLAN	3 1/2" BATT	3HR	U419	-

**PARTITION TYPE Q**


SCALE: 3" = 1'-0"

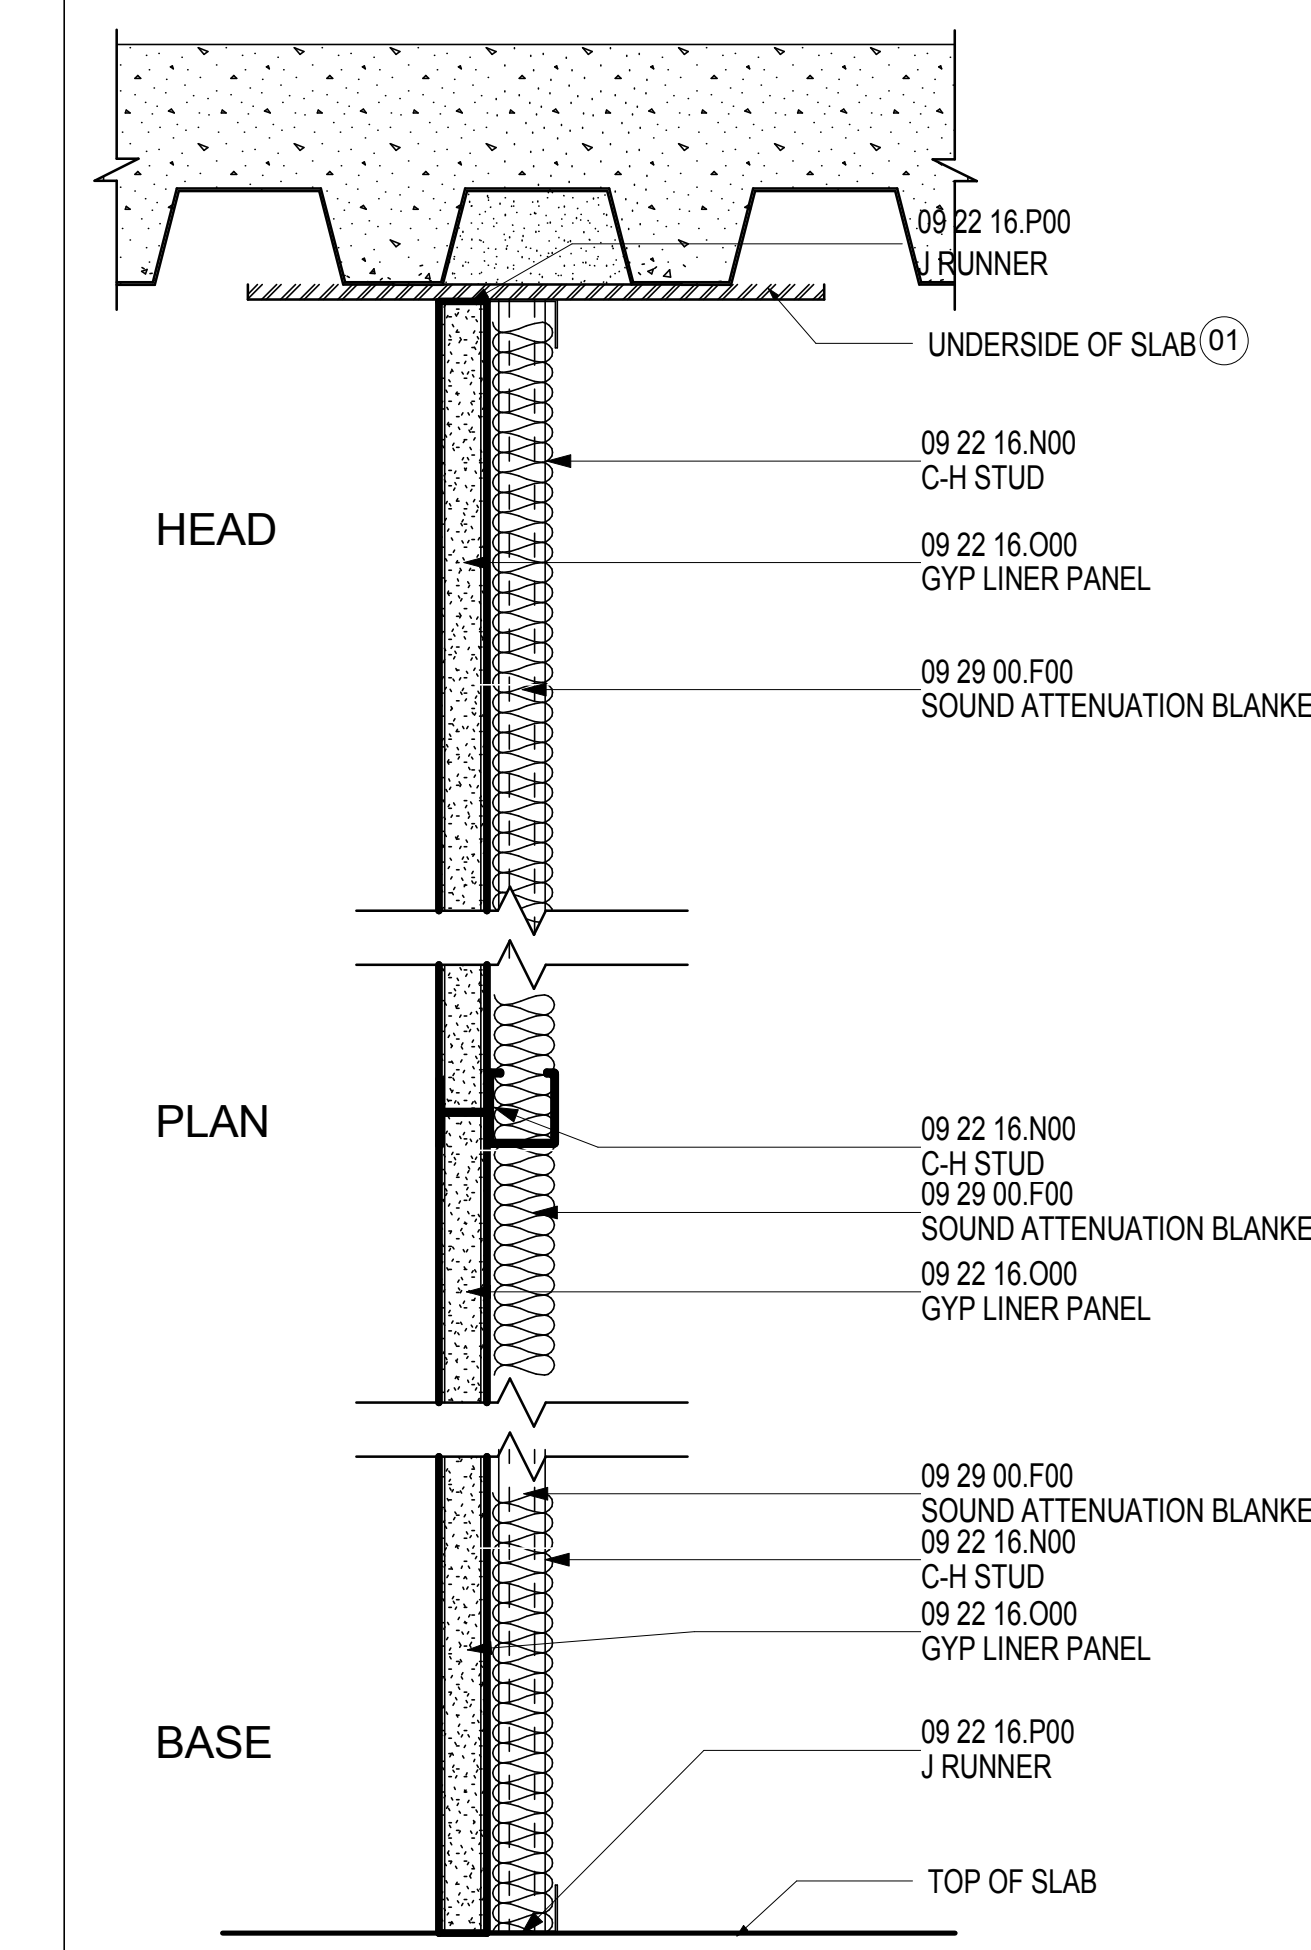

TYPE	STUD SIZE	STUD GA	STUD SPACING	GYP BD THK/TYP	WALL THK	ATTENUATION THICKNESS	FIRE RATING	UL NUMBER	STC RATING
N6A	6"	20	24" OC	1"	6"	2" BATT	-	-	-

**PARTITION TYPE N**


SCALE: 3" = 1'-0"

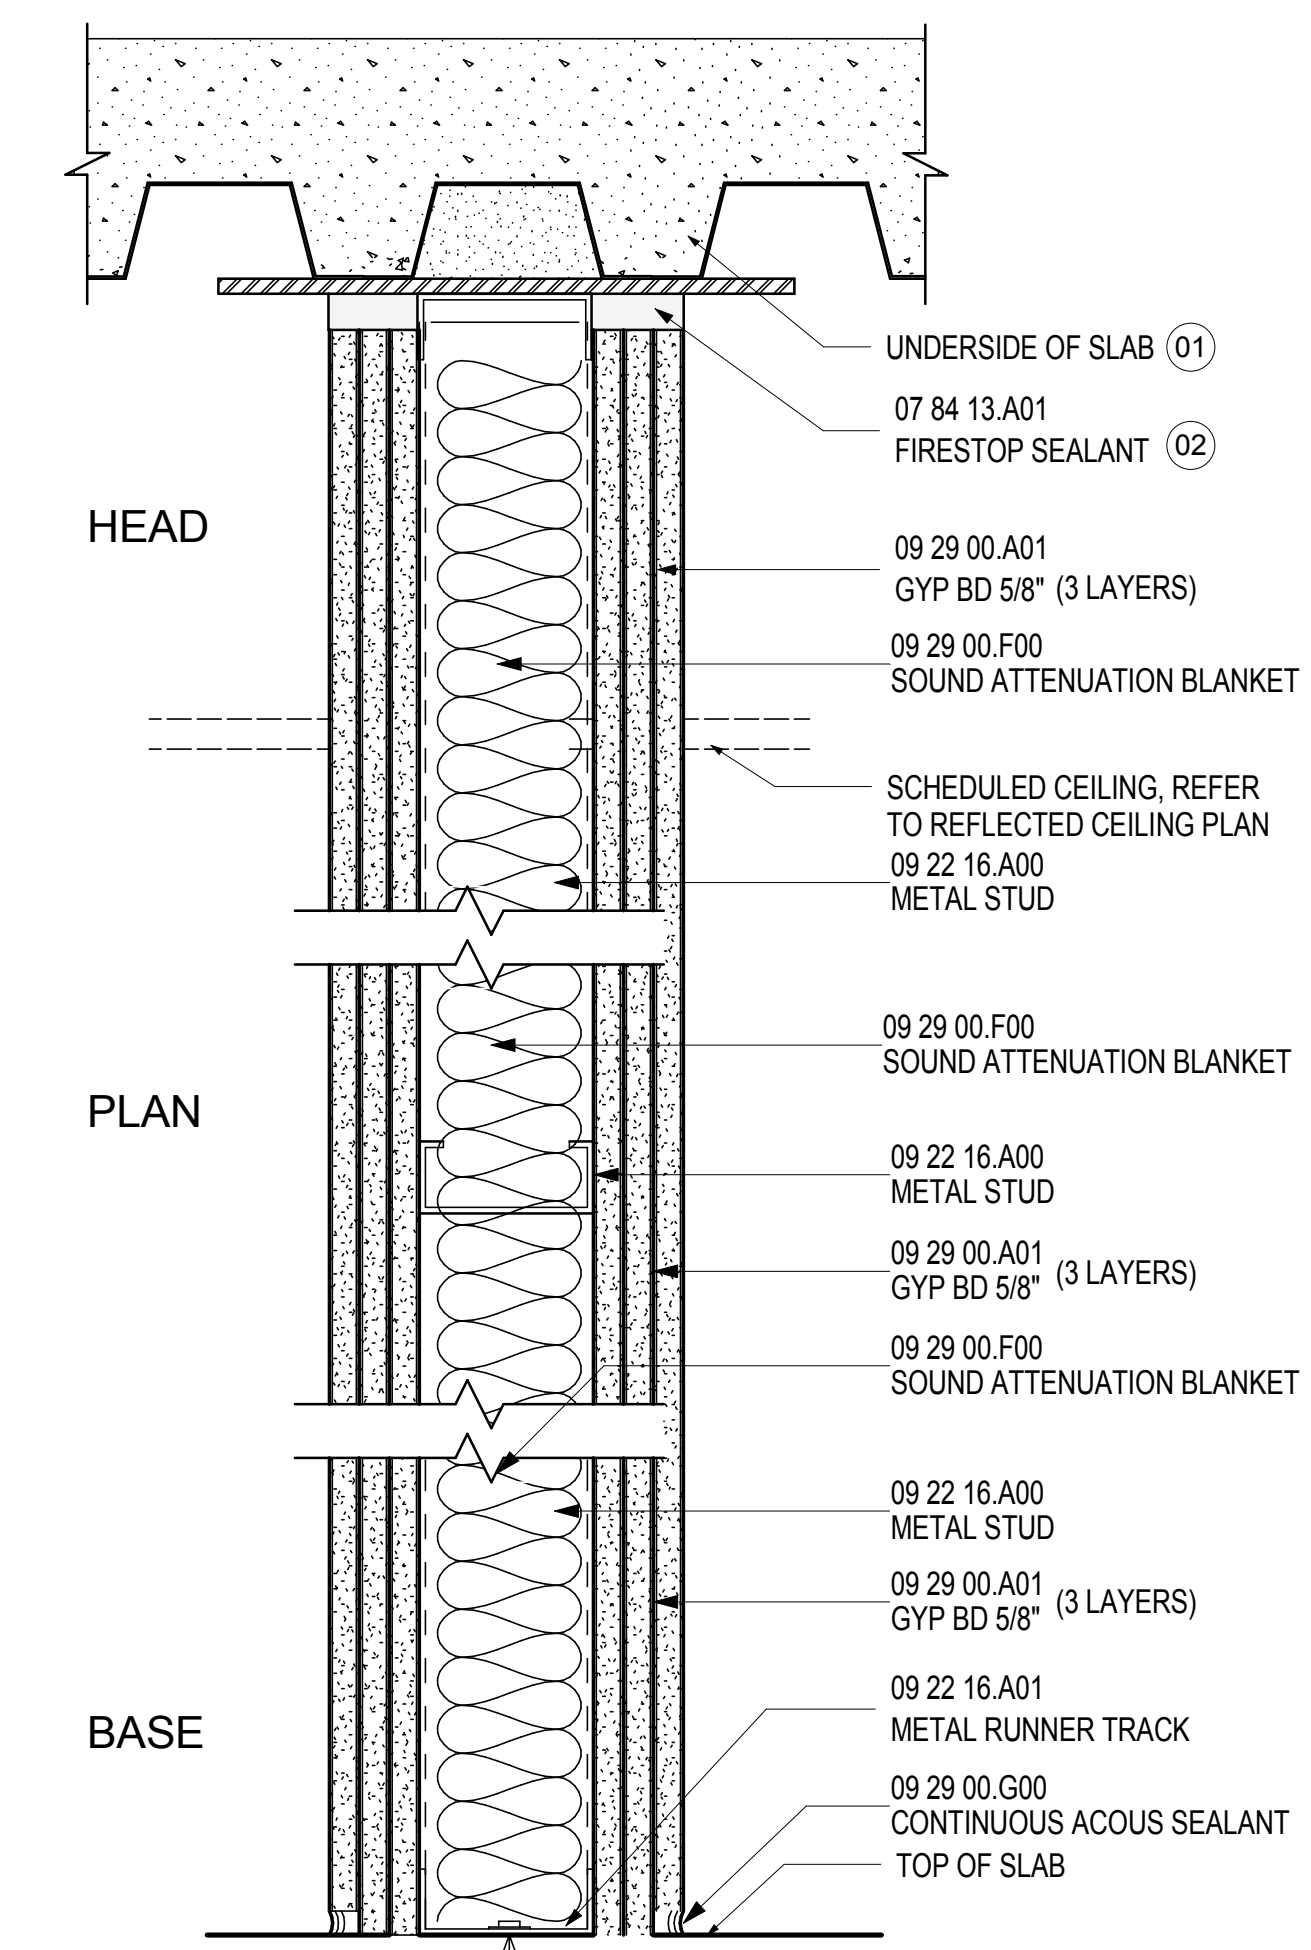

TYPE	STUD SIZE	STUD GA	STUD SPACING	GYP BD THK/TYP	WALL THK	ATTENUATION THICKNESS	FIRE RATING	UL NUMBER	STC RATING
L3A	3 5/8"	20	16"	5/8"	7 3/8"	3 1/2" BATT	3HR	U419	-
L3B	3 5/8"	20	16"	**AR 5/8"	7 3/8"	3 1/2" BATT	3HR	U419	-

**PARTITION TYPE L**


SCALE: 3" = 1'-0"

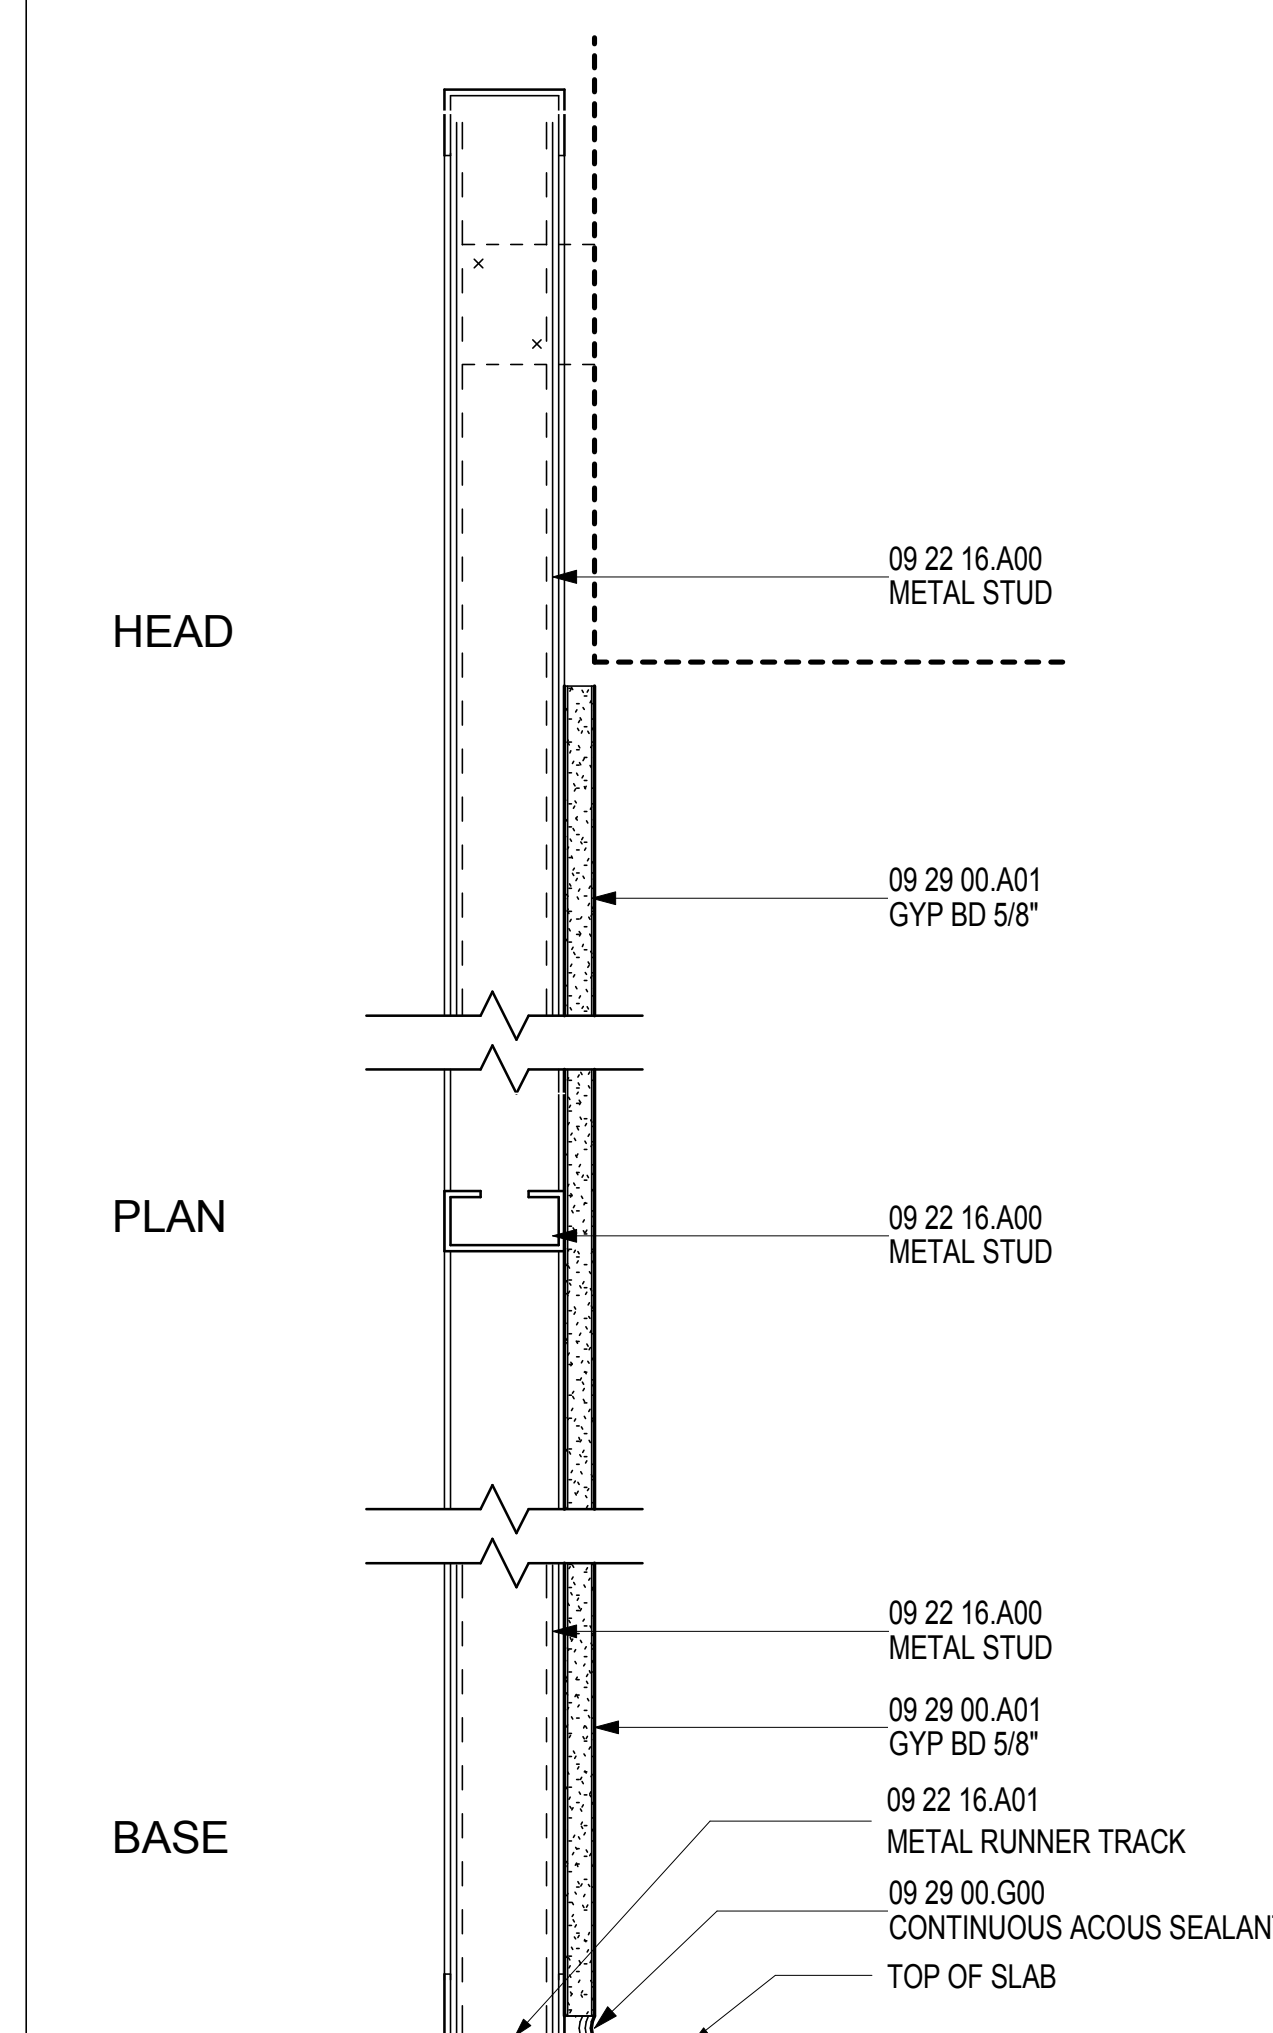

TYPE	STUD SIZE	STUD GA	STUD SPACING	GYP BD THK/TYP	WALL THK	ATTENUATION THICKNESS	FIRE RATING	UL NUMBER	STC RATING
P3A	3 5/8"	20	16" OC	5/8"	4 1/4"	-	-	-	-

**PARTITION TYPE P (DEMISING)**

SCALE: 3" = 1'-0"

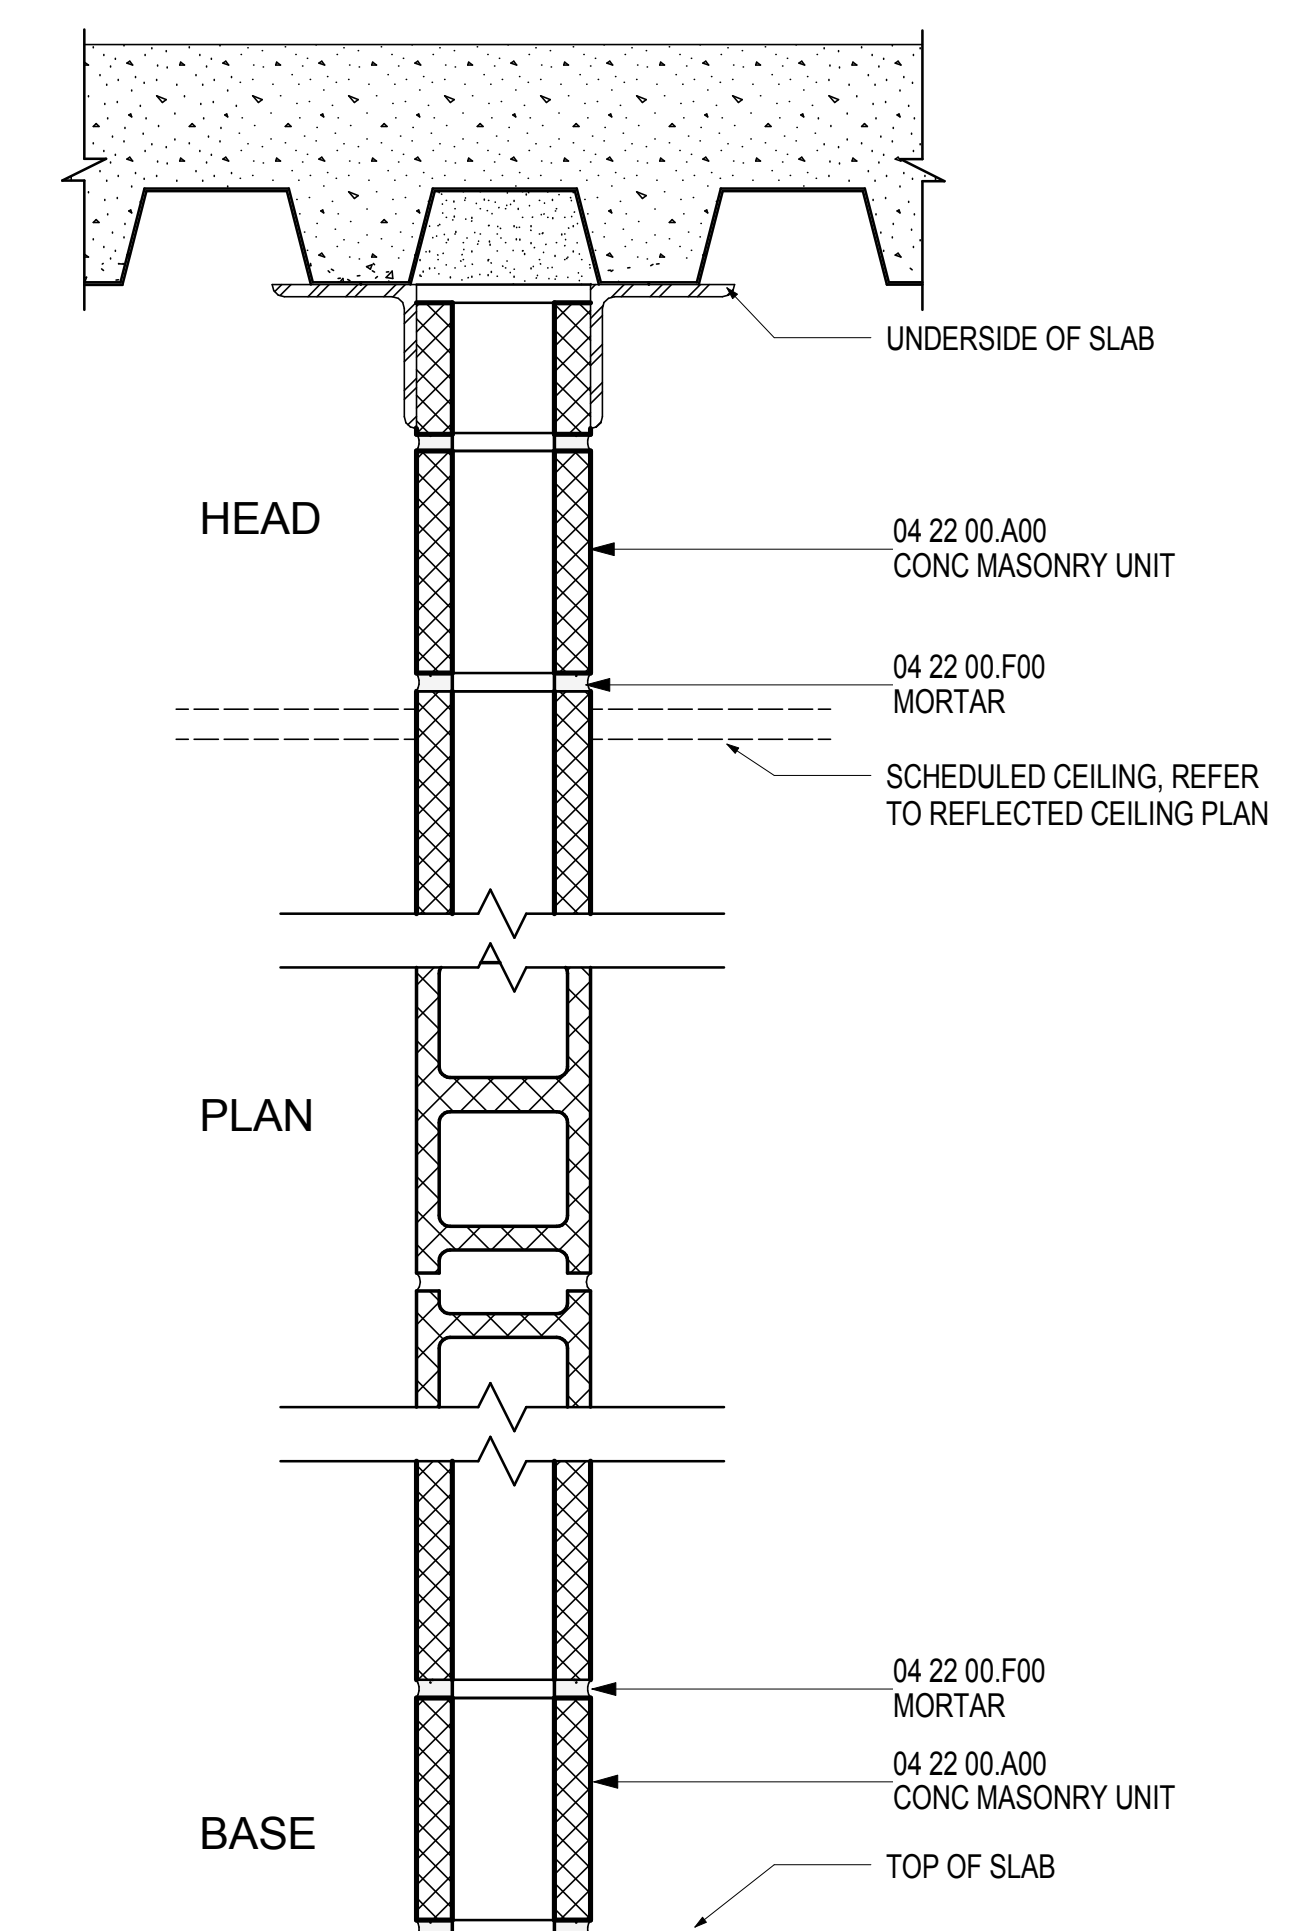

\* FULLY GROUTED

TYPE	BLOCK SIZE	WALL THK	FIRE RATING	UL NUMBER	STC RATING
M1A	8"	-	-	-	-
M1B	8"	-	2 HR	U901	-
M2	8"	-	3 HR	U901	-
M3	12"	-	2 HR	U901	-

**PARTITION TYPE M**

SCALE: 3" = 1'-0"

**SHEET NOTES**

- 01 16 GA CLOSURE PLATE AS REQUIRED TO ATTACHED TOP TRACK TO METAL DECK, TYP.
- 02 FIRESAFING AS REQUIRED TO MAINTAIN RATING.
- 03 FLUSH WALL BASE WHERE OCCURS. COORDINATE WITH FINISHES AND DETAILS.
- 04 RUN GYPSUM BOARD TO UNDERSIDE OF SLAB AT SPECIFIED WALL TYPES.

**GENERAL NOTES**

**Portland International Jetport**  
1001 Westbrook Street  
Portland, Maine 04102

**Gensler**  
2020 K Street, Northwest  
Suite 200  
Washington, DC 20006  
Telephone 202.721.5200  
Facsimile 202.872.8587

Issue	Date & Issue Description	By	Check
01	01/21/09		
03	10/26/09		

Seal/Signature



Project Name  
PWM Terminal Enhancement

Project Number  
09-6395-000

Description  
PARTITION TYPES

Scale  
3" = 1'-0"

**A12.61**

© 2009 Gensler