


SHEET NOTES

- 01 PROVIDE GRID TYPE RECEPTACLES IN THE ESCALATOR LOWER LEVEL MACHINE SPACE. COORDINATE LOCATION AND INSTALLATION WITH THE ESCALATOR CONTRACTOR.
- 02 PROVIDE PULL BOX FOR CONNECTION TO BAGGAGE HANDLING SYSTEMS POWER FROM MAIN ELECTRICAL PANELS. PIP SHALL BE PROVIDED BY BAGGAGE HANDLING CONSULTANTS. CONTRACTOR SHALL MOUNT PULL BOX ABOVE PIP AND AND LEAVE OFF OF EXTRA CABLE COILED NEATLY. TERMINATION OF CONDUCTORS IN PIP WILL BE DONE BY OTHERS. SEE SHEET E1201 FOR CONDUIT AND WIRE SIZES.
- 03 SEE ONE-LINE DIAGRAM ON SHEET E1201 FOR CONDUIT AND CONDUCTOR SIZES ASSOCIATED WITH THIS EQUIPMENT.

Portland International Jetport
 1001 Westbrook Street
 Portland, Maine 04102

Gensler
 2024 K Street, NW
 Washington, DC 20006
 Telephone 202.221.5200
 Facsimile 202.672.5297

oast ASSOCIATES, INC.
 2001 Park Street, NW
 Washington, DC 20006
 Telephone 202.221.5200
 Facsimile 202.672.5297
 engineers • architects • interior architects • construction managers

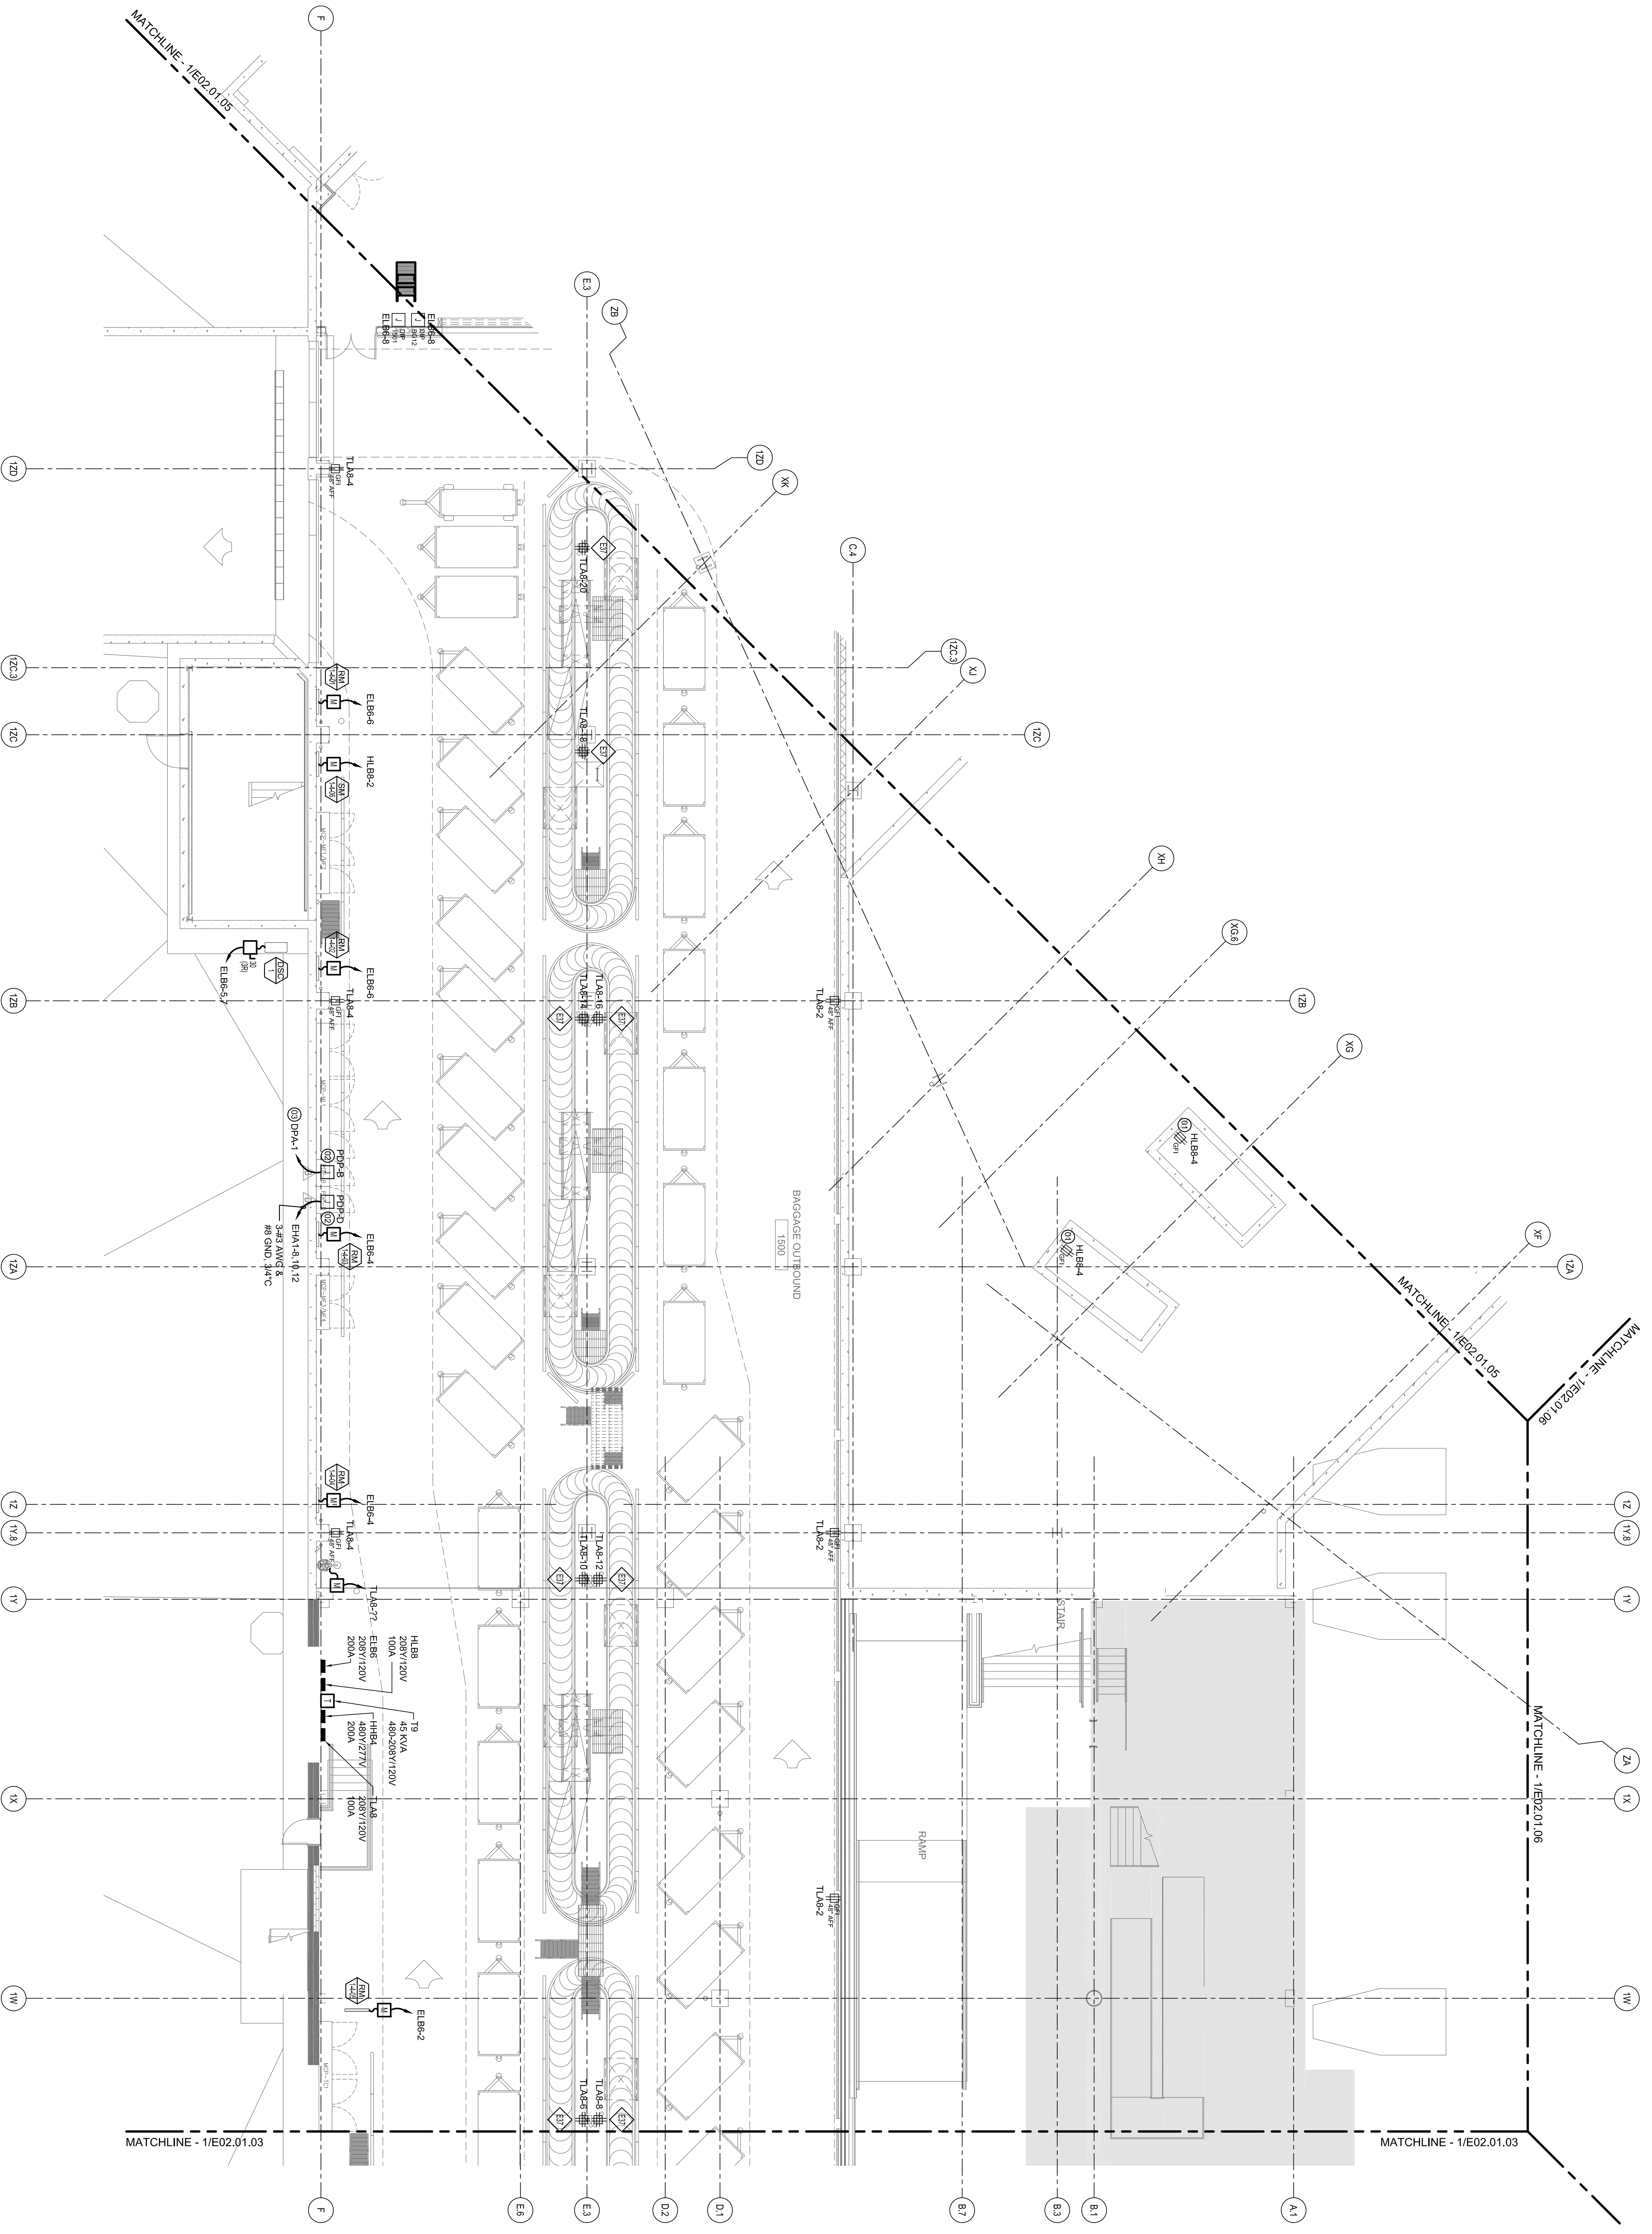


GENERAL NOTES

- A SEE SHEET E00.00 FOR LEGEND AND GENERAL NOTES.
- B CONTRACTOR SHALL REFER TO FIRE ALARM, SECURITY, IT, AND PUBLIC ADDRESS SYSTEMS DRAWINGS FOR CONDUITS & WIRING REQUIREMENTS.

Issue	Date & Issue Description	By	Checked
01	07/11/03	LAM	BHG
02	09/22/03	LAM	BHG
03	DESIGN DEVELOPMENT	LAM	BHG
04	75% CONSTRUCTION DOCUMENTS	LAM	BHG
05	95% CONSTRUCTION DOCUMENTS	LAM	BHG
06	ISSUED FOR PERMIT	LAM	BHG

KEY PLAN

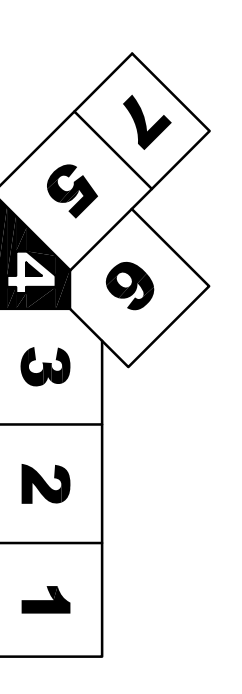

E02.01.04

Scale: 1/8" = 1'-0"

Ref. North

Project Name: PIM Terminal Expansion
 Project Number: E02.01.04
 Drawing Title: ELECTRICAL POWER PLAN - LEVEL 1 - ZONE 4
 Designer: T. SCHWARTZ
 Checker: T. SCHWARTZ