


1 TYPICAL DOOR INTERFACE PANEL
FA12.01 NTS

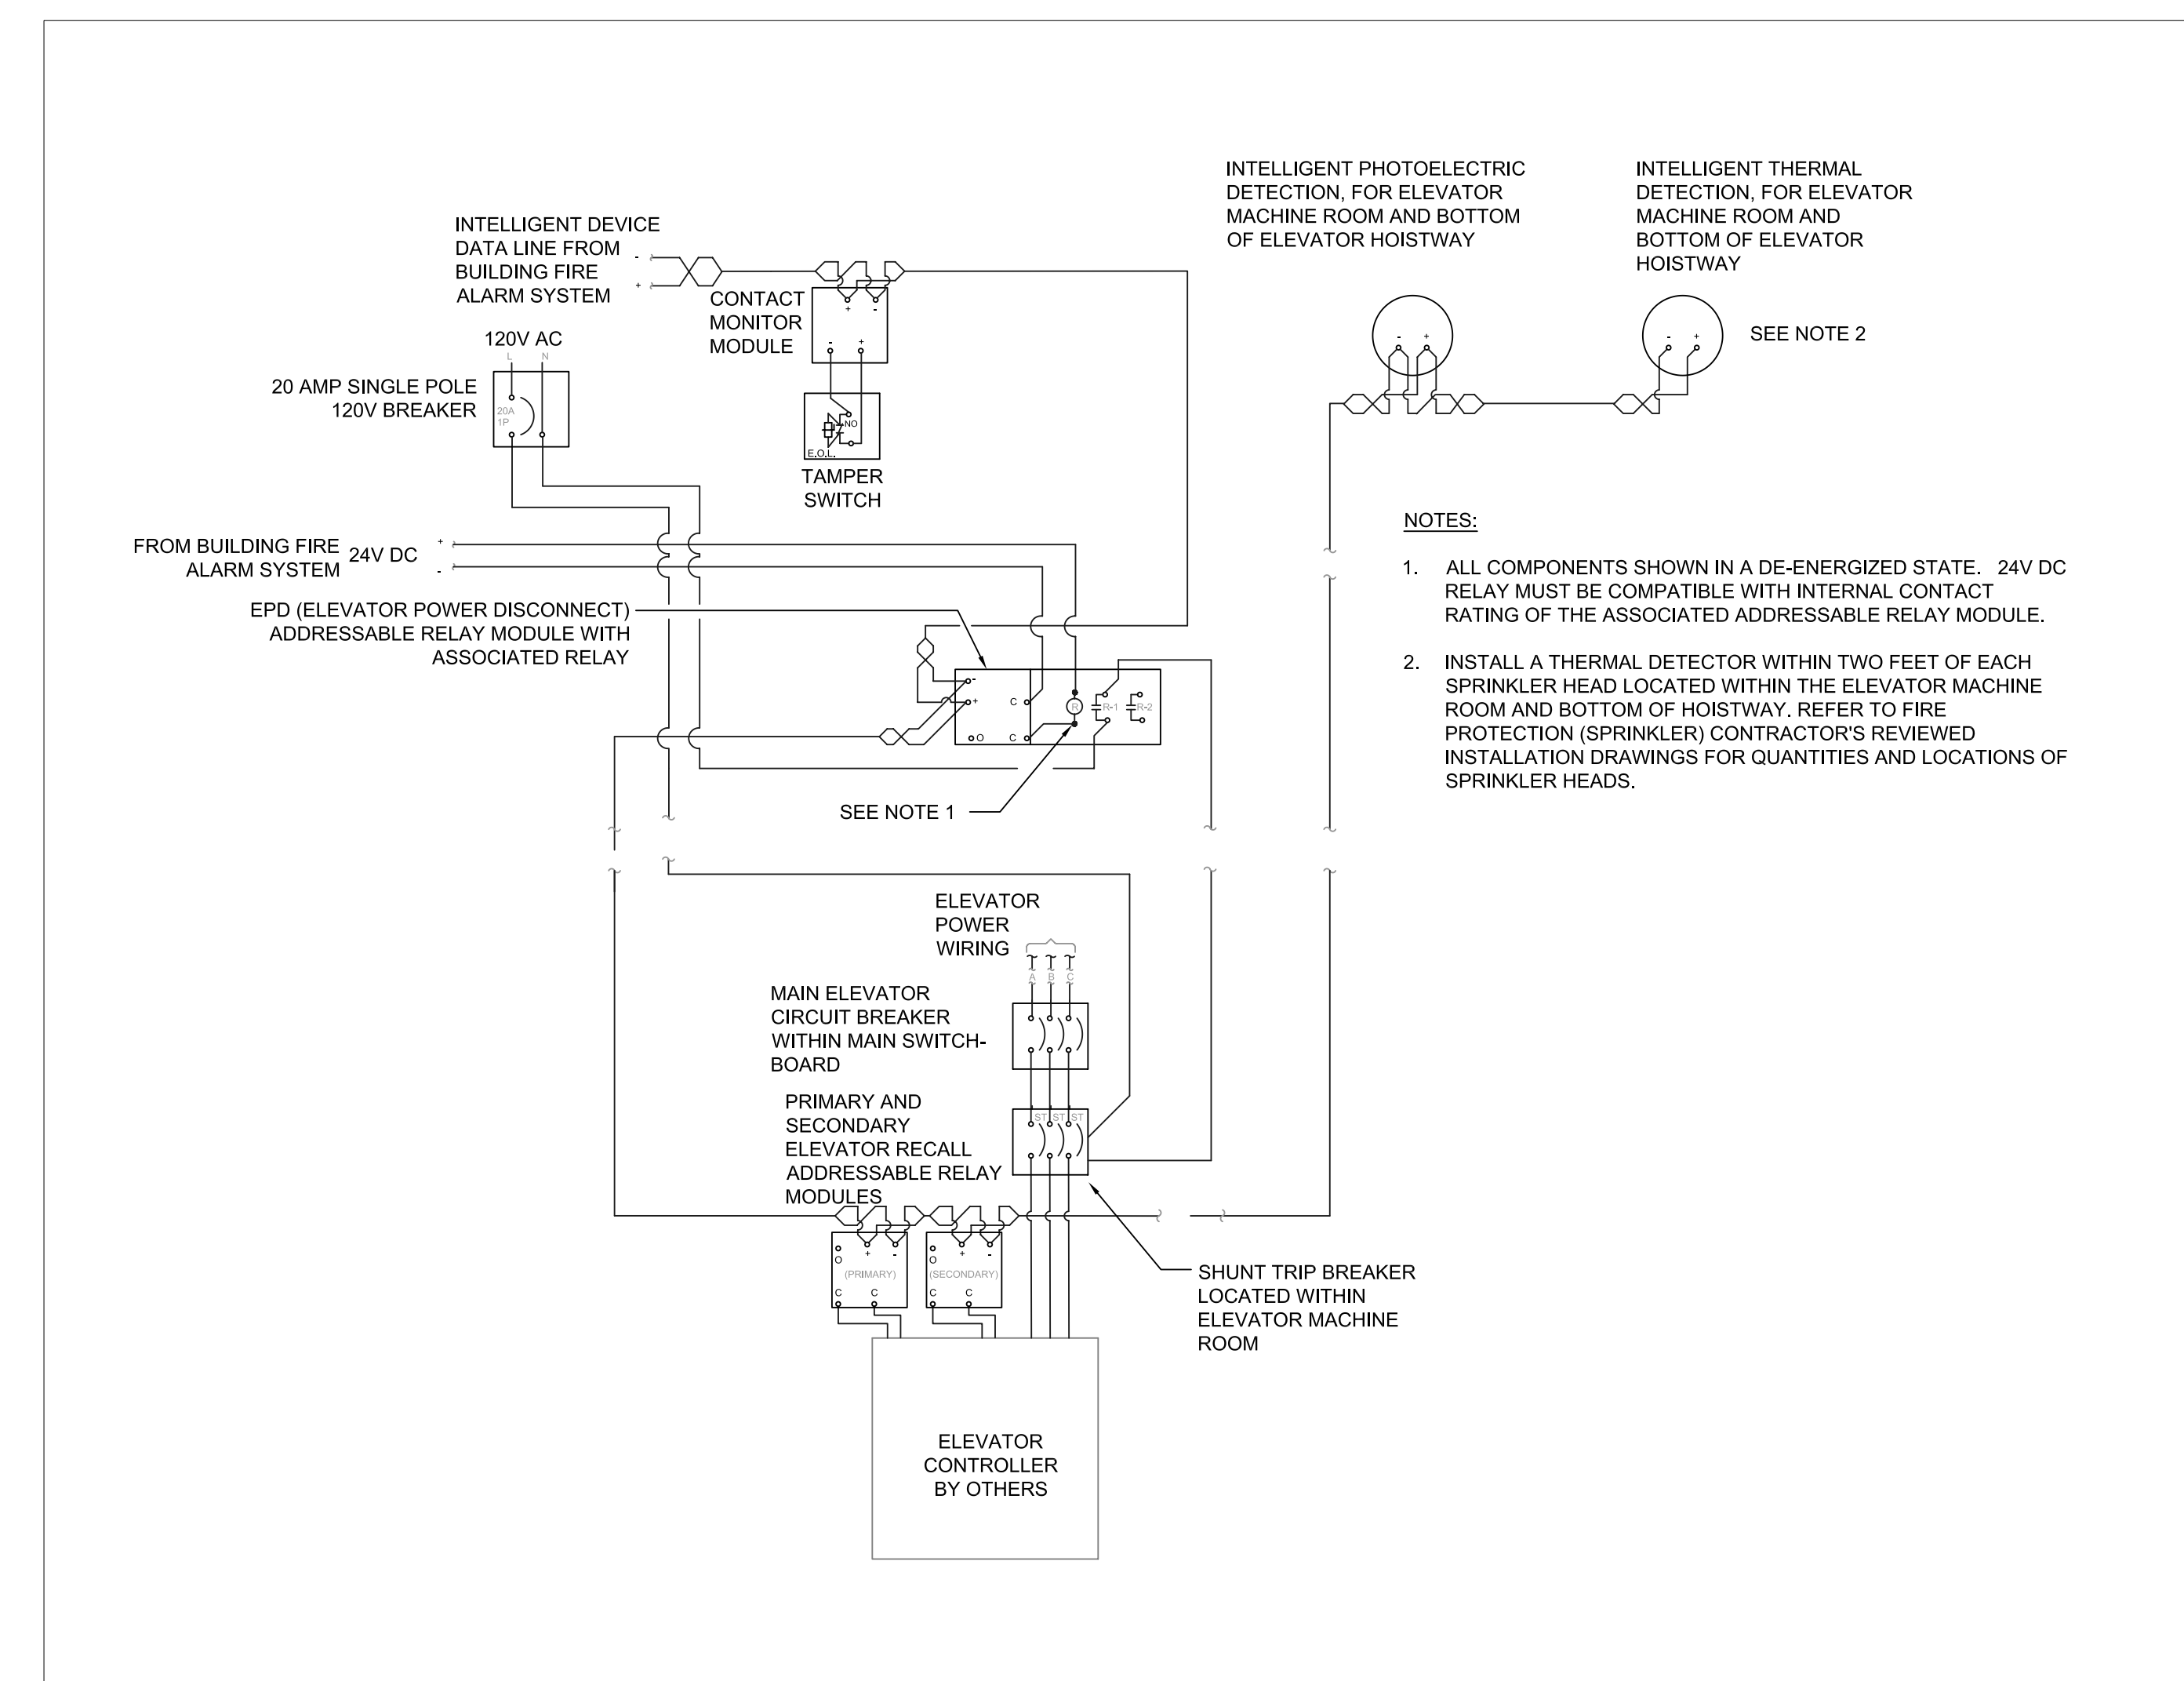

2 TYPICAL ELEVATOR SHUNT TRIP DETAIL
FA12.01 NTS

SHEET NOTES

GENERAL NOTES

- A FIRE ALARM CONTRACTOR SHALL COORDINATE WITH THE SECURITY CONTRACTOR FOR THE LOCATION OF CONTROL MODULE WITH RESPECT TO THE LOCATION OF DOOR INTERFACE PANEL.
- B INSTALLATION AND INTERFACING OF THE CONTROL MODULE WITH THE DOOR INTERFACE PANEL SHALL BE THE RESPONSIBILITY OF THE FIRE ALARM CONTRACTOR. THE INTERFACING SHALL BE PERFORMED IN THE PRESENCE OF THE SECURITY CONTRACTOR.

Portland International Jetport
1001 Westbrook Street
Portland, Maine 04102

Gensler
2020 K Street, Northwest
Suite 200
Washington DC 20006
Telephone 202.721.5200
Facsimile 202.872.8587

ARORA
Solutions for Secure Environments
Arora Engineers, Inc.
61 Wilmington - West Chester
Pike
Suite # 100
Chadds Ford, PA 19317
Tel: (610) 459-7900
Fax: (610) 459-7950

Issue	Date & Issue Description	By	Check
	10/26/09		
	100% ISSUED FOR PERMIT		

Seal/Signature

Project Name
PJM TERMINAL EXPANSION

Project Number

CAD File Name
FA12.01

Description
FIRE ALARM PANEL DIAGRAM

Scale
As Indicated

FA12.01

©2006 Gensler