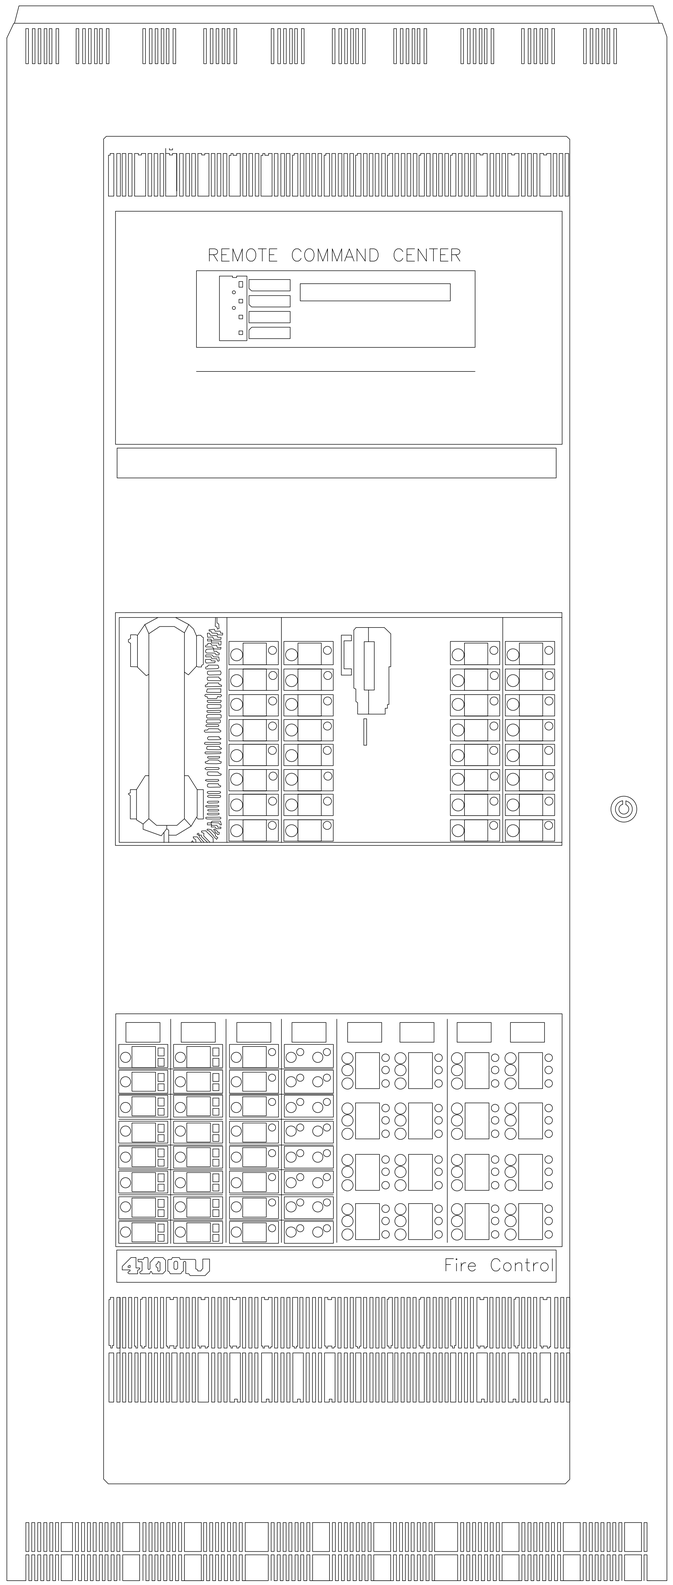

1 FA12.03 TYPICAL 4100 FIRE ALARM CONTROL PANEL
NTS

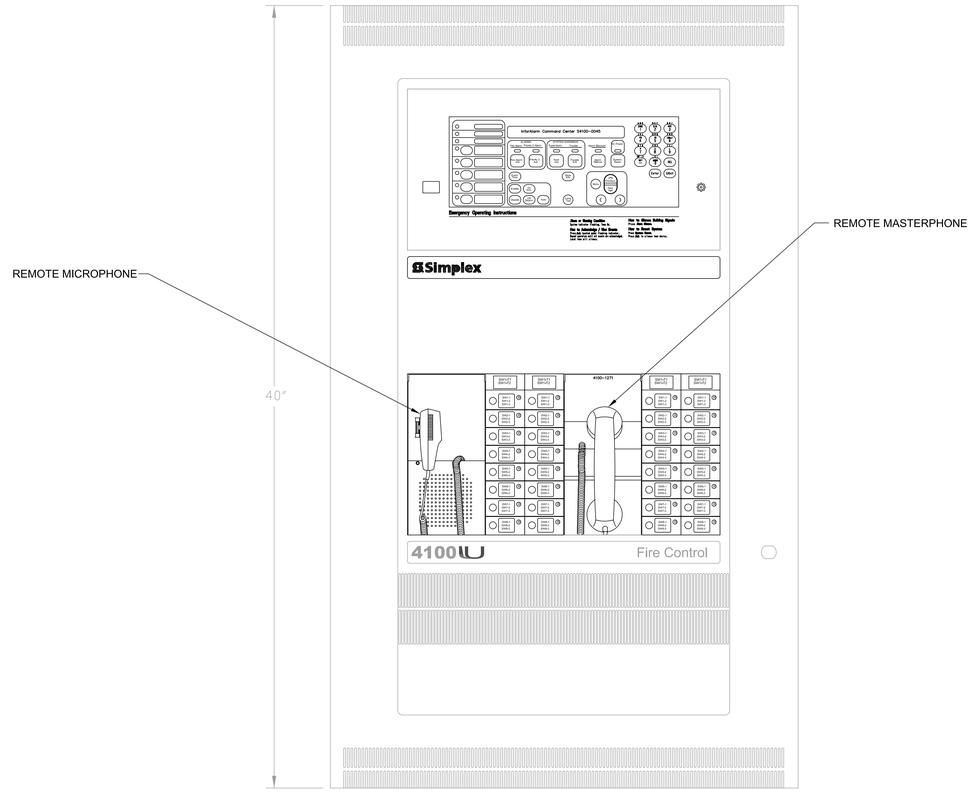

2 FA12.03 TYPICAL REMOTE ANNUNCIATOR PANEL
NTS

SHEET NOTES

GENERAL NOTES

A MOUNTING FOR ALL DEVICES SHALL COMPLY WITH IBC 2003, NFPA 90A, NFPA 72, NEC, ADAAG AND ALL APPLICABLE LOCAL CODES.

Portland International Jetport

1001 Westbrook Street
Portland, Maine 04102

Gensler
2020 K Street, Northwest
Suite 200
Washington DC 20006
Telephone 202.721.5200
Facsimile 202.872.8587

ARORA Solutions for Secure Environments
Arora Engineers, Inc.
61 Wilmington - West Chester Pike
Suite #100
Chadds Ford, PA 19317
T: (610) 459-7900
F: (610) 459-7950

Issue	Date & Issue Description	By	Check
	10/26/09		
	100% ISSUED FOR PERMIT		

Seal/Signature



Project Name
PWM TERMINAL EXPANSION

Project Number

CAD File Name
FA12.03

Description
FIRE ALARM
DETAILS

Scale
As Indicated

FA12.03

©2006 Gensler

DETAILS
SCALE: NOT TO SCALE