

**SHEET NOTES**

- 01 PROVIDE 1" VALVED HWS & HWR FOR FUTURE INSTALLATION OF VAV BOX.
- 02 RUN HWS/HWR CONCEALED IN FINNED RADIATION ENCLOSURE.
- 03 LOCATE HEAT EXCHANGER IN SNOWMELT MANIFOLD CABINET ENCLOSURE.

**Portland International Jetport**  
 1001 Westbrook Street  
 Portland, Maine 04102

**Gensler**  
 2020 K Street, NW  
 Suite 200  
 Washington, DC 20006  
 Telephone 202.721.5200  
 Facsimile 202.872.8587

**oest ASSOCIATES, INC.**  
 360 Galloway Road, South Portland, ME 04106 P: (207) 741-1770 F: (207) 774-2444 www.oest.com  
 engineers • architects • surveyors • construction managers

**GENERAL NOTES**

- A SEE SHEET M00.00 FOR LEGEND AND GENERAL NOTES.
- B MAINTAIN 18" MIN CLEARANCE FROM RADIANT TUBING TO FLOOR DRAINS, COLUMN WRAPS, PLUMBING FIXTURES, EQUIPMENT SUPPORTS, AND PIPING AT FLOORS.
- C RUN ALL PIPING HIGH AS POSSIBLE WITHIN BEAM POCKET TO AVOID BAGGAGE HANDLING EQUIPMENT.

Issue	Date & Issue Description	By	Check
01	07/11/08	PWZ	RHB
02	09/22/08	PWZ	RHB
03	12/03/08	PWZ	RHB
04	01/23/09	PWZ	RHB
05	10/26/09	PWZ	RHB

SeedSignature

ROBERT BROWN  
 No. 4602  
 10/26/09

Project Name  
 PWM Terminal Enhancement

Project Number  
 09-6395-000

CAD File Name  
 T:\6330\01\Sheet\M02.02.05.dwg


Description  
 MECHANICAL PIPING PLAN - LEVEL 2 - ZONE 5

Scale  
 1/8" = 1'-0"

**M02.02.05**

©2009 Gensler

**KEY PLAN**

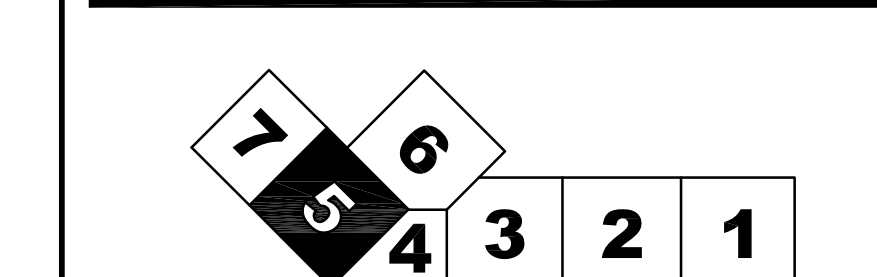

**MECHANICAL PIPING PLAN - LEVEL 2 - ZONE 5**  
 SCALE: 1/8" = 1'-0"