

**SHEET NOTES**

- 01 PROVIDE 1" VALVED HWS & HWR FOR FUTURE INSTALLATION OF VAV BOX.
- 02 RUN HWS/HWR CONCEALED IN FINNED RADIATION ENCLOSURE.

**GENERAL NOTES**

- A SEE SHEET M00.00 FOR LEGEND AND GENERAL NOTES.
- B MAINTAIN 18" MIN CLEARANCE FROM RADIANT TUBING TO FLOOR DRAINS, COLUMN WRAPS, PLUMBING FIXTURES, EQUIPMENT SUPPORTS, AND PIPING AT FLOORS.
- C RUN ALL PIPING HIGH AS POSSIBLE WITHIN BEAM POCKET TO AVOID CEILING MOUNTED EQUIPMENT & FIXTURES.


Issue	Date & Issue Description	By	Check
01	07/11/08	PWZ	RHB
02	09/22/08	PWZ	RHB
03	12/03/08	PWZ	RHB
04	01/23/09	PWZ	RHB
05	10/26/09	PWZ	RHB

Project Name: PWM Terminal Enhancement  
 Project Number: 09-6395-000  
 CAD File Name: T:\6330\101\Sheets\M02.03.04.dwg  
 Description: MECHANICAL PIPING PLAN - LEVEL 3 - ZONE 4

Issue Date: 10/26/09

Signature: *Robert Brown*  
 STATE OF MAINE  
 ROBERT BROWN  
 No. 4602

**KEY PLAN**

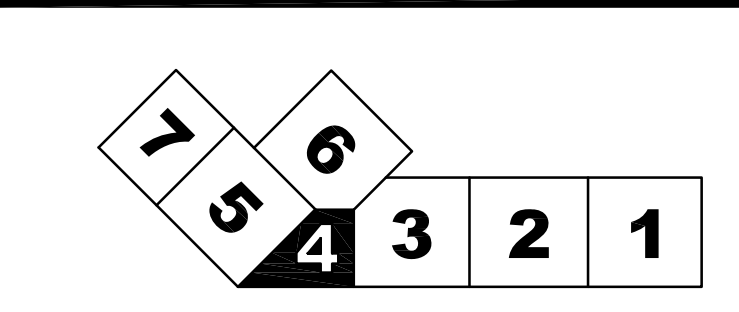

Scale: 1/8" = 1'-0"  
 Ref. North

**M02.03.04**

